




Install Carbon Monoxide (CO) Alarms

Island Grantee Job Aid

Aligns With Standard Work Specification 2.0102.1



Select battery-operated CO alarms that are listed and labeled in accordance with UL 2034 or approved by the **Authority Having Jurisdiction (AHJ)** and minimally have sealed, non-replaceable batteries and a 10-year manufacturer's warranty. **2.0102.1a.**

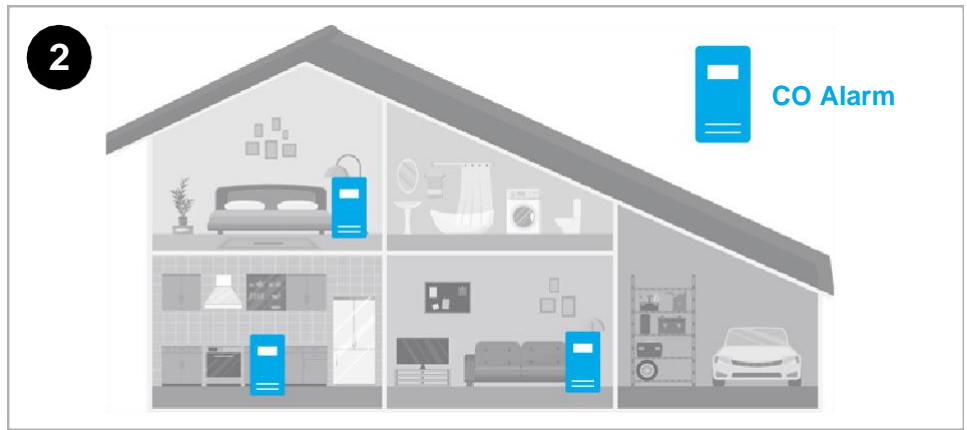

Install CO alarms in all homes where not present or inoperable in compliance with **ASHRAE 62.2-2016** (which references **NFPA 72**). Locations are to be determined by the AHJ. **2.0102.1b.**

Avoid installation near vents, windows, exterior doors, in dead air spaces, or closer to combustion equipment than manufacturer recommendations.



Install the CO alarm in accordance with manufacturer instructions. **2.0102.1c.**



Provide occupants with the manufacturer written instructions. **2.0102.1d.**



Checklist

Install Carbon Monoxide (CO) Alarms

DESIRED OUTCOME

Properly selected and installed CO alarms.

- ☐ Verify UL 2034 label.
- ☐ Verify appropriate location according to NFPA 72 and WAP requirements.

ACKNOWLEDGEMENTS

Developed for the U.S. Department of Energy by Simonson Management Services (SMS) under contract #89243422FEE400259, with input from Weatherization trainers and providers throughout the country and the generous assistance of Catkins Solutions, Guam Energy Office, National Renewable Energy Laboratory, Richard Heath & Associates, and WxTV.

