




GEOHERMAL HEAT PUMP CASE STUDY:

Leon County Extension

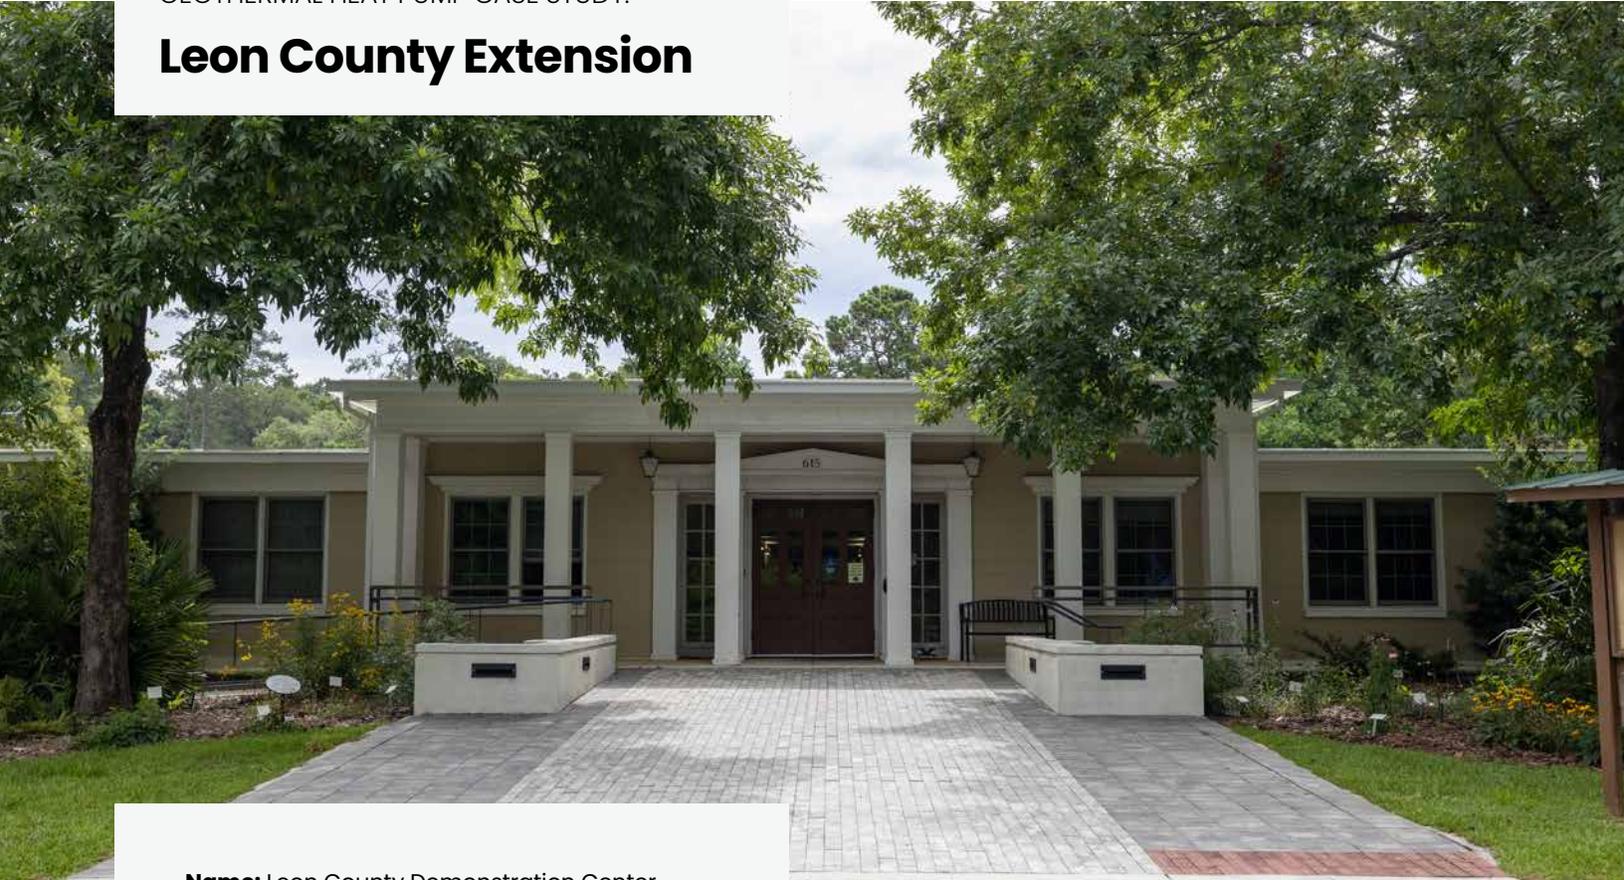

Name: Leon County Demonstration Center

Location: Tallahassee, Florida

Site Type: Office building

Size:

- 60 vertical boreholes, each 90 feet deep
- 8 heat pumps
- 13,000-square-foot building

Unique Features:

- 3 individual loop zones for resiliency

Energy Savings: 40% energy savings over traditional HVAC

Cost Savings:

- System requires about 1/10 of the maintenance costs as traditional HVAC
- Borefield maintenance is virtually zero

Funding Sources: U.S. Department of Energy through the American Recovery and Reinvestment Act of 2009

The University of Florida Institute of Food and Agricultural Sciences Leon County Extension building in Tallahassee, Florida, installed a geothermal heat pump to help meet their energy goals. *Photo from Leon County Government*

Educating the Community

Through the partnership of Leon County Government in Florida and the University of Florida Institute of Food and Agricultural Sciences (UF/IFAS), the Leon County Extension program yielded a long history of improving lives in the community. Through demonstration sites and interactive exhibits, this program provides local residents access to critical knowledge in agriculture, natural resources, and life sciences.

Leon County Government identified the UF/IFAS Leon County Extension office as an opportunity to use the 1962 cinderblock structure as a demonstration building to educate the community about multiple energy systems.

Completed in Just Six Weeks

A team from Leon County Government and consultants began to identify energy projects to minimize peak energy demand and reduce utility costs in the building, including a solar photovoltaic



Teaching Future Generations About Energy. Student visitors learn how the stable ground temperature can offset energy costs through geothermal. *Photo from Leon County Government*

(PV) system, lighting retrofit, thermostat setbacks, and a geothermal heat pump (GHP) system. The Leon County Extension Program received funding for the project from Leon County Government as well as grants, such as \$178,000 in state-allocated federal funding.

The geothermal heat pump system took six weeks to complete and was finished in 2012. The system includes a closed-loop geothermal borefield with 60 vertical wells around 90 feet deep with three individual loop zones for resiliency. If one loop needs repairs, the other two will continue to operate. The borefield is also used as an educational event parking overflow that remains pervious to rainwater.

Eight geothermal heat pumps replaced nine traditional air conditioning condensers and allow the system to remove or recover heat, depending on the season. Most of the geothermal heat pump system's heaviest work happens during the hot and humid northern Florida summer months.

The building features an educational kitchen for visitors to learn about food safety and staff to prepare food for local families as well as attendees at youth summer camps. Recovered waste heat from the geothermal heat pump system supplies this kitchen with hot water.

Impacted by History

The geothermal heat pump system only supplies about 50% of the 13,000 square foot building's conditioned air. The reason for this can be explained by the building's not-too-distant past.

As with any retrofit to an existing structure that has been used for decades, mysteries and vital historical elements surface. This was no different when the team began to plan and design air distribution for their geothermal heat pump system. While reviewing the original plans from 1962, the team realized that the building was originally constructed as a racially segregated building, even featuring segregated air conditioning infrastructure.

The existence of two mechanical rooms is unusual, as is the segmented air supply system. The separate HVAC systems influenced the decision to allocate the geothermal heat pump system to about 50% of the building; a traditional natural gas HVAC system serves the other half.

Less Energy and Maintenance

Fast forward to the present day and the geothermal heat pump system continues to reduce energy and maintenance costs. The system has 40% energy savings compared to a traditional HVAC system and requires about 1/10 of the maintenance costs. In addition, the geothermal borefield has virtually zero maintenance except for an annual fluid test. In fact, the County's training of new maintenance staff focuses primarily on conventional HVAC because upkeep on the geothermal heat pump borefield is negligible.



The geothermal system has been a key part of infrastructure allowing the building to stand up to evolving demands, even as we've doubled the number of staff that occupy the site. ”

Maggie Theriot; Director of the Office of Resource Stewardship; Leon County, Florida

Contact: Maggie Theriot, theriotm@leoncountyfl.gov

Visit the [Case Studies](#) page to see more examples of [geothermal heat pumps](#) in action.



For more information, visit:
www.energy.gov/eere/geothermal/geothermal-heat-pumps

DOE/GO-102025-6443 • July 2025