



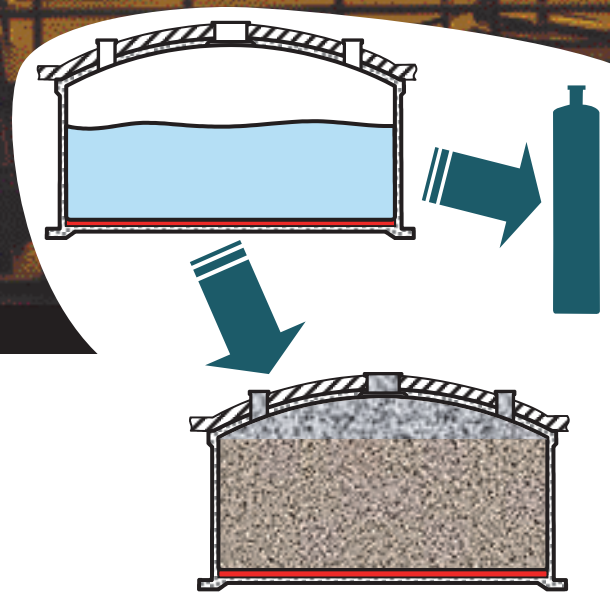

Savannah River Site Liquid Waste Planning Process

L IQUID Waste System Plan

An Integrated System at the Savannah River Site

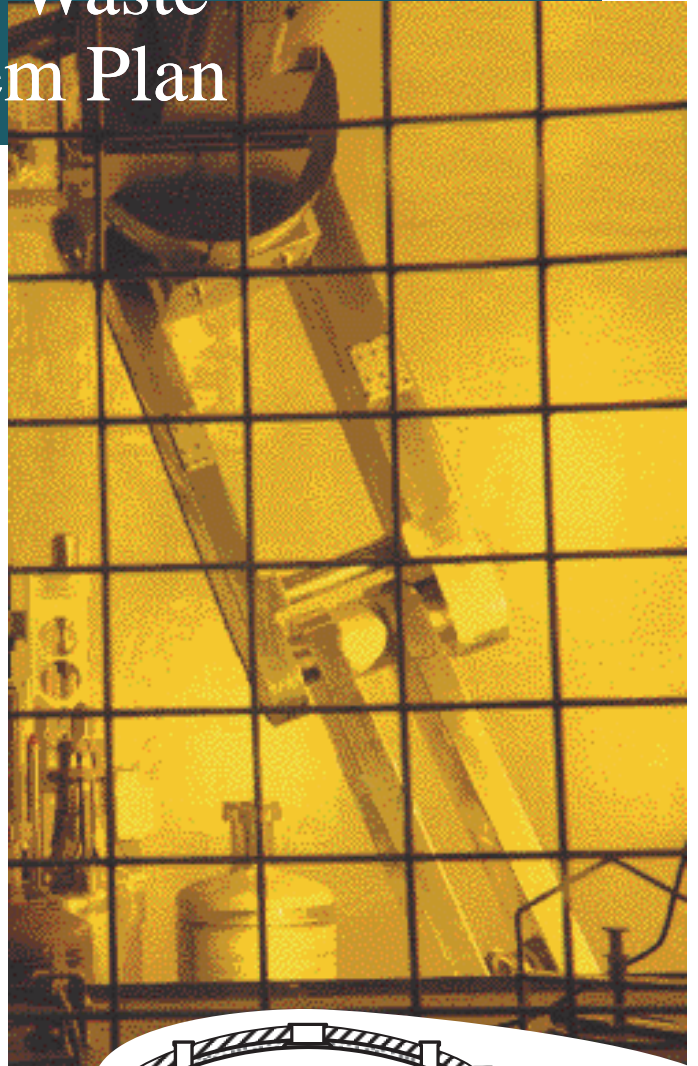

REVISION 18

June 2013

SRR-LWP-2009-00001

REVISION: 18

June 24, 2013

KEYWORDS: Tank Farm, Salt Program

DWPF, Liquid Waste

ETF, Sludge Washing

Lifecycle, Waste Solidification

MCU, ARP, CSSX, SWPF

RETENTION: PERMANENT

Liquid Waste System Plan Revision 18

D. P. Chew

B. A. Hamm

Approvals:




L. David Olson
SRR President & Project Manager




Terrel J. Spears
Assistant Manager for Waste Disposition Project

Authors

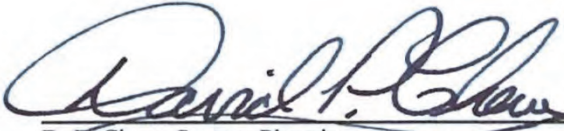

D. P. Chew, System Planning




B. A. Hamm, System Planning

Reviews



L. T. Ling, Manager, System Planning



R. W. Blackmon, Manager, Project Integration, and Planning

Table of Contents

1. EXECUTIVE SUMMARY	1
PURPOSE	1
COMMON GOALS & VALUES	2
GOALS	2
REVISIONS	3
RESULTS OF THE PLAN	3
2. INTRODUCTION	5
2.1 COMMON GOALS & VALUES	5
2.2 GOALS	7
2.3 ALTERNATIVE ANALYSES	11
2.4 RISK ASSESSMENT	11
3. PLANNING BASES	12
3.1 FUNDING	12
3.2 REGULATORY DRIVERS	12
3.3 REVISIONS	13
3.4 KEY MILESTONES	14
4. PLANNING SUMMARY AND RESULTS	15
4.1 DISPOSITION OF SLUDGE WASTE	15
4.2 DWPF OPERATIONS	16
4.3 DISPOSITION OF SALT WASTES	18
4.3.1 Actinide Removal Process / Modular CSSX Unit (APR/MCU)	19
4.3.2 Small Column Ion Exchange (SCIX)	22
4.3.3 Salt Waste Processing Facility (SWPF)	23
4.4 SALTSTONE OPERATIONS	25
4.5 WASTE REMOVAL AND TANK CLOSURE	25
4.5.1 Waste Removal and Tank Cleaning	25
4.5.2 Tank Closure and Stabilization	28
4.6 BASE OPERATIONS	29
4.6.1 Supporting Nuclear Material Stabilization	29
4.6.2 DWPF Recycle Handling	30
4.6.3 Transfer Line Infrastructure	30
4.6.4 Tank 50 Equipping for HLW Service	30
4.6.5 Effluent Treatment Facility	30
4.6.6 Managing Type III Tank Space	31
4.7 CLOSURE SEQUENCE FOR THE LIQUID WASTE SYSTEM	31
5. ALTERNATIVE ANALYSES	33
5.1 2023 SWPF STARTUP	33
6. DESCRIPTION OF ASSUMPTIONS AND BASES	34
6.1 PRIORITIES FOR PLAN DEVELOPMENT	34
6.2 FUNDING	34
6.3 REGULATORY DRIVERS	34
6.4 WASTE REMOVAL AND TANK REMOVAL FROM SERVICE PROGRAM	34
6.5 DWPF PRODUCTION	35
6.6 SALT PROGRAM	36
6.7 SALTSTONE PRODUCTION	38
6.8 BASE OPERATIONS	38
7. SYSTEM DESCRIPTION	40
7.1 HISTORY	40
7.2 TANK STORAGE	40
7.3 WASTE TANK SPACE MANAGEMENT	42
7.4 WASTE REMOVAL FROM TANKS	43
7.5 SAFE DISPOSAL OF THE WASTE	44
7.6 SALT PROCESSING	44

7.7	SLUDGE PROCESSING	45
7.8	DWPF VITRIFICATION.....	45
7.9	SALTSTONE DISPOSITION	45
APPENDIX A — SALT SOLUTION PROCESSING, BASE CASE		50
APPENDIX B — SLUDGE PROCESSING.....		51
APPENDIX C — CANISTER STORAGE		52
APPENDIX D — BWRE & REMOVAL FROM SERVICE, BASE CASE.....		53
APPENDIX E — TANK FARM INFLUENTS AND EFFLUENTS		54
APPENDIX F — REMAINING TANK INVENTORY		56
APPENDIX G — LW SYSTEM PLAN — REV 18 SUMMARY		57
APPENDIX H — SALT SOLUTION PROCESSING, ALTERNATE CASE.....		58
APPENDIX I — BWRE & REMOVAL FROM SERVICE, ALTERNATE CASE		59
APPENDIX J — ACRONYMS		60
REFERENCES.....		62

Index of Tables

Table 1-1 — <i>Results of the Plan</i>	3
Table 3-1 — <i>Key Milestones</i>	14
Table 4-1 — <i>Planned DWPF Production Rates</i>	17
Table 4-2 — <i>ARP/MCU Salt Batch Composition</i>	21
Table 4-3 — <i>SCIX Salt Batch Composition</i>	22
Table 4-4 — <i>SWPF Batch Composition</i>	23
Table 4-5 — <i>Closure Activities</i>	32
Table 6-1 — <i>Evaporator Utilities</i>	38

Index of Figures

Figure 2-1 — <i>Bulk Waste Removals</i>	8
Figure 2-2 — <i>Tank Closures</i>	8
Figure 2-3 — <i>Curies at Risk</i>	9
Figure 4-1 — <i>Sludge Feed Preparation</i>	15
Figure 4-2 — <i>Schematic of the ARP/MCU Process</i>	19
Figure 4-3 — <i>WOW Deployment for BWRE</i>	26
Figure 4-4 — <i>Modified Density Gradient Salt Removal</i>	27
Figure 4-5 — <i>Grout Placement</i>	29
Figure 4-6 — <i>Grouted Tank</i>	29
Figure 5-1 — <i>Salt Solution Remaining</i>	33
Figure 5-2 — <i>Tank Closure Projections</i>	33
Figure 7-1 — <i>Waste Tank Composite Inventory (as of December 31, 2012)</i>	42
Figure 7-2 — <i>Process Flowsheet</i>	48
Figure 7-3 — <i>Liquid Waste Program — Current Status</i>	49

1. Executive Summary

Treatment and disposition of salt waste is the critical path to completion of the Savannah River Site (SRS) Liquid Waste (LW) Disposition Program. During the period prior to startup of the Salt Waste Processing Facility (SWPF), salt waste disposition will continue through the Actinide Removal Process (ARP) and Modular Caustic Side Solvent Extraction (CSSX) Unit (MCU) facilities. Deliquification, Dissolution and Adjustment (DDA) processing was required prior to startup of the ARP/MCU facilities to enable continued tank closure activities, to sustain sludge disposition activities in the Defense Waste Processing Facility (DWPF), and to minimize continued limited use of old-style tanks. During the DDA phase, approximately 2.8 million gallons of dissolved salt solution from Tank 41 and associated adjustment streams were dispositioned. Another 3.2 million gallons of salt waste have been dispositioned through ARP/MCU since startup in April 2008.

With the December 2010 Revision 16 of the *Liquid Waste System Plan*¹ (hereinafter referred to as the “*Plan*”) DOE summarized a comprehensive, integrated program execution strategy for optimized LW system performance. Revision 16 of the System Plan included deployment of several new technologies such as:

- Small Column Ion Exchange (SCIX) to supplement the salt waste treatment capabilities of ARP/MCU and SWPF
- Enhanced chemical cleaning of tanks after the bulk waste removal efforts (BWRE) are complete
- Melter bubbler technology to improve the capacity of the DWPF melter
- DWPF feed preparation improvements to reduce processing time within DWPF
- Rotary microfiltration (RMF) to decrease sludge preparation cycle time
- Low temperature aluminum dissolution (LTAD) of sludge to minimize DWPF canister count
- Optimization of the tank closure process to enable a reduction in the tank closure process cycle time.

These actions would have resulted in maximizing sludge and salt processing, doubling DWPF throughput, closing old-style tanks ahead of the schedule required by regulatory agreements, and accelerating completion of the program lifecycle.

The February 2012 Revision 17² of the *Plan* included updated inputs and assumptions. The primary constraints which limit program execution per the accelerated Revision 16 pathway are, *first*, funding targets significantly below previously assumed levels and, *second*, realignment of the SWPF Project schedule. Revision 17 still projected tank closures and program completion on or ahead of regulatory commitments, albeit on a “just-in-time” basis for most activities.

This eighteenth revision of the *Plan* recognizes challenges from the further delay of SWPF and its concomitant effect on regulatory milestones. It also recognizes additional challenges in funding. Preliminary funding guidance for Fiscal Year 2014 (FY14) and projections for future years are significantly less than needed to execute the mission as outlined in Revision 17 of the *Plan*. These reduced funding levels combined with further delay in the SWPF drove the need for a revised approach. The President’s Budget Request (PBR), however, was submitted after the development of this plan. Therefore, the impacts to the LW program from the PBR are not reflected in this *Plan*. This *Plan* mitigates the effect of these challenges by continuing to reinvent the SRS LW Program in a way that integrates the smartest combination of facility operating schedules, supporting infrastructure upgrades, and workforce management actions to enable the completion of as many deliverables as possible under reduced budget projections. The overarching objective of this *Plan* is to ensure safe storage of the waste and minimize extension of the remaining time at risk associated with legacy high level waste storage in aging tanks.

Equally important is timely approval of major scope items (e.g., Saltstone Disposal Unit #6 (SDU-6) and following, Small Column Ion Exchange, additional Glass Waste Storage, etc.). This *Plan* assumes the availability of these facilities that require multi-year construction projects and approvals well before the need date. Delay in approving these major scope items will interfere with the accomplishment of the goals of this *Plan*.

Safe storage, risk reduction, and provision of necessary facilities are essential precursors to successful closure of waste tanks.

Purpose

The purpose of this *Plan* is to integrate and document the activities required to disposition the existing and future High Level Waste (HLW) and to remove from service radioactive LW tanks and facilities at the Department of Energy (DOE) at SRS. It records a planning basis for waste processing in the LW System through the end of the

program mission. Development of this *Plan* is a joint effort between DOE-Savannah River (DOE-SR) and Savannah River Remediation LLC (SRR).

This *Plan* satisfies the contract deliverable described in Contract N^o DE-AC09-09SR22505; Part III — List of Documents, Exhibits, and Other Attachments; Section J — List of Attachments; Appendix M — Deliverables; Item N^o 1 — *Liquid Waste System Plan*.³

This eighteenth revision (Revision 18) of the *Plan*:

- Provides one of the inputs to development of financial submissions to the complex-wide Integrated Planning, Accountability, & Budgeting System (IPABS)
- Provides a basis for LW contract and Contract Performance Baseline changes.

Common Goals & Values

The overarching principles which govern strategic planning and execution of the SRS Liquid Waste Disposition Program are summarized well in the seven “Common Goals and Values” that were agreed upon by key stakeholders almost a decade ago. These remain the guiding goals and values for program execution and planning:

1. Reduce operational risk and the risk of leaks to the environment by removing waste from tanks, and closing the tanks
2. Remove actinides from waste expeditiously since they impact on the environment most significantly if a leak occurs.
3. Maximize amount of waste ready for disposal in deep geologic repository. Make significant effort to ensure maximum amount of long lived radionuclides are disposed in a deep geologic repository.
4. Remove as much cesium as practical from salt waste and dispose in parallel with vitrified sludge.
5. Dispose of cesium as soon as practical to avoid having cesium only waste when sludge vitrification is complete.
6. Limit disposal of radioactive waste onsite at SRS so that residual radioactivity is as low as reasonably achievable.
7. Ensure DOE’s strategy and plans are subject to public involvement and acceptance.

Goals

The goals of previous revisions of this *Plan*, through Revision 17, have always been to meet *Federal Facility Agreement* (FFA)⁴ and *Site Treatment Plan* (STP)⁵ regulatory commitments. However, with the delays of SWPF beyond October 2014, as demonstrated in Revision 17, these regulatory commitments have been adversely affected:

- Meet tank bulk waste removal efforts regulatory milestones in the currently-approved FFA
- Meet tank removal-from-service regulatory milestones in the currently-approved FFA
- Meet the waste treatment goals identified in the STP

The goals of this *Plan*, then, are to meet the following programmatic objectives:

- Continue storing liquid radioactive wastes in a safe and environmentally sound manner
- Optimize program life cycle cost and schedule to minimize extension of the remaining time-at-risk associated with legacy high level waste storage in aging tanks
- Conduct operations consistent with the Section 3116 Determination for Salt Waste Disposal at the Savannah River Site⁶, the Basis for Section 3116 Determination for Salt Waste Disposal at the Savannah River Site⁷, the *Section 3116 Determination for Closure of F-Tank Farm at the Savannah River Site*⁸, the *Basis for Section 3116 Determination for Closure of F-Tank Farm at the Savannah River Site*⁹, and future Waste Determination (WD) and Basis documents for H-Tank Farm
- Comply with applicable permits and consent orders, including the Modified Class 3 Landfill Permit for the SRS Z-Area Saltstone Disposal Facility (SDF) (permit ID 025500-1603) and State-approved area-specific General Closure Plans
- Provide tank space to support staging of salt solution adequate to feed the SWPF per the inputs and assumptions
- Provide tank space to support staging of salt solution adequate to feed the SCIX per the inputs and assumptions
- Sustain sludge vitrification in the DWPF
- Minimize the quantity of radionuclides (as measured in curies) dispositioned in the SDF, keeping the total curies at or below the amount identified in *Savannah River Site – Liquid Waste Disposition Processing Strategy*¹⁰ (SRS LW Strategy), as amended by letter from the South Carolina Department of Health and

Environmental Control (SCDHEC) to DOE-SR¹¹ and the *Basis for Section 3116 Determination for Salt Waste Disposal at the Savannah River Site*⁷

- Support continued nuclear material stabilization of legacy materials in H-Canyon.

To enable continuation of risk reduction initiatives encompassed by the goals above, this *Plan* follows a processing strategy to provide the tank space required to support meeting, or minimizing impacts to meeting, programmatic objectives. During the period prior to startup of SWPF in 2018, near-term retrieval, treatment, and disposal of salt waste are required. The ARP/MCU facilities provide this treatment. Operation of these salt treatment processes frees up working space in the 2F, 2H, and 3H Evaporators' concentrate receipt tanks (Tanks 25, 38, and 30 and 37, respectively). This provides support for near-term handling of waste streams generated from early-year tank removals from service, DWPF sludge batch preparation, DWPF recycle handling, and H-Canyon processing.

Revisions

The significant updates from the previous version of this *Plan*, the *Liquid Waste System Plan, Revision 17 (Rev 17)*², include:

- Modifications required due to near-term funding limitation:
 - Cancel Enhanced Chemical Cleaning (ECC) implementation
 - Reschedule implementation of SCIX
 - Delays in tank removal from service that are beyond FFA commitments for BWRE and operational closure commitments
- **Salt Processing:**
 - **SWPF Processing:** SWPF operations initiation delayed to October 2018 from October 2014
 - **SWPF Processing:** SWPF maximum processing rate increased to 9 Mgal/yr from 8 Mgal/yr
 - **SCIX Processing:** reschedule of SRR's proposal of a supplemental salt treatment process to April 2019 from October 2018 due to funding limitation
 - **SCIX Processing:** SCIX maximum processing rate increased to 3 Mgal/yr from 2.5 Mgal/yr.
- **Sludge Processing**
 - The nominal canister rate reduced to 275 from 325

Results of the Plan

Table 1-1 — *Results of the Plan* describes the major results as compared to Revision 17 of the *Plan*:

Table 1-1 — Results of the Plan

Parameter	Revision 17	This Plan
Date last LW facility removed from service	2028	2034
All bulk waste removal currently-approved FFA commitments met	Yes	No
All yearly tank removal from service currently-approved FFA commitments met	Yes	No
Final FY2022 currently-approved FFA commitment met	Yes	No
Final Type I, II, and IV tanks removed from service	2022	2028
Complete bulk salt treatment	2026	2028
Complete bulk sludge treatment	2026	2026
Complete heel treatment	2028	2032
SCIX for supplemental salt waste treatment	Yes	Yes
Next generation extractant for increased SWPF throughput	Yes	Yes
Maximum canister waste loading	43 wt%	40 wt%
Nominal annual canister throughput rate	325	275
Total number of canisters produced	7,580	7,824
Radionuclides (curies) dispositioned in SDF within the amended <i>SRS LW Strategy</i>	Yes	Yes
Radionuclides (curies) dispositioned in SDF within NDAA §3116	Yes	Yes
Total number of SDUs	12	12

- **SWPF Processing:** This *Plan* maintains the tank space required to provide feed for SWPF according to the inputs and assumptions. The nominal processing rate for SWPF increases to 9 Mgal/yr from 8 Mgal/yr due to the incorporation of an improved cesium extractant

- **Radionuclides Dispositioned in SDF:** This *Plan* is consistent with *SRS LW Strategy* as amended by letter from the SCDHEC to DOE-SR¹¹ and the *Basis for Section 3116 Determination for Salt Waste Disposal at the Savannah River Site*⁷ concerning the total curies dispositioned at SDF
- **Vitrification of Sludge at DWPF:** This *Plan* reflects:
 - updated estimates of sludge mass in Tanks 4 and 12 based on sample results (see section 4.1)
 - reduced LTAD for some of the material in Tank 13 and Tank 15
 - lower waste loadings
- **Supporting Nuclear Material Stabilization:** Sufficient Tank Farm space exists to support the receipt of projected H-Canyon waste through the end of H-Canyon operations and shutdown flows. This *Plan* accommodates receipt of additional H-Canyon waste in Tank 50 or directly to sludge batches
- **Canister Storage:** This *Plan* projects completely filling Glass Waste Storage Building (GWSB) #2 in early FY17. This requires supplemental canister storage to become available in December 2016. Shipment of canisters from SRS is not included in this *Plan* since a repository has not been identified to date
- **SDU:** SDU-1 and SDU-4 are rectangular multi-cell units; no further contaminated grout is forecast for emplacement in these units. SDU-2 (the current operating unit), SDU-3, and SDU-5 are dual cylindrical cell units with ~2.3 Mgal grout capacity (~1.3 Mgal Decontaminated Salt Solution or DSS) per cell. SDU-6 through SDU-12 are single cylindrical cell units with ~30 Mgal grout capacity (~17 Mgal DSS).

2. Introduction

This revision of the *Plan* documents the current operating strategy of the LW System at SRS to receive, store, treat, and dispose of radioactive liquid waste and to close waste storage and processing facilities. The LW System is a highly integrated operation involving safely storing liquid waste in underground storage tanks; removing, treating, and dispositioning the low-level waste (LLW) fraction in concrete SDUs; vitrifying the higher activity waste at DWPF; and storing the vitrified waste in stainless steel canisters until permanent disposition. After waste removal and processing, the storage and processing facilities are cleaned and closed. This *Plan* assumes the reader has a familiarity with the systems and processes discussed. Section 7 — *System Description* of this *Plan* is an overview of the LW System.

The Tank Farms have received over 150 million gallons of waste from 1954 to the present. Reducing the volumes of waste through evaporation and disposition of waste via vitrification and saltstone, the Tank Farms currently store approximately 37 million gallons of waste containing approximately 281 million curies of radioactivity. As of December 31, 2012, DWPF had produced 3,560 vitrified waste canisters. All volumes and curies reported as current inventory in the Tank Farms are as of December 31, 2012 and account for any changes of volume or curies in the Tank Farms since Revision 17 of the *Plan* and the *Section 3116 Determination for Salt Waste Disposal at the Savannah River Site*.

Successful and timely salt waste removal and disposal is integral to efforts by SRS to proceed with all aspects of tank cleanup and removal from service, extending well beyond permitted disposal of the solidified low-activity salt waste streams themselves. Removal and disposal of salt waste not only enables removal of tanks from service, it is necessary for the continued removal and stabilization of the high-activity sludge fraction of the waste. This is because SRS uses the tanks to prepare the high-activity waste for processing in DWPF. Salt waste is filling up tank space needed to allow this preparation activity to continue. Processing low-activity salt waste through ARP/MCU reduces, but does not eliminate, this tank space shortage and increases the likelihood that vitrification of the high-activity fraction will be able to continue uninterrupted.

Operating ARP/MCU as described in this *Plan* will enable continued stabilization of DOE Complex legacy nuclear materials. It will also increase the likelihood of feeding SCIX and SWPF per the inputs and assumptions, which would not be possible without these treatment processes. Use of ARP/MCU will allow DOE to complete cleanup and removal from service of the tanks years earlier than would otherwise be the case, which, in turn, will reduce the time during which the tanks — including several that do not have full secondary containment and some of which that have known history of leak sites — continue to store liquid radioactive waste.

2.1 Common Goals & Values

The overarching principles which govern strategic planning and execution of the SRS Liquid Waste Disposition Program are summarized well in the seven “Common Goals and Values” that were agreed upon by key stakeholders almost a decade ago. These remain the guiding goals and values for program execution and planning:

1. **Reduce operational risk and the risk of leaks to the environment by removing waste from tanks, and closing the tanks**

- Curie Workoff from ~550 million curies (MCi) in 1995 to 294 MCi in 2012 (~49 MCi in glass, 0.4 MCi in grout, and the remainder due to radioactive decay).
- Of the 14 SRS tanks (all old-style tanks) with leakage history:
 - 2 are operationally closed and grouted
 - 2 are being prepared for operation closure and grout addition later this year
 - 1 has been cleaned, pending further evaluation
 - 1 has had bulk waste removed and is undergoing chemical cleaning later this year
 - 1 has had BWRE completed
 - 5 contain essentially dry waste, with little or no free liquid supernate
 - 2 contain liquid supernate (at a level well below all known leak sites)
- Of the 24 SRS old-style tanks:
 - 4 are grouted and operationally closed
 - 2 are being prepared for operation closure and grout addition later this year
 - 5 have had bulk waste removal efforts completed

- Approximately 65% of old-style tank space is currently empty or grouted and approximately 19% of new-style tank space is empty.
2. **Remove actinides from waste expeditiously since they impact on the environment most significantly if a leak occurs.**
 - Actinides and other high activity components are being immobilized in glass as a top priority
 - To date, 3,603 canisters of waste (~47 % of the projected lifecycle total) have been vitrified
 - Canister waste loading has been raised from the originally planned ~28% to the current waste loading of ~36% and is planned to be maximized further to ~40%
 - In FY12, DWPF set a production record of 275 canisters in a fiscal year
 - In June 2012, DWPF set a production record of 338 canisters produced in a twelve-month period.
 3. **Maximize amount of waste ready for disposal in deep geologic repository. Make significant effort to ensure maximum amount of long lived radionuclides are disposed in a deep geologic repository.**
 - To date, over 99% of the curies immobilized have been placed in glass in preparation for disposal in a deep geologic repository
 - Less than 1% of treated curies have been immobilized in grout
 - At mission completion, over 99% of treated curies are projected to be immobilized in glass.
 4. **Remove as much cesium as practical from salt waste and dispose in parallel with vitrified sludge.**
 - Only 15% of the volume of salt waste originally projected to be treated via DDA- only was actually treated with that process; the remainder has been or will be treated through processes with higher cesium removal efficiency
 - Extraction of cesium from salt waste through ARP/MCU began in 2008 and to date has been ~ 10 times more efficient than the original projection
 - Deployment of Next Generation Solvent (NGS) at MCU is projected to additionally improve cesium removal efficiency
 - Efficiency of cesium removal through deployment and operation of SCIX is projected to meet all original expectations for high capacity salt processing
 - Since 2008, cesium has been (and will continue to be) disposed in parallel with vitrified sludge.
 5. **Dispose of cesium as soon as practical to avoid having cesium only waste when sludge vitrification is complete.**
 - To date, 6.1 million gallons (Mgals) of salt waste (~6% of the projected lifecycle total) have been treated and disposed.
 - Allocation of available resources is focused on maintaining the pace of risk reduction through waste treatment and immobilization.
 - The contribution of ARP/MCU will be enhanced and maximized by deploying NGS to increase cesium removal efficiency.
 - An increase to 3 Mgals/year through ARP/MCU with increased cesium removal efficiency will be demonstrated with current equipment configuration.
 - With modest equipment reconfiguration and filtration improvements, up to 4.7 Mgals/year is projected through ARP/MCU.
 - SCIX capability is projected to be deployed and demonstrated to treat an additional 3 Mgals/year of salt waste.
 - These actions would generally maintain the pace of the program to achieve and maintain salt treatment rates of 6 Mgals/year by June 2017 and 8 Mgals/year by September 2018 by using both ARP/MCU and SCIX.
 - These actions would maintain the pace of the program to complete salt waste treatment and disposal in parallel with sludge vitrification to avoid having cesium only waste when sludge vitrification is complete and avoid making additional DWPF salt only canisters.
 6. **Limit disposal of radioactive waste onsite at SRS so that residual radioactivity is as low as reasonably achievable.**
 - Formal Performance Assessments of low level waste disposal and operational closure of tanks, coupled with cost to benefit evaluations prior to cessation of tank waste removal activities, support that any residual future impacts from onsite waste disposal are well within the requirements of all applicable federal and state laws and regulations and are as low as reasonably achievable

- Based on operational experience, over 95% of the radioactive inventory in a tank has been removed after bulk waste removal and heel dilution; over 99% of the radioactive inventory has been removed after final cleaning
- At mission completion, over 99% of treated curies are projected to be immobilized in glass and packaged for offsite disposal in a deep geologic repository
- The originally agreed upon projection for onsite emplacement in engineered disposal units from liquid waste treatment and disposition was 3 MCi (2.5 MCi from DDA-only; 0.3 MCi from ARP/MCU; and 0.2 MCi from SWPF). Based on progress as of 2011, that projection for onsite emplacement was reduced to 0.8 MCi from 3 MCi
- The revised strategy to achieve salt waste treatment rates of 6 Mgals/year and 8 Mgals/year by June 2017 and September 2018, respectively, and to complete waste disposition by 2028 would maintain onsite emplacement in engineered disposal units within the reduced 0.8 MCi.

7. Ensure DOE's strategy and plans are subject to public involvement and acceptance.

- The formal processes for evaluation, determination, and execution of all tank waste removal, disposal, and operational closure fully involves SCDHEC, the Environmental Protection Agency (EPA), and the Nuclear Regulatory Commission (NRC)
- Various formal hold points exist in these processes for public involvement and comment
- All SRS Liquid Waste Disposition activities fall within the purview of DNFSB oversight, and DNFSB periodically issues publically accessible reports of their evaluations and conducts periodic meetings to receive public input regarding their activities
- The SRS Citizen's Advisory Board receives routine updates in a public venue regarding all SRS Liquid Waste Disposition activities
- Annual updates to this *Plan* are provided to all regulatory and oversight entities and made available for public review
- Quarterly updates of radiological inventory additions to SDUs are posted to a publically accessible website.
- SRR monthly and annual reports of progress towards disposition of SRS Liquid Waste are available to the public

2.2 Goals

The overarching priorities for development of this *Plan* are:

- Continual Safe Storage of liquid waste in tanks and vitrified canisters in storage
- Maximize Risk Reduction through Waste Disposition
- Tank Cleaning and Grouting.

Development of Priorities for this Plan

The overarching priorities are expressed through specific goals related to the various parts of the LW system. As documented in Revision 17 of this *Plan*, startup of SWPF by October 2014 was necessary to achieve compliance with all regulatory requirements. The delay of SWPF, however, adversely affects these regulatory commitments:

- Meet tank bulk waste removal efforts regulatory milestones in the currently-approved FFA
- Meet tank removal-from-service regulatory milestones in the currently-approved FFA
- Meet the waste treatment goals identified in the STP

In addition, projected funding for Revision 18 is insufficient to perform all activities needed for optimum performance of the Liquid Waste scope. Given the limited funding and the SWPF delay, prioritization criteria must be applied to guide allocation of the funding to the activities that provide the best value to DOE. For the purposes of this plan, two sets of prioritization criteria were evaluated:

Option A (Closure Acceleration Priority)

- Safe Storage
- Tank Cleaning & Grouting
- Hazard Elimination & Risk Reduction

Option B (Risk Reduction Priority)

- Safe Storage
- Hazard Elimination & Risk Reduction
- Tank Cleaning & Grouting

Option A places a preference on funding final cleaning and grouting of waste tanks to maximize compliance with near term regulatory requirements, while activities that improve waste processing rates (e.g., SCIX) receive limited funds. Option B gives preference to activities that maximize sludge and salt processing while cleaning and grouting activities (e.g., Tank 12 acid cleaning) are only funded if funds remain after salt and sludge acceleration activities are fully funded. In order to select the prioritization criteria to be used for the base case in this plan, modeling results based on the two prioritization techniques were examined and provide a comparison of achieving the FFA Bulk Waste Removal and Tank Closure Commitments. As depicted in Figure 2-1, the Closure Acceleration case provides a marginal improvement in BWR compliance by improving waste removal on tanks containing immobile dry salt at the expense of waste removal on tanks containing sludge that is both more mobile and more hazardous. The benefit of pursuing a closure acceleration path to near term tank closures is demonstrated in Figure 2-2. It is worth noting that focusing on tank closure in the near term ultimately delays closure of the last old-style tank.

The consequence of focusing on near term closures is the significant increase in unstabilized curies remaining in the waste tanks. This undesirable result is clearly demonstrated in Figure 2-3. As a result of this examination, it is clear that the significant real benefit of maximized risk reduction far outweighs the limited perceived benefit of near term closures. In recognition of this determination, Option B (Risk Reduction Priority) has been chosen as the prioritization criteria for this plan.

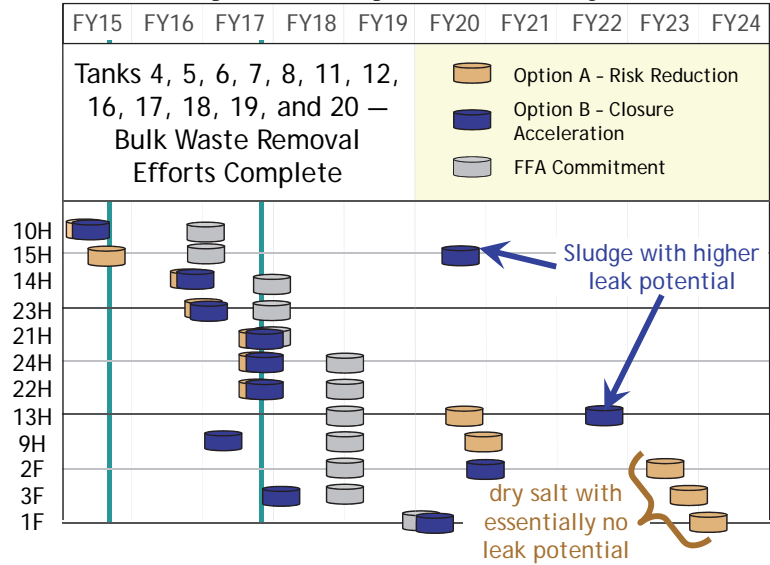


Figure 2-1 — Bulk Waste Removals

The benefit of pursuing a closure acceleration path to near term tank closures is demonstrated in Figure 2-2. It is worth noting that focusing on tank closure in the near term ultimately delays closure of the last old-style tank.

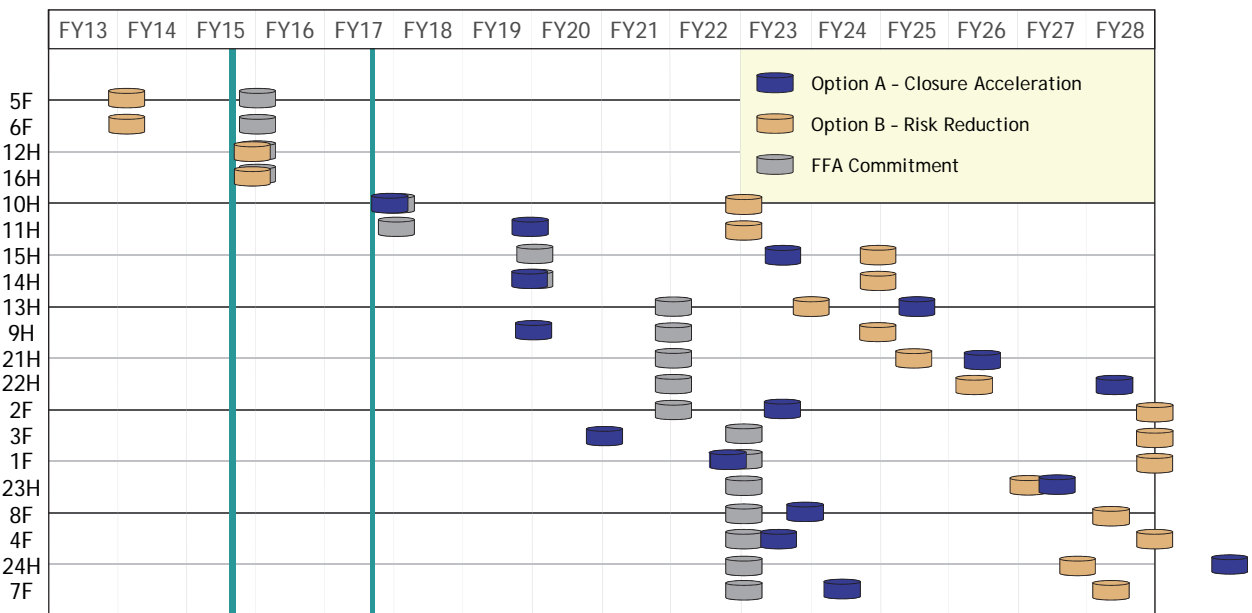


Figure 2-2 — Tank Closures

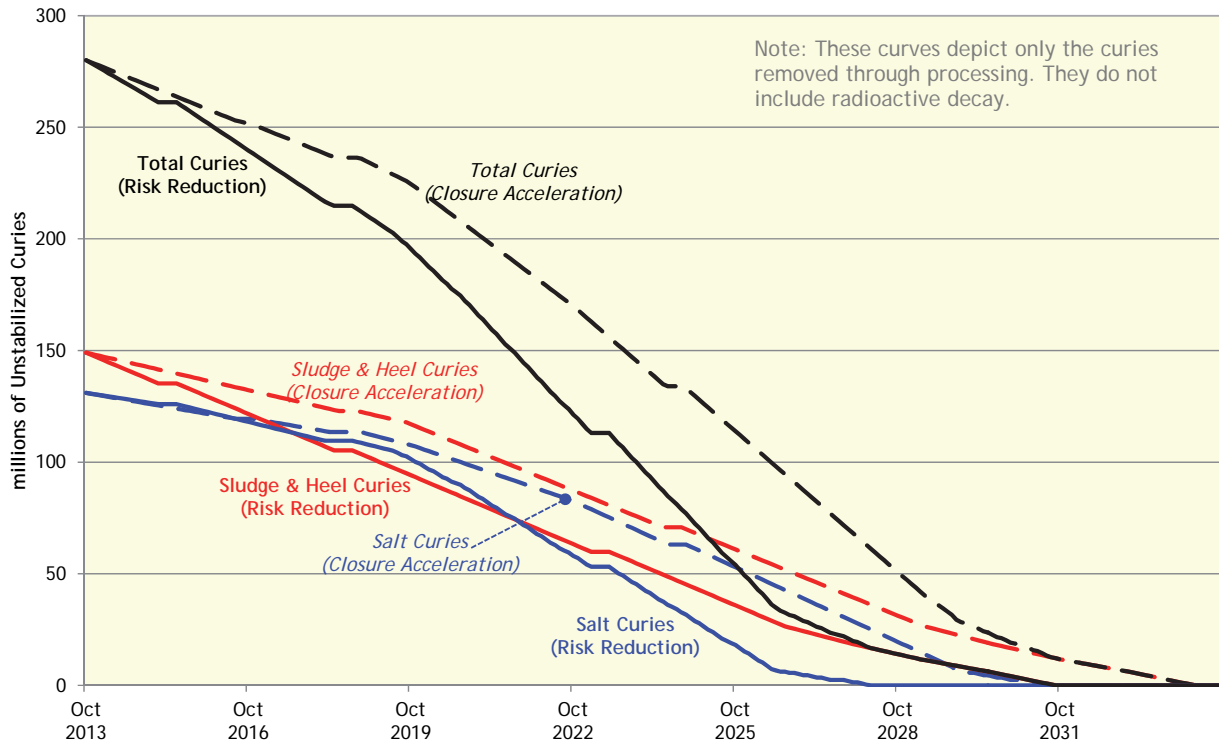


Figure 2-3 — Curies at Risk

Goals for this Plan

Therefore, the goals of this *Plan* are to meet the following programmatic objectives:

- Continue storing liquid radioactive wastes in a safe and environmentally sound manner
- Optimize program life cycle cost and schedule to minimize extension of the remaining time at risk associated with legacy high level waste storage in aging tanks
- Conduct operations consistent with the *Section 3116 Determination for Salt Waste Disposal at the Savannah River Site*⁶, the *Basis for Section 3116 Determination for Salt Waste Disposal at the Savannah River Site*⁷, the *Section 3116 Determination for Closure of F-Tank Farm at the Savannah River Site*⁸, the *Basis for Section 3116 Determination for Closure of F-Tank Farm at the Savannah River Site*⁹, and future WD and Basis documents for H-Tank Farm
- Satisfy applicable permits and consent orders, including the Modified Class 3 Landfill Permit for the SRS Z-Area SDF (permit ID 025500-1603) and State-approved area-specific General Closure Plans
- Provide tank space to support staging of salt solution adequate to feed the SWPF per the inputs and assumptions
- Provide tank space to support staging of salt solution adequate to feed the SCIX per the inputs and assumptions
- Sustain sludge vitrification in the DWPF
- Minimize the quantity of radionuclides (as measured in curies) dispositioned in the SDF, keeping the total curies at or below the amount identified in the *SRS LW Strategy*¹⁰ as amended by letter from the SCDHEC to DOE-SR¹¹ and the *Basis for Section 3116 Determination for Salt Waste Disposal at the Savannah River Site*⁷
- Support continued nuclear material stabilization of legacy materials in H-Canyon.

The following generalized priorities guide the sequencing of waste removal and disposition from the Liquid Radioactive Waste tanks:

1. Remove waste from tanks with a leakage history, while safely managing the total waste inventory
2. Ensure the curies dispositioned to the SDF are at or below the amount identified in the *SRS LW Strategy* as amended by letter from the SCDHEC to DOE-SR and the *Basis for Section 3116 Determination for Salt Waste Disposal at the Savannah River Site*⁷
3. Provide tank space to support staging of salt solution adequate to feed salt solution to ARP/MCU, SWPF and SCIX per the inputs and assumptions
4. Provide tank space to support staging of sludge adequate to feed DWPF
5. Support removal from service of Type I, II, and IV tanks to meet currently approved FFA commitments
6. Support continued nuclear material stabilization in H-Canyon.

There is currently a premium on processing and storage space in the SRS radioactive liquid waste tanks. To enable continuation of risk reduction initiatives encompassed by the goals above, this *Plan* follows a processing strategy providing the tank space required to meet, or minimizing impacts to meeting, programmatic objectives. During the period prior to startup of SWPF in 2018, near-term retrieval, treatment, and disposal of salt waste are required. The ARP/MCU facilities perform this treatment. Operation of these salt treatment processes frees up working space in the 2F, 2H, and 3H Evaporators' concentrate receipt tanks (Tanks 25, 38, and 30 and 37, respectively). This provides support for near-term handling of waste streams generated from early-year tank removals from service, DWPF sludge batch preparation, DWPF recycle handling, and H-Canyon processing.

These initiatives and the assumed SWPF startup in 2018 provide tank space to minimize impacts to the programmatic objectives. Currently, there are approximately 37 million gallons of liquid waste stored on an interim basis in 44 underground waste storage tanks. Since FY96, the Liquid Waste Program at SRS has been removing waste from tanks, pre-treating it, vitrifying it, and pouring the vitrified waste into canisters for long-term storage and disposal. Through December 2012, 3,560 canisters of waste (containing ~49 million curies) have been vitrified. Canister waste loading has been raised from the originally planned ~28% to the current waste loading of ~36% and is planned to be maximized further to ~40%. The canisters vitrified to date have contained sludge waste and, since April 2008 they have also contained processed salt waste. These canisters represent ~47% of sludge waste immobilization lifecycle and ~6% of salt waste disposition lifecycle.

Approximately 65% of the old-style tank nominal space is currently empty or grouted; and approximately 19% of the new-style tank nominal space is empty. Of the 24 old-style tanks in the SRS Liquid Waste System, four are grouted and operationally closed, two more are empty and cleaned, one is empty with final cleaning status being evaluated, and five more have had bulk waste removed. Based on operational experience, over 95% of the radioactive inventory in a tank has been removed after bulk waste removal and heel dilution; over 99% of the radioactive inventory has been removed after cleaning.

Space in new-style tanks is used for various operations for waste processing and disposal. Tank space is recovered through evaporator operations; DWPF vitrification; ARP/MCU Treatment; and saltstone disposal. This valuable space has been used to: (1) retrieve waste from and clean old-style tanks; (2) prepare, qualify, and treat sludge waste for disposal; (3) prepare, qualify, treat, and dispose salt waste; and (4) support nuclear materials stabilization and disposal through H-Canyon. The Tank Farm space management strategy is based on a set of key assumptions involving projections of DWPF canister production rates, influent stream volumes, Tank Farm evaporator performance, and space gain initiative implementation. The processing of salt and sludge utilizes new-style tank space to retrieve and prepare waste from old-style tanks, and therefore nominal empty space in new-style tanks will increase only after all waste in old-style tanks is processed. Sludge processing through the DWPF removes the highest risk material from the old-style tanks. However, for every 1.0 gallon of sludge processed, 1.3 gallons of salt waste is formed due to sludge washing and DWPF processing operations to return the resulting low hazard salt waste to the tank farm. Similarly, salt waste retrieval, preparation, and batching typically require the use of 4 gallons of tank space per gallon of salt waste treated. Given these parameters, the "key to reducing the overall risk is processing high-level waste as expeditiously as possible and managing the total tank space efficiently", as recognized by the DNFSB letter dated January 7, 2010.

New-style tank space is a currency used to prepare for permanent immobilization and disposition of high level waste in a vitrified waste form and low-level waste in a grouted waste form. The tank space management program maintains sufficient space in the new-style tanks to allow continued DWPF operations. The tank space management program also provides the necessary tank space to support staging of salt solutions to sustain salt waste disposition

currently through ARP/MCU and subsequently through SWPF and SCIX. Of the 27 new-style tanks (with a total nominal volume of 35.1 million gallons) in the SRS Liquid Waste System:

- 5 are dedicated to salt batching, qualification, and disposition (including DWPF recycle beneficial reuse and the 2H Evaporator)
- 6 are dedicated to sludge batching, qualification, and disposition (including the 3H Evaporator)
- 3 are dedicated to waste retrieval from and residual cleaning of old-style tanks in preparation for operational closure
- 1 is dedicated to uninterrupted H-Canyon waste receipts
- 12 are dedicated to safe storage of legacy liquid waste pending retrieval and disposition.

There are currently ~6.8 Mgals of empty space (~19%) in these new-style tanks:

- 3.0 Mgals is margin as defense-in-depth operational control coupled with Safety Class or Safety Significant (SC/SS) systems, structures and components (SSC) to facilitate reasonably conservative assurance of more than adequate dilution and ventilation of potentially flammable vapors
- 1.3 Mgals is procedurally-required minimum contingency space for recovery from the unlikely event of a bulk waste leak elsewhere in the system
- 2.5 Mgals is operational “working” space variously used to provide:
 - Additional contingency transfer space as operational excess margin above the procedurally-required minimum
 - Excess margin to preserve salt batch quality and maintain uninterrupted treatment and disposition through ARP/MCU and Saltstone
 - Excess margin to preserve sludge batch quality and maintain uninterrupted immobilization through DWPF
- Excess margin to preserve uninterrupted support for H-Canyon.

2.3 Alternative Analyses

This *Plan* provides a modeled analysis to describe the potential impacts of further delaying initiation of SWPF operations to September 30, 2023 from October 2018.

2.4 Risk Assessment

The *PBS-SR-0014, Radioactive Liquid Tank Waste Stabilization and Disposition, Risk and Opportunity Management Plan*¹² (ROMP) documents the comprehensive identification and analysis of technical risks and opportunities associated with the LW program. It identifies individual technical and programmatic risks and presents the strategies for handling risks and opportunities in the near-term and outyears.

3. Planning Bases

This *Plan* is based on inputs and assumptions provided by DOE. Dates, volumes, and chemical or radiological composition information contained in this *Plan* are planning approximations only. Specific flowsheets guide actual execution of individual processing steps. The activities described are summary-level activities, some of which have yet to be fully defined. The sequence of activities reflects the best judgment of the planners. The individual activity execution strategies contain full scope, schedule, and funding development. Upon approval of scope, cost, and schedule baselines modifications of this *Plan* may be required.

3.1 Funding

Progress toward the ultimate goal of immobilizing all the LW at SRS is highly dependent on available funding. This *Plan* was developed assuming the availability of the funding required as specified in *DE-AC09-09SR22505: Revision 3- Savannah River Remediation. (SRR) Office of Environmental Management (EM) Preliminary) FY 2013 Expected Funds*¹³. It supports justification for requesting necessary funding profiles. With any reduction from full funding, activities that ensure safe storage of waste claim first priority. Funding above that required for safe storage enables risk reduction activities, i.e., waste removal, treatment — including immobilization — and removal from service, as described in this *Plan*.

3.2 Regulatory Drivers

Numerous laws, constraints, and commitments influence LW System planning. Described below are requirements most directly affecting LW system planning. This *Plan* assumes the timely acquisition of regulatory approvals.

South Carolina Environmental Laws

Under the South Carolina Pollution Control Act, S.C. Code Ann. §§ 48-1-10 *et seq.*, SCDHEC is the delegated authority for air pollution control and water pollution control. The State has empowered SCDHEC to adopt standards for protection of water and air quality, and to issue permits for pollutant discharges. Further, SCDHEC is authorized to administer both the federal Clean Water Act and the Clean Air Act. Under South Carolina's Hazardous Waste Management Act, S.C. Code Ann. §§ 44-56-10 *et seq.*, SCDHEC is granted the authority to manage hazardous wastes. With minor modifications, SCDHEC has promulgated the federal Resource Conservation and Recovery Act (RCRA) requirements, including essentially the same numbering system. The South Carolina Solid Waste Policy and Management Act, S.C. Code Ann. §§ 44-96-10 *et seq.*, provides standards for the management of most solid wastes in the state. For example, SCDHEC issued to DOE-SR permits such as the Class 3 Landfill Permit for SDF. This landfill permit contains conditions for the acceptable disposal of non-hazardous waste in the SDF. This permit also contains provisions for fines and penalties. Other principal permits required to operate LW facilities pursuant to the state's environmental laws include:

- SCDHEC Bureau of Water:
 - Industrial wastewater treatment facility permits (e.g., Tank Farms, DWPF, ARP/MCU, Effluent Treatment Facility [ETF], and the SPF)
 - National Pollutant Discharge Elimination System (NPDES) permit (H-16 Outfall discharges from ETF)
- SCDHEC Bureau of Air Quality:
 - Part 70 Air Quality Permit (one Site-wide Air Permit including the LW facilities).

Site Treatment Plan (STP)

The STP⁵ for SRS describes the development of treatment capacities and technologies for mixed wastes, and provides guidance on establishing treatment technologies for newly identified mixed wastes. The STP allows DOE, regulatory agencies, the States, and other stakeholders to efficiently plan mixed waste treatment and disposal by considering waste volumes and treatment capacities on a national scale. The STP identifies vitrification in DWPF as the preferred treatment option for appropriate SRS liquid high-level radioactive waste streams. SRS has committed that:

“Upon the beginning of full operations, DWPF will maintain canister production sufficient to meet the commitment for the removal of the backlogged and currently generated waste inventory by 2028.”

The commitment for the removal of the waste by 2028 encompasses the BWRE and heel removal scope of this *Plan*. Final cleaning, deactivation, and removal from service of storage and processing facilities are subsequent to the satisfaction of this commitment.

Federal Facility Agreement (FFA)

The EPA, DOE, and SCDHEC executed the SRS FFA⁴ on January 15, 1993, which became effective August 16, 1993. It provides standards for secondary containment, requirements for responding to leaks, and provisions for the removal from service of leaking or unsuitable LW storage tanks. Tanks scheduled to be removed from service may continue to be used, but must adhere to the FFA schedule for removal from service and the applicable requirements contained in the Tank Farms' industrial wastewater treatment facility permit. An agreement between DOE, SCDHEC, and EPA (*Statement of Resolution of Dispute Concerning Extension of Closure Dates for Savannah River Site High-Level Radioactive Waste Tanks 19 and 18*¹⁴ effective in November 2007) modified the FFA by providing for the submission of Waste Determination documentation for F- and H-Tank Farms and including end dates for BWRE and the operational closure of each old style tank. The FFA requires SRS to operationally close the last Type I, II, and IV tank no later than 2022.

National Environmental Policy Act

The National Environmental Policy Act (NEPA) requires federal agencies to assess the potential environmental impacts of proposed actions. Seven existing NEPA documents and their associated records of decision directly affect the LW System and support the operating scenario described in this *Plan*:

- DWPF Supplemental Environmental Impact Statement (SEIS) (DOE/EIS-0082-S)
- Final Waste Management Programmatic Environmental Impact Statement (PEIS) (DOE/EIS-0200-F)
- SRS Waste Management Final Environmental Impact Statement (EIS) (DOE/EIS-0217)
- Interim Management of Nuclear Materials EIS (DOE/EIS-0220)
- SRS High-Level Waste Tank Closure Final EIS (DOE/EIS-0303)
- Environmental Assessment (EA) for the Closure of the High Level Waste Tanks in F- and H Areas at SRS (DOE/EA-1164)
- SRS Salt Processing Alternatives Final SEIS (DOE/EIS-0082-S2).

Ronald W. Reagan National Defense Authorization Act for Fiscal Year 2005

The *Ronald W. Reagan National Defense Authorization Act for Fiscal Year 2005* (NDAA) Section 3116 (NDAA §3116) allows determinations by the Secretary of Energy, in consultation with the NRC, that certain radioactive waste from reprocessing is not high-level waste and may be disposed of in South Carolina pursuant to a State-approved closure plan or State-issued permit. For salt waste, DOE contemplates removing targeted fission products and actinides using a variety of technologies and combining the removed fission products and actinides with the metals being vitrified in DWPF. NDAA §3116 governs solidifying the remaining low-activity salt stream into saltstone for the purpose of disposal in the SDF. For Type I, II, and IV tank removal from service activities, NDAA §3116 governs the Waste Determinations for the Tank Farms that demonstrate that the tanks and ancillary equipment (evaporators, diversion boxes, etc.) at the time of removal from service and stabilization can be managed as non-high level waste.

3.3 Revisions

The significant updates from the previous version of this *Plan*, the *Liquid Waste System Plan, Revision 17*², include:

- **Salt Processing:**
 - **SWPF Processing:** SWPF operations initiation delayed to October 2018 from October 2014
 - **SWPF Processing:** SWPF maximum processing rate increased to 9 Mgal/yr from 8 Mgal/yr
 - **SCIX Processing:** reschedule of SRR's proposal of a supplemental salt treatment process to April 2019 from October 2018 due to funding limitations
 - **SCIX Processing:** SCIX maximum processing rate increased to 3 Mgal/yr from 2.5 Mgal/yr
 - **Next Generation Extractant:** Next generation extractant is deployed at MCU
- **Sludge Processing**
 - Reduced the maximum canister throughput to 275 canisters per year from 315 canister per year
- **Tank Closure**
 - Increased durations for near-term regulatory approvals

- Eliminate implementation of ECC due to funding
- Delays in tank removal from service that are beyond FFA commitments for BWRE and operational closure commitments

3.4 Key Milestones

Key Milestones are those major dates deemed necessary under this *Plan* to remove waste from storage, process it into glass or saltstone, and close the LW facilities. The *LW System Plan, Revision 17* milestones are provided for comparison.

Table 3-1 — Key Milestones

Key Milestone	Revision 17	this Plan
Last LW facility closed	2028	2034
BWRE complete for Type I, II, and IV tanks	Jul 2019	Oct 2023
All Type I, II, and IV tanks are removed from service	Oct 2022	Sep 2028
Complete bulk salt treatment	2026	2028
Complete bulk sludge treatment	2026	2026
Complete heel treatment	2028	2032
Total number of canisters produced	7,580	7,824
Supplemental canister storage required	Dec 2016	Dec 2016
Initiate ARP/MCU Processing	Apr 2008 (actual)	Apr 2008 (actual)
– <i>Deploy next generation extractant at MCU</i>	<i>n/a</i>	Oct 2013
Initiate SCIX Processing	Oct 2018	April 2019
Initiate SWPF Processing	Oct 2014	Oct 2018
– <i>Salt Solution Processed via DDA-solely</i>	<i>2.8 Mgal (Actual)</i>	<i>2.8 Mgal (Actual)</i>
– <i>Salt Solution Processed via ARP/MCU</i>	<i>5.2 Mgal</i>	<i>21 Mgal</i>
– <i>Salt Solution Processed via SCIX</i>	<i>16 Mgal</i>	<i>24 Mgal</i>
– <i>Salt Solution Processed via SWPF</i>	<i>78 Mgal</i>	<i>61 Mgal</i>
Number of SDU (<i>note SDU-6–SDU-12 are high capacity SDUs</i>)	12	12
– <i>SDU-6 need date</i>	<i>July 2015</i>	<i>July 2015</i>
Salt Processing Complete	2026	2028

4. Planning Summary and Results

This section summarizes the key attributes of this *Plan*. Detailed discussion on risks and associated mitigation strategies are included in other documents such as the ROMP and individual implementation activity risk assessments.

In addition, this *Plan* assumes receiving adequate funding to achieve the required project and operations activities. Failure to obtain adequate funding will have a commensurate impact on the programmatic objectives.

This section summarizes the *Plan*, based on the key assumptions and bases. Tabular results of the lifecycle, on a year-by-year basis, or graphical results of the lifecycle are included in:

- Appendix A — *Salt Solution Processing*
- Appendix B — *Sludge Processing*
- Appendix C — *Canister Storage*
- Appendix D — *BWRE & Removal from Service*
- Appendix E — *Tank Farm Influent and Effluent*
- Appendix F — *Remaining Tank Inventory*
- Appendix G — *LW System Plan — Rev 18 Summary*

4.1 Disposition of Sludge Waste

The basic steps for sludge processing (Figure 4-1) are:

1. Sludge removal from tanks
2. Blending and washing of sludge (in Tank 51)
3. Sludge feeding to the DWPF (from Tank 40)
4. Vitrification in DWPF.

Sludge processing

Sludge processing is paced by the capabilities of the sludge washing and the DWPF processing facilities and by tank storage space to prepare sludge batches. Sludge batch planning uses the estimated mass and composition of sludge and known processing capabilities to optimize processing sequences. Sub-tier plans document the modeling, guide the sequence of waste removal, and support a more detailed level of planning. These sub-tier plans are revised as new information becomes available or when significant updates in the overall waste removal strategy are made. The specific input to this *Plan* from sludge batch planning is summarized in *Sludge Batch Plan in Support of System Plan Rev. 18*¹⁵.

Differences in sludge batch sequencing, total number canisters produced, and batch end dates between *Sludge Batch Plan in Support of System Plan Rev. 18* and *Sludge Batch Plan in Support of System Plan Rev. 17*¹⁶ are mainly driven by the following:

- This *Plan* assumes the use of LTAD for Sludge Batch (SB) 12 through 16.
 - Most of Tank 13 is no longer targeted for LTAD
 - The majority of Tank 15 sludge is no longer targeted for LTAD because there is no viable disposition option for the aluminum rich supernate
- This *Plan* assumes 21 total sludge batches
 - Batches 18–21 are primarily sludge heels, insoluble salt, and oxalates
- The projected canister pour rate and waste loadings remain at 275 canisters/yr; no second sludge preparation tank is anticipated
- In addition to SB7, three other sludge batches are modeled to include enough washing to remove sodium oxalate solids that originate from bulk Oxalic Acid (OA) chemical cleaning operations

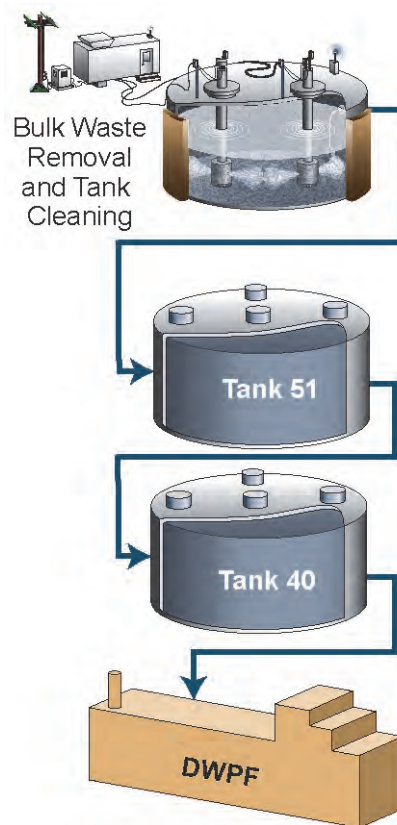


Figure 4-1 — *Sludge Feed Preparation*

Sludge Feed Preparation

This *Plan* uses a single sludge tank (Tank 51) as the sole DWPF feed preparation tank (see Figure 4-1).

Sludge Washing

Sodium and other soluble salts in DWPF feed are reduced through sludge washing. Sludge washing is performed by adding water to the sludge batch, mixing with slurry pumps, securing the pumps to allow gravity settling of washed solids, and decanting the sodium-rich supernate to an evaporator system for concentration. This cycle is repeated until the desired sodium molarity, typically 1.5 M Na, is reached. Some types of sludge settle slowly, extending wash cycles. Sludge settling and washing typically constitutes ~75% of batch preparation time. The total number of washes performed and volume of wash water used are minimized to conserve waste tank space. Sludge batch size and wash volumes are also limited by the hydrogen generation rate associated with radiolysis of water. Tank contents are mixed on a periodic frequency to release hydrogen retained within the sludge layer, resulting in a limited window within operating constraints for gravity settling.

4.2 DWPF Operations

Washed sludge is transferred to the DWPF facility where it is combined with the high-level waste streams from salt processing (discussed below) for vitrification into glass canisters and stored on-site pending disposition.

Historically, melter performance has been the limiting factor for DWPF throughput. The DWPF melter (without bubblers) had produced an average of 215 canisters/yr before melter bubblers were installed. Bubblers installed in September 2010, however, improved the demonstrated melter capacity to a rate of 37 canisters/month (444 canisters/year), resulting in a record 264 canisters poured in FY11 and 277 in FY12. Tank Farm sludge waste feed preparation has been analyzed to be capable of supporting a canister production capability of 275 canisters/year while DWPF feed preparation systems have demonstrated a capacity of greater than 325 canisters/year, e.g., the 337 canisters poured from July 2011 thru June 2012.

Sludge Batch 7B processing challenges were encountered towards the end of FY12 and continued to be experienced during the first part of FY13. The primary challenge was associated with sludge carryover into the vessel vent and recycle collection systems. Mitigation efforts were focused in the following areas:

- **Compliance with Technical Safety Requirement (TSR) Specific Administrative Controls (SAC)**
 - The time consuming laboratory analytical method to determine solids content of recycle material was replaced by implementing a turbidity instrument for solids carryover detection. This effort reduced cycle time by 20 hours per batch
 - A Documented Safety Analysis (DSA) change package was developed that maintains the recycle system under caustic and nitrite inhibited conditions, which will provide additional operational flexibility and improve cycle times
 - Digital Control System (DCS) Software was developed and loaded to increase the ability to detect sludge carryover events. Work continues on development of automated DCS software to both detect the onset and provide control action to prevent sludge carryover events
 - Process vessel air purge system modifications are scheduled for later this year.
- **Chemical Process Cell Processing with Certainty**
 - An independent team of local (i.e. Savannah River National Laboratory (SRNL) & SRR) experts was assembled to review past processing data. The team of experts provided recommendations for both batch processing and carryover prevention
 - DWPF completed a 14 day outage to flush and clean the Process Vessel Vent system in order to restore proper flows to this system following system degradation caused by sludge carryover.

Near-term improvements are complete and historical canister production rates have once again been demonstrated. As part of the longer-term comprehensive effort, an Independent Peer Review of recent DWPF operating performance was conducted, including feed preparation and controls, feed chemistry, melter performance, support system performance and reliability, and melter flammability controls. The overall objective is to assure we have fully identified, evaluated, and developed actions to fully address the core issues that could prevent DWPF from meeting its aggressive production commitments. A DWPF reliability improvement and maintenance plan was developed incorporating the team's input.

Two-step Production Improvement Approach

To support higher glass throughput, the DWPF melter was retrofitted with four bubbler systems and the melter off-gas system was optimized in September 2010. The second step of DWPF production capacity improvement program addresses streamlining the DWPF feed preparation system. Several process improvements are planned to streamline the DWPF feed preparation system:

- Implementation of an alternate reductant
- Processing of cesium strip effluent in the slurry mix evaporator (SME)
- Addition of dry process frit to the SME

The feed preparation modifications reduce recycle water generation by 660 kgal/yr:

- 250 kgal/yr by using dry process frit
- 1.5 kgal/canister × 275 canisters/yr = 410 kgal/yr by routing decon frit water to ETF.

Reduction of liquid addition in DWPF supports receipt of Strip Effluent (SE) from SWPF. Beneficial reuse of DWPF recycle for waste removal and tank cleaning, in lieu of water additions, supplements recycle reduction and supports maintenance of tank farm capacity (see §4.6 below).

The DWPF production rate (prior to the bubbler installation) averaged 215 canisters per year with ~4,000 pounds of glass per canister. The production rate improvement initiatives enable a higher nominal DWPF canister production capability of 275 canisters/year. Future estimated canister production, by year is shown in Table 4-1 — *Planned DWPF Production Rates*. The canister rates assume two one-week outages every year to allow for routine planned maintenance and another two week site-wide steam outage each year.

Table 4-1 — Planned DWPF Production Rates

FY	Nominal Rate (Canisters/yr)	Outage (Months)	Total DWPF Canisters poured (Canisters)
FY13	275		275
FY14	275		276
FY15	275	4	184
FY16	275		276
FY17	275		276
FY18	275	4	184
FY19	275		276
FY20	275		276
FY21	275		276
FY22	275		276
FY23	275	4	184
FY24	275		276
FY25	275		276
FY26	275		276
FY27	275		169
FY28	(sludge heels)		153
FY29	(sludge heels)		132
FY30	(sludge heels)		122
FY31	(sludge heels)		133

^a Four-month melter outage is assumed every eight years during sludge processing. Actual melter change-out is determined by melter performance

^b Four-Month outage in 2018 to accommodate transition to SWPF-DWPF coupled operations — assumes no canister production rate impact from coupled SWPF-DWPF operations

^c Lower production rate assumed for dilute heel processing beginning in 2028.

Failed Equipment Storage Vaults and Melter Storage Boxes

Failed equipment storage vaults (FESVs) and Melter Storage Boxes (MSBs) are repetitive activities required to sustain ongoing DWPF operation by providing interim storage of failed DWPF melters. The original DWPF design

has two vaults contained within one construction unit. Each FESV is designed to store one failed melter inside an MSB.

Melter 1 was placed in FESV #2 in December 2002. Melter 1 (inside MSB #1) had a relatively low radiation field. It was placed in the northernmost vault since the next vault pair to be constructed would be adjacent to FESV #2.

FESV #1 remains available for use with Melter 2. Construction of MSB #2 was completed in October 2008. MSB #2 is currently stored in FESV #1 awaiting use during the Melter 2 replacement outage currently forecast in this *Plan* to occur in 2015. Space has been reserved for construction of up to ten FESVs, if needed.

Under the current planning basis, the need date for FESV #3 and #4 will be triggered by the failure of Melter 3. Melter 3 is currently scheduled to be placed into service in July 2015. Based upon this strategy, FESVs #3 and #4 construction should be completed and available for service by January 2015 (approximately six months prior to the planned installation of Melter 3). Likewise, MSB #3 should be constructed and available to receive Melter 3 by January 2015. The need dates for FESV #3 and #4 and successive pairs of vaults will be evaluated on an ongoing basis.

Currently, the FESV 200-ton gantry crane is designed to interface only with an MSB designed primarily to contain failed melters. The placement of other large failed DWPF equipment (which do not have disposal paths) in FESVs has been considered but the complete engineered system to move large contaminated equipment from the 221-S canyon to the FESV has not been designed or constructed. Alternative methods for disposal of large contaminated equipment from DWPF (not including melters) are being evaluated.

Glass Waste Canister Storage

The canisters of vitrified HLW glass produced by DWPF are currently stored on-site in dedicated interim storage buildings, Glass Waste Storage Buildings (GWSB). A Shielded Canister Transporter moves one canister at a time from the Vitrification Building to a GWSB. The schedule for filling the GWSBs is found in *Appendix C — Canister Storage*.

GWSB #1 consists of a below-grade seismically qualified concrete vault containing support frames for vertical storage of 2,262 standard canisters. Eight of these positions have been abandoned due to construction defects and three contain archived non-radioactive glass filled canisters. As of December 31, 2012, 2,244 standard positions are in use storing radioactive canisters, the remaining 7 being contingency positions for placement of canisters if GWSB #2 is temporarily unavailable.

GWSB #2, with a similar design to GWSB #1, has 2,340 standard storage locations. The first radioactive canister was placed in GWSB #2 on July 10, 2006. One archived non-radioactive canister has been placed in GWSB #2. As of December 31, 2012, GWSB #2 stored 1,302 canisters. The total storage capacity of GWSB #1 and #2 for standard radioactive storage is 4,590.

The current GWSBs are forecast to be full by the end of 2016. Supplemental glass waste storage must be ready to store canisters in FY17 in order to maintain production of DWPF canisters. Scoping studies are being conducted to determine the configuration of the supplemental storage. Funding limitations have delayed the start of design and construction of this needed supplemental glass waste storage such that, at present, it is unlikely that supplemental storage will be available by the FY17 need date.

The schedule for shipment of the canisters from SRS is not included in this *Plan* and is unknown at this time.

4.3 Disposition of Salt Wastes

As highlighted in the Introduction, this *Plan* includes the use of a series of salt treatment processes over the life of the program, including ARP/MCU, SCIX, and SWPF. *Appendix A — Salt Solution Processing* reflects the breakdown of the volumes treated from each of the processes by year. Using the input assumptions for this *Plan*, over 100 Mgal of salt solution from the Tank Farms are planned for processing over the life of the program; 5.6 Mgal was processed by the end of FY12. If SWPF starts up in October 2018 as assumed, it would process the majority of this salt solution waste. The nominal capacity of SWPF, after an initial 36-month start-up period is assumed to be approximately 9 Mgal/yr. Coupled with the SCIX throughput of ~3 Mgal/yr, 12 Mgal/yr is the total planned nominal salt processing capacity. It must be noted that salt processing may be limited by SE processing in DWPF at the planned rates. At a DWPF production rate of 275 canisters/year, achieving greater than 7 Mgal/yr of SWPF processing will require reducing the strip effluent volume. The specific input to this *Plan* from salt batch planning is summarized in *Salt Batch Plan in Support of System Plan R 18*¹⁷.

4.3.1 Actinide Removal Process / Modular CSSX Unit (APR/MCU)

Salt waste is currently processed through ARP/MCU. A summary of the process is shown in Figure 4-2 — *Schematic of the ARP/MCU Process*. Table 4-2 — *ARP/MCU Salt Batch Composition* gives the composition of the salt batches for ARP/MCU.

The ARP decontaminates salt solution via adsorption of strontium-90 (Sr-90), actinide radionuclides, and entrained sludge solids in the salt solution onto mono-sodium titanate (MST) followed by filtration. The actinide, Sr-90, and MST laden sludge waste stream are transferred to DWPF for vitrification and the remaining clarified salt solution is transferred to the MCU process. The MCU process extracts Cs from the clarified salt solution using CSSX chemistry. The low Cs-137/low actinide decontaminated salt solution (DSS) is subsequently transferred to Tank 50 for feed to the SPF, and the SE solution of cesium nitrate from the CSSX process is transferred to the DWPF for vitrification.

The ARP/MCU process was constructed and permitted initially for a three-year service period, bridging the crucial period before the startup of the SWPF. With the delay of SWPF, however, ARP/MCU has been enhanced and improved to provide a longer term option for salt disposition (see *Life-Extension* discussion below). The original goals of the ARP/MCU process were to (1) treat salt solution prior to the start of SWPF; and importantly (2) provide operational experience and lessons learned for the SWPF project.

Actions taken since startup of ARP/MCU have demonstrated an increased processing rate from the original design of 1 million gallons per year to approximately 1.4 million gallons per year. Enhancements and improvements include chemistry adjustments at Tank 49, modified MST, reduced cycle-times, redesign and replacement of the secondary filter at 512-S. A twelve-hour strike time was implemented at ARP, along with a 6-gpm processing rate increase at MCU which reduced the overall processing cycle-time.

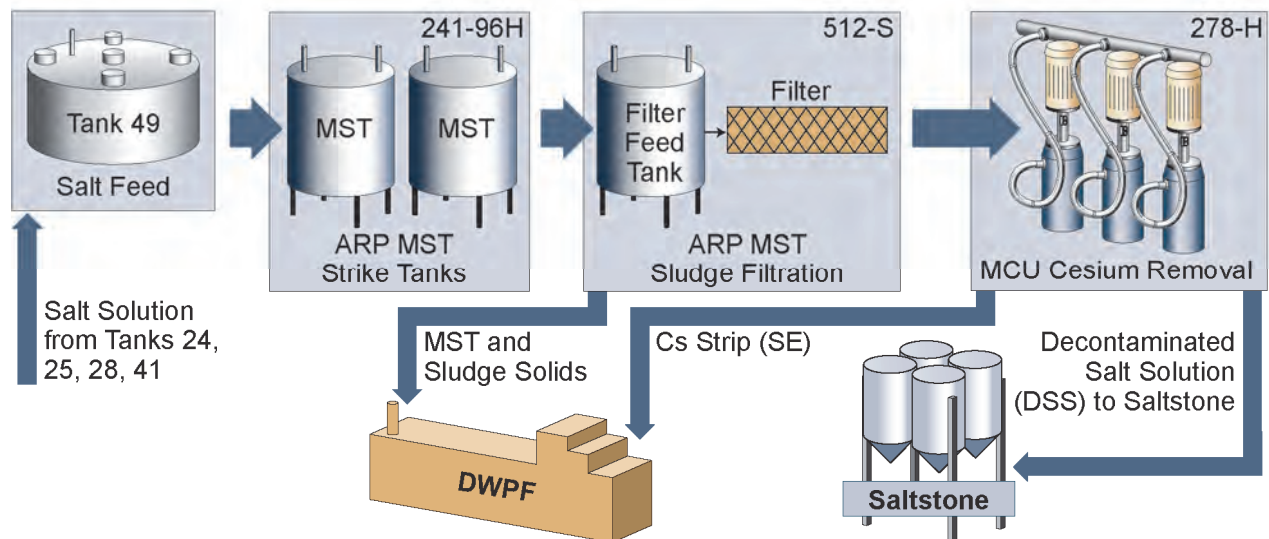


Figure 4-2 — *Schematic of the ARP/MCU Process*

Although the overall attainment has significantly improved through operations, equipment downtime has limited the overall attainment hence overall throughput. The majority of the affected equipment has been repaired, replaced, or redesigned commensurate with the failure causes identified. Efforts continue to improve equipment reliability, reducing unexpected downtime to improve overall attainment. In addition to equipment and processing upgrades, alternative system planning is being done to more efficiently qualify subsequent salt batches to reduce downtime between batches.

Life-Extension

The originally planned three-year service life of ARP/MCU was reached in 2012. A detailed engineering analysis (*ARP/MCU Life Extension Evaluation*¹⁸) identified the key parameters necessary for life extension. Most of the individual components were determined to be capable of a longer operating life than three years. An evaluation

concluded that ARP/MCU can operate until 2015 before major equipment failure is expected. The passive process components, such as piping and structures, were determined to have service life beyond 2025.

The life of ARP/MCU has been extended through:

- Process and equipment upgrades and improvements
- Evaluation and procurement of spare parts
- Adjustment to preventive maintenance
- Increased equipment performance monitoring
- Appropriate regulatory approvals

Active components by their nature are consumable and degrade in performance over time. Active components would include, for example, motors, pump rotating assemblies and seals, actuators, operators, hand switches, instruments, indicators, and gauges. Passive components are not considered consumable, however over time they will degrade. Passive components include, for example, cell coatings, building structures, tanks and vessels, piping, pump casings, and valve bodies. While the original service life basis for ARP/MCU has been validated, extending the life of ARP/MCU required that some process equipment be replaced due to radiological or chemical failure. To successfully operate ARP/MCU for longer than the original service life of three years (2012), equipment at high risk of failure will be monitored to give early warning of impending failure, i.e. motors and equipment in high radiation areas.

Enhanced Throughput

The detailed engineering analysis of the ARP/MCU flowsheet identified the key rate-limiting steps in the ARP/MCU process, and opportunities to maximize rates of processing through these steps. The ARP/MCU process essentially consists of salt feed for adsorption of actinides, followed by filtration of solids, and solvent exchange to capture cesium. The adsorption is accomplished via addition of MST ion exchange resin to a strike tank along with salt waste. Following the ion exchange process, the salt solution is transferred to a cross-flow filtration facility, where salt solution is passed through a 0.1 micron sintered metal cross-flow filter. The MST solids are gradually concentrated over the course of multiple microbatches and transferred to DWPF after washing to remove excess sodium. The filtrate stream is sent to MCU for removal of soluble Cs-137. Following a cross-flow filter chemical cleaning effort, the heels of the filter tanks are chemically adjusted and the next cycle of waste receipt and filtration resumes. The filtrate stream is sent to MCU for removal of soluble Cs-137.

The facilities which comprise the ARP were able to provide consistent feed to the MCU throughout the first three Salt Batches. During this time, MCU was capable of operating at a feed rate of 4–6 gpm. Following the transition to Salt Batch 4, MCU Operations successfully demonstrated the ability to process at a sustained rate of 8.5 gpm. As such, it was concluded that throughput is limited by the cross-flow filtration processing rate. A System Engineering Evaluation on the ARP filtration system, as well as an Integrated Salt Processing flow sheet evaluation will be performed. An enhanced throughput strategy will be developed to eliminate discrepancies and provide the basis to maintain a 3 Mgal/year processing rate. Additionally in parallel, the following near-term enhancements are planned:

- Perform an Integrated salt processing flow sheet evaluation
- Change the cross-flow filter operation from batch-operation to continuous operation
- Reduce the amount of MST added at the ARP facility and evaluate reduced strike time
- Increase the temperature limit specified to allow for enhanced filtration
- Adjust the secondary filter cleaning strategy
- Adjust the current back-pulse and cross-flow filter loading strategies.
- Increase the Trans-membrane pressure
- Optimize the operating strategy and time to end of cycle
- Optimize filtration scouring strategies to maximize filtrate flow rate.

A plan to demonstrate the increased throughput including a phased approach to implementation, monitoring parameters, and criteria for measurement and achievement is being developed.

Improved Decontamination

In the fourth quarter of FY2013, the original solvent formula will be replaced with a next generation solvent (NGS). Operation of ARP/MCU with NGS will result in two benefits. *First*, this solvent is more efficient at removing cesium from the treated salt solution than the original solvent formula. This increased cesium removal efficiency (decontamination factor or DF) is expected to enable ARP/MCU to produce a DSS stream with a residual cesium concentration orders of magnitude less than achieved currently. The improved DF will enable continued operation of ARP/MCU while minimizing the curies disposed in the SDF. *Second*, NGS will enable a future increase of MCU

throughput to 12 gpm. Following the initial deployment of NGS in 2013, ARP/MCU will continue to be operated at 8.5 gpm until mid-2015. During this period, operational data will be obtained that will support adjustments within MCU that may be needed to sustain 12 gpm production at MCU.

Enhanced Throughput (phase II)

After sufficient operational data is obtained and in conjunction with the planned outage for contactor bearing replacements in 2015, the throughput of ARP/MCU will be increased to approximately 12 gpm enabling a nominal ARP/MCU production of 4.7 Mgal/yr. While the deployment of NGS will enable the increase in MCU throughput, a revised filtration strategy will be employed to accelerate ARP. To support an increased rate of actinide removal, addition of MST will occur in a waste tank prior to transfer of the salt solution Tank 49. This process is known as “large-tank strike” and is essentially moving ARP upstream of Tank 49. The large-tank strike, settle/decant then filter will remove the ARP process as a throughput constraint. Whereas the current process (Tank 49 → ARP 96H → ARP 512-S→MCU) has close coupled operation of ARP and MCU, the new configuration (ARP → Tank 49/filtration → MCU) places a large supply of Clarified Salt Solution feed directly in front of MCU improving overall system attainment.

Table 4-2 — ARP/MCU Salt Batch Composition

Batch	Source Tanks	Nominal Volume (kgal)
ARP/MCU B7	Tank 23 liquid (Tank 41 salt dissolution (SD)); Tank 11 liquid (Tank 10 SD); Tank 38 liquid (2H liquor).	1,000
ARP/MCU B8	Tank 23 liquid (Tank 41 SD and Tank 35 supernate); Tank 35 supernate; Tank 8 liquid (SB 5 & 6 LTAD leachate); Tank 11 liquid (Tank 10 SD); Tank 38 liquid (2H liquor).	1,000
ARP/MCU B9	Tank 23 liquid (Tank 41 SD and Tank 35 supernate); Tank 35 supernate (Tank 37 SD); Tank 8 liquid (SB5 & 6 LTAD); Tank 11 liquid (Tank 10 SD); Tank 38 liquid (2H liquor).	1,000
ARP/MCU B10	Tank 23 liquid (Tank 41 and Tank 37 SD); Tank 35 supernate (Tank 37 SD); Tank 8 liquid (SB5 & 6 LTAD); Tank 11 liquid (Tank 10 SD); Tank 38 liquid (2H liquor).	1,000
ARP(41)/MCU B11*	Tank 23 liquid (Tank 41 and Tank 37 SD); Tank 38 liquid (2H liquor).	1,000
ARP(41)/MCU B12	Tank 23 liquid (Tank 41 and Tank 37 SD); Tank 32 supernate/interstitial liquid (IL); Tank 38 liquid (2H liquor).	783
ARP (41)/MCU B13	Tank 26 liquid (Tank 37 SD from Tank 35); Tank 25 supernate (Tank 30 supernate/IL)	783
ARP (41)/MCU B14	Tank 23 liquid (Tank 41 and Tank 37 SD); Tank 32 supernate/IL; Tank 38 liquid (2H liquor)	783
ARP (41)/MCU B15	Tank 26 liquid (Tank 37 SD from Tank 35 and Tank 29 SD); Tank 25 supernate (Tank 46 supernate/ IL)	783
ARP (41)/MCU B16	Tank 23 liquid (Tank 41 and Tank 37 SD); Tank 32 supernate/IL; Tank 38 liquid (2H liquor)	783
ARP (41)/MCU B17	Tank 26 liquid (Tank 46 SD); Tank 25 supernate (Tank 46 supernate/ IL)	783
ARP (41)/MCU B18	Tank 23 liquid (Tank 41 and Tank 37 SD); Tank 32 supernate; Tank 38 liquid (2H liquor)	783
ARP (41)/MCU B19	Tank 26 liquid (Tank 46 SD); Tank 25 supernate (Tank 46 supernate/ IL)	783
ARP (41)/MCU B20	Tank 23 liquid (Tank 29 SD and Tank 37 SD (from Tank 35)); Tank 32 supernate/IL; Tank 38 liquid (2H liquor)	783
ARP (41)/MCU B21	Tank 26 liquid (Tank 46 SD); Tank 25 supernate (Tank 46 supernate/ IL)	783
ARP (41)/MCU B22	Tank 23 liquid (Tank 29 SD, Tank 37 SD (from Tank 35), and Tank 14 sludge washed water (from Tank 13)); Tank 32 supernate/IL; Tank 38 liquid (2H liquor)	783
ARP (41)/MCU B23	Tank 26 liquid (Tank 46 and Tank 29 SD); Tank 25 supernate (Tank 46 supernate/ IL)	783
ARP (41)/MCU B24	Tank 23 liquid (Tank 29 SD, and Tank 14 sludge washed water (from Tank 13)); Tank 32 supernate/IL; Tank 38 liquid (2H liquor)	783
ARP (41)/MCU B25	Tank 26 liquid (Tank 46 and Tank 29 SD); Tank 25 supernate (Tank 46 supernate/ IL)	783

Batch	Source Tanks	Nominal Volume (kgal)
ARP (41)/MCU B26	Tank 23 liquid (Tank 29 SD, and Tank 14 sludge washed water (from Tank 13)); Tank 32 supernate/IL; Tank 38 liquid (2H liquor)	783
ARP (41)/MCU B27**	Tank 26 liquid (Tank 37 SD from Tank 35 and Tank 29 SD); Tank 25 supernate (Tank 46 supernate/ IL)	783

* Beginning with ARP/MCU Batch 11, the MST strike will be completed in Tank 41 with filtration accomplished by RMFs

**ARP/MCU will be shut down for SWPF tie-in during ARP/MCU B27. Any qualified ARP/MCU in Tank 21 would be transferred to Tank 49 to use in SWPF B1.

4.3.2 Small Column Ion Exchange (SCIX)

The SCIX Program will provide additional salt processing capability utilizing an Ion Exchange Column (IXC) to accelerate salt processing and tank grouting. Although SCIX deployment could be physically complete as early as FY16, assumed funding limitations defer projected completion to FY19. In this *Plan*, SCIX operates in parallel with SWPF, beginning in FY19. SCIX is able to increase the salt processing rate without the strip effluent limitation inherent with SWPF. It will consist of one feed pump, four RMF, two IXC units, and one Spent Resin Disposal (SRD) unit installed in risers in Tank 41. An additional 3 Mgal/yr salt solution treatment capacity is planned. Table 4-3 — *SCIX Salt Batch Composition* gives the composition of the salt batches for SCIX.

The process utilizes a non-elutable ion exchange media, crystalline silicotitanate (CST), for use in the IXC to remove Cs-137 from the salt solution. CST can only be loaded with Cs-137 one time. Once loaded, the spent media must be removed and the IXC replenished with fresh resin. Spent CST will be sluiced to SRD to reduce the particle size. The ground CST, laden with Cs-137, is then transferred to a sludge batch for ultimate disposal by DWPF. The CST is assumed to require replacement once every two weeks, based on operating 24 hours a day, seven days per week. Table 4-3 gives the composition of the salt batches for SCIX.

Table 4-3 — SCIX Salt Batch Composition

Batch	Source Tanks	Nominal Volume (kgal)
SCIX B0	Tank 35 liquid (Tank 38 and 47 SD); Tank 30 supernate/IL	1,040
SCIX B1	Tank 35 liquid (Tank 38 and 47 SD); Tank 30 supernate/IL	840
SCIX B2	Tank 35 liquid (Tank 38 SD); Tank 30 supernate/IL	840
SCIX B3	Tank 35 liquid (Tank 38 SD); Tank 30 supernate (Tank 30 and Tank 9 supernate/IL)	840
SCIX B4	Tank 35 liquid (Tank 9 SD and Tank 29 SD (stored in Tank 34)); Tank 30 supernate (Tank 30 and Tank 9 supernate/IL)	840
SCIX B5	Tank 35 liquid (Tank 45 SD via Tank 34); Tank 30 supernate (Tank 30, 31, 9 supernate/IL)	840
SCIX B6	Tank 35 liquid (Tank 45 SD via Tank 34); Tank 30 supernate (Tank 30, 31, 9 supernate/IL)	840
SCIX B7	Tank 35 liquid (Tank 45 SD via Tank 34); Tank 30 supernate (Tank 30, 31, 9 supernate/IL)	840
SCIX B8	Tank 35 liquid (Tank 45 SD via Tank 34); Tank 30 supernate (Tank 30, 31, 9 supernate/IL)	840
SCIX B9	Tank 35 liquid (Tank 29 SD); Tank 30 supernate (Tank 30, 31, 9 supernate/IL)	840
SCIX B10	Tank 35 liquid (Tank 31 SD); Tank 30 supernate (Tank 25 and 26 supernate/IL stored in Tank 8)	840
SCIX B11	Tank 35 liquid (Tank 31 SD); Tank 30 supernate (Tank 25 and 26 supernate/IL stored in Tank 8)	840
SCIX B12	Tank 39 liquid (Tank 31 SD); Tank 30 supernate (Tank 25 and 26 supernate/IL stored in Tank 8)	840
SCIX B13	Tank 39 liquid (Tank 31 SD); Tank 30 supernate (Tank 27 supernate/IL stored in Tank 8)	840
SCIX B14	Tank 39 liquid (Tank 2 SD (from Tank 23), Tank 3 SD (from Tank 8), and Tank 36 SD); Tank 37 supernate/IL	840
SCIX B15	Tank 39 liquid (Tank 36 SD); Tank 37 supernate/IL; Tank 48 bulk waste removal treatment.	840
SCIX B16	Tank 39 liquid (Tank 36 SD); Tank 30 supernate (Tank 37 supernate/IL); Tank 48 bulk waste removal treatment	840
SCIX B17	Tank 39 liquid (Tank 36 SD); Tank 30 supernate (Tank 37 supernate/IL); Tank 48 bulk waste removal treatment.	840
SCIX B18	Tank 39 liquid (Tank 36 SD); Tank 30 supernate (Tank 37 supernate/IL); Tank 48 bulk waste removal treatment.	840
SCIX B19	Tank 39 liquid (Tank 37 SD); Tank 38 supernate (Tank 36 supernate/IL)	840

Batch	Source Tanks	Nominal Volume (kgal)
SCIX B20	Tank 39 liquid (Tank 37 SD); Tank 38 supernate (Tank 37 supernate/IL from Tank 30)	840
SCIX B21	Tank 39 liquid (Tank 37 SD); Tank 38 supernate (Tank 37 supernate/IL from Tank 30)	840
SCIX B22	Tank 39 liquid (Tank 27 and 28 SD (stored in Tank 25)); Tank 38 supernate (Tank 37 supernate/IL from Tank 30)	840
SCIX B23	Tank 39 liquid (Tank 27 and 28 SD (stored in Tank 25)); Tank 38 supernate (Tank 37 supernate/IL from Tank 30)	840
SCIX B24	Tank 39 liquid (Tank 27 and 28 SD (stored in Tank 44), Tank 29 and 45 SD (stored in Tank31)); Tank 38 supernate (from Tank 46, Tank 37 supernate/IL (stored Tank 30/Tank 47))	840
SCIX B25	Tank 39 liquid (Tank 28 SD (from Tank 25) and Tank 37 SD); Tank 38 supernate (from Tank 46, Tank 37 supernate/IL (stored Tank 30/Tank 47))	840
SCIX B26	Tank 39 liquid (Tank 28 SD (from Tank 25) and Tank 37 SD); Tank 38 supernate (from Tank 46, Tank 37 supernate/IL (stored Tank 30/Tank 47))	840
SCIX B27	Tank 39 liquid (Tank 3 SD (from Tank 26)); Tank 38 supernate (from Tank 46, Tank 37 supernate/IL (stored Tank 30/Tank 47))	840
SCIX B28	Tank 39 liquid (Tank 3 SD (from Tank 26) and Tank 38 SD (from Tank 43); Tank 38 supernate (from Tank 46, Tank 37 supernate/IL (stored Tank 30/Tank 47))	840
SCIX B29	Tank 39 liquid (Tank 3 SD (from Tank 26) and Tank 38 SD (from Tank 43); Tank 38 supernate (from Tank 46, Tank 37 supernate/IL (stored Tank 30/Tank 47))	840

4.3.3 Salt Waste Processing Facility (SWPF)

SWPF is assumed to begin operation in October 2018. All funding needed to complete the SWPF Project through CD-4 is assumed to be available as needed and is in addition to the LW Program funding assumption discussed in Section 6.1. For the first 12 months, the SWPF processing rate is assumed to be 4.6 Mgal/yr of salt solution. After 12 months, this *Plan* assumes the nominal processing rate to increase to 7.2 Mgal/yr. Beginning in 2022 process improvements will increase the nominal processing rate to 9 Mgal/yr.

The SWPF processing rate is based on an assumed 100% availability for the Tank Farm feed as well as DWPF and SPF receipt of the SWPF discharge streams. Availability of tank space to prepare salt solution batches may impact the ability to achieve SWPF operations at the rates in the inputs and assumptions, especially in the first few years of operation. The SWPF treatment process is planned to produce DSS that meets the SPF Waste Acceptance Criteria (WAC) limit.

Table 4-4 — *SWPF Batch Composition* gives the composition of the salt batches for SWPF.

Table 4-4 — SWPF Batch Composition

Batch	Source Tanks	Nominal Volume (kgal)
SWPF B1	Tank 23 liquid (Tank 32 SD); Tank 24 concentrated supernate; SB12 Aluminum dissolution leachate	1,000
SWPF B2	Tank 23 liquid (Tank 32 and Tank 34 SD); Tank 24 concentrated supernate; SB12 Aluminum dissolution leachate	1,000
SWPF B3	Tank 34 liquid (Tank 29 SD); Tank 42 supernate (Tank 42 and Tank 43 supernate); SB12 Aluminum dissolution leachate	1,000
SWPF B4	Tank 23 liquid (Tank 29 SD); Tank 42 supernate (Tank 42 and Tank 43 supernate); SB12 Aluminum Dissolution leachate	1,000
SWPF B5	Tank 34 liquid (Tank 29 SD); Tank 42 supernate (Tank 42 and Tank 43 supernate, Tank 24 supernate from Tank 35); SB13 LTAD leachate	1,000
SWPF B6	Tank 23 liquid (Tank 47 SD); Tank 42 supernate (Tank 42 and Tank 43 supernate, Tank 24 supernate from Tank 35); SB13 LTAD leachate	1,000
SWPF B7	Tank 26 liquid (Tank 47 SD); Tank 7 (Tank 25, 26, 33 supernate/IL)	1,000
SWPF B8	Tank 43 liquid (Tank 47 SD); Tank 42 supernate (Tank 42 and Tank 24 supernate from Tank 32); SB13 LTAD leachate	1,000
SWPF B9	Tank 23 liquid (Tank 47 SD); Tank 42 supernate (Tank 42 and Tank 24 supernate from Tank 32); SB13 LTAD leachate	1,000

Batch	Source Tanks	Nominal Volume (kgal)
SWPF B10	Tank 43 liquid (Tank 47 SD); Tank 42 supernate (Tank 42 and Tank 24 supernate from Tank 32)	1,000
SWPF B11	Tank 26 (Tank 46 SD); Tank 7 (Tank 25, 26, 33 supernate/IL)	1,000
SWPF B12	Tank 23 liquid (Tank and Tank 47 SD); Tank 42 supernate (Tank 42 and Tank 24 supernate from Tank 32)	1,000
SWPF B13	Tank 43 liquid (Tank 9 SD); Tank 42 supernate (Tank 45 supernate/IL from Tank 47); SB14 LTAD leachate	1,000
SWPF B14	Tank 26 (Tank 45 and 46 SD); Tank 7 (Tank 25, 26, 33 supernate/IL); SB14 LTAD leachate	1,000
SWPF B15	Tank23 liquid (Tank 9 SD and Tank 45 SD from Tank 34); Tank 42 supernate (Tank 45 supernate/IL from Tank 47); SB14 LTAD leachate	1,000
SWPF B16	Tank 43 liquid (Tank 38 SD); Tank 42 supernate (Tank 45 supernate/IL from Tank 47); SB14 LTAD leachate	1,000
SWPF B17	Tank 26 (Tank 45 and 46 SD); Tank 7 (Tank 25, 26, 33 supernate/IL)	1,000
SWPF B18	Tank 23 liquid (Tank 38 SD); Tank 42 supernate (Tank 45 supernate/IL from Tank 47)	1,000
SWPF B19	Tank 43 liquid (Tank 38 SD); Tank 42 supernate (Tank 44 supernate/IL from Tank 47)	1,000
SWPF B20	Tank 26 (Tank 45 SD); Tank 7 (Tank 25, 26, 29 supernate/IL from Tank 8)	1,000
SWPF B21	Tank 23 liquid (Tank 29 SD); Tank 42 supernate (Tank 45 supernate/IL from Tank 47)	1,000
SWPF B22	Tank 23 liquid (Tank 31 SD); Tank 42 supernate (Tank 45 supernate/IL from Tank 47)	1,000
SWPF B23	Tank 26 (Tank 45 SD); Tank 7 (Tank 25, 26, 29 supernate/IL from Tank 8)	1,000
SWPF B24	Tank 46 (Tank 44 and 45 SD); Tank 25 (Tank 34 supernate/IL)	1,000
SWPF B25	Tank 23 liquid (Tank 31 SD); Tank 42 supernate (Tank 45 supernate/IL from Tank 47)	1,000
SWPF B26	Tank 45 (Tank 44 SD); Tank 7 (Tank 25, 26, 29 supernate/IL from Tank 8); SB15 LTAD leachate	1,000
SWPF B27	Tank 46 (Tank 44 SD and 45 SD (stored in Tank 26)); Tank 25 (Tank 34 supernate/IL); SB15 LTAD leachate	1,000
SWPF B28	Tank 23 liquid (Tank 31 SD); Tank 42 supernate (Tank 39 supernate); SB15 LTAD leachate	1,000
SWPF B29	Tank 45 (Tank 44 SD); Tank 7 (Tank 2 and 3supernate/IL); SB15 LTAD leachate	1,000
SWPF B30	Tank 46 (Tank 44 and 45 SD); Tank 25 (Tank 34 supernate/IL)	1,000
SWPF B31	Tank 23 liquid (Tank 31 SD and Tank 2 SD (stored in Tank 8)); Tank 42 supernate (Tank 39 supernate)	1,000
SWPF B32	Tank 45 (Tank 44 SD); Tank 7 (Tank 2 and 3supernate/IL)	1,000
SWPF B33	Tank 46 (Tank 44 SD); Tank 25 (Tank 34 supernate/IL)	1,000
SWPF B34	Tank 23 liquid (Tank 2 SD (stored in Tank 8)); Tank 37 supernate	1,000
SWPF B35	Tank 45 liquid (Tank 44 SD (from Tank 46) and Tank 25 SD); Tank 46 supernate (Tank 1 supernate/IL (from Tank7), and Tank 27 supernate/IL)	1,000
SWPF B36	Tank 44 liquid (Tank 25 SD); Tank 46 supernate (Tank 1 supernate/IL (from Tank 7), and Tank 27 supernate/IL); SB16 LTAD leachate	1,000
SWPF B37	Tank 31 liquid (Tank 2 SD (stored in Tank 8) and Tank 36 SD); Tank 37 supernate; SB16 LTAD leachate	1,000
SWPF B38	Tank 45 liquid (Tank 1 SD via Tank 7); Tank 46 supernate (Tank 1 supernate/IL (from Tank7), and Tank 27 supernate/IL); SB16 LTAD leachate	1,000
SWPF B39	Tank 44 liquid (Tank 27 SD (stored in Tank 25) and Tank 1 SD (stored in Tank 8)); Tank 46 supernate (Tank 1 supernate/IL (from Tank 7), and Tank 27 supernate/IL); SB16 LTAD leachate	1,000
SWPF B40	Tank 31 liquid (Tank 36 SD); Tank 30 supernate (Tank 42, 36 supernate/IL); supernate liquid from Tank 48 bulk waste removal treatment	1,000
SWPF B41	Tank 45 liquid (Tank 1 SD via Tank 7 and Tank 3 SD via Tank 8 (stored in Tank 26)); Tank 46 supernate (Tank 1 supernate/IL (from Tank7), and Tank 27 supernate/IL); supernate liquid from Tank 48 bulk waste removal treatment	1,000
SWPF B42	Tank 44 liquid (Tank 1 SD (stored in Tank 8) and Tank 3 SD via Tank 8 (stored in Tank 26)); Tank 46 supernate (Tank 1 supernate/IL (from Tank 7), and Tank 27 supernate/IL); supernate liquid from Tank 48 bulk waste removal treatment	1,000
SWPF B43	Tank 31 liquid (Tank 36 SD); Tank 30 supernate (37 supernate/IL); supernate liquid from Tank 48 bulk waste removal treatment	1,000

Batch	Source Tanks	Nominal Volume (kgal)
SWPF B44	Tank 45 liquid (Tank 1 SD (stored in Tank 8), and Tank 28 SD); Tank 46 supernate (Tank 4 supernate); supernate liquid from Tank 48 bulk waste removal treatment	1,000
SWPF B45	Tank 44 (Tank 25 SD); Tank 46 supernate (Tank 4 supernate); supernate liquid from Tank 48 bulk waste removal treatment	1,000
SWPF B46	Tank 31 liquid (Tank 36 SD); Tank 30 supernate (Tank 37 supernate/IL); supernate liquid from Tank 48 bulk waste removal treatment	1,000
SWPF B47	Tank 45 liquid (Tank 28 SD); Tank 46 supernate (Tank 25 supernate/IL (stored in Tank 47) and Tank 28 supernate/IL); supernate liquid from Tank 48 bulk waste removal treatment	1,000
SWPF B48	Tank 44 liquid (Tank 25 SD); Tank 46 supernate (Tank 25 and 28 supernate/IL (stored in Tank 47)); supernate liquid from Tank 48 bulk waste removal treatment	1,000
SWPF B49	Tank 31 liquid (Tank 31 SD (stored in Tank 35), Tank 37 SD); Tank 38 supernate (Tank 37 supernate/IL (stored in Tank 30))	1,000
SWPF B50	Tank 45 liquid (Tank 28 SD); Tank 46 supernate (Tank 25, 28 and 30 supernate/IL (stored in Tank 47))	1,000
SWPF B51	Tank 44 liquid (Tank 25 SD); Tank 46 supernate (Tank 25, 28 and 30 supernate/IL (stored in Tank 47))	1,000
SWPF B52	Tank 31 liquid (Tank 37 SD); Tank 38 supernate (Tank 37 supernate/IL (stored in Tank 30))	1,000
SWPF B53	Tank 45 liquid (Tank 28 SD); Tank 46 supernate (Tank 25, 28 and 30 supernate/IL (stored in Tank 47))	1,000
SWPF B54	Tank 44 liquid (Tank 25 SD); Tank 46 supernate (Tank 25, 28 and 30 supernate/IL (stored in Tank 47))	1,000
SWPF B55	Tank 31 liquid (Tank 30 SD); Tank 38 supernate (Tank 37 supernate/IL)	1,000
SWPF B56	Tank 45 liquid (Tank 27 and 28 SD); Tank 46 supernate (Tank 25, 28 and 30 supernate/IL (stored in Tank 47))	1,000
SWPF B57	Tank 44 liquid (Tank 27 & 28 SD stored in Tank 25, Tank 28 SD); Tank 46 supernate (Tank 25, 28 and 30 supernate/IL (stored in Tank 47))	1,000
SWPF B58	Tank 31 liquid (Tank 30 SD); Tank 38 supernate (Tank 30 supernate/IL stored in Tank 37)	1,000
SWPF B59	Tank 45 liquid (Tank 27 and 28 SD); Tank 46 supernate (Tank 25, 28 and 30 supernate/IL (stored in Tank 47))	1,000
SWPF B60	Tank 44 liquid (Tank 27 SD); Tank 46 supernate (Tank 25, 28 and 30 supernate/IL (stored in Tank 47))	1,000
SWPF B61	Tank 31 liquid (Tank 27 SD in Tank 45); Tank 38 supernate (Tank 30 supernate/IL in Tank 37)	1,000

4.4 Saltstone Operations

The current active SDU, SDU-2 consists of two cells nominally 150 feet diameter by 22 feet high. After accounting for interior obstructions (support columns, drainwater collection systems, etc.) and the requirement for a 2-foot cold cap, the nominal useable volume of a cell is 2,300 kgal. Recent operating experience results in approximately 1.76 gallons of grout being produced for each gallon of DSS feed, thus yielding a nominal cell capacity of approximately 1,300 kgal of DSS. This SDU configuration is planned for SDU-3 and SDU-5 (SDU-4, a twelve-cell rectangular vault, completed filling in 2012). Beginning with SDU-6 through SDU-12, SDUs will consist of a single cell 375 feet in diameter by 43 feet high. The total capacity for these SDUs will be 32 Mgal, which will have a capability, after accounting for cold cap requirements, of dispositioning 30 Mgal of contaminated grout or 17.1 Mgal of DSS. In this *Plan*, SDU-6 is required to begin operations by July 2015.

4.5 Waste Removal and Tank Closure

4.5.1 Waste Removal and Tank Cleaning

The first step in the disposition of sludge and salt waste is BWRE. Sludge is sent to a hub tank or directly to the feed preparation tank ensuring sludge waste is continuously available for treatment at DWPF. Salt is dissolved, removed, and staged for treatment at ARP/MCU, SCIX, or SWPF.

Bulk Waste Removal Efforts

This *Plan* includes the Waste on Wheels (WOW) concept, which minimizes new infrastructure (see Figure 4-3). Portable and temporary equipment can meet tank infrastructure needs. Additional purchased pumps and equipment perform accelerated BWRE operations concurrently in both Tank Farms. The primary components of the WOW system are:

- Reusable submersible mixer pumps (SMP)
- A portable field operating station containing pump drives and controls
- A portable substation to provide 480-, 240- and 120-volt power to the WOW equipment
- Disposable carbon steel transfer pumps.

WOW equipment is deployed at the tank as a field operating station, providing temporary power and control for BWRE equipment. When BWRE is completed on one tank, the WOW equipment is reconfigured to support waste removal on the next tank. Pumps are sized to fit through 24-inch openings allowing a high degree of flexibility to locate the pumps in optimal configurations within the waste tanks. Most are supported from the bottom of the tank, minimizing steel superstructures and tank-top loading. Product lubricated bearings and motor cooling eliminate the need for bearing and seal water supply. These pumps have exterior fittings and fixtures so the pumps can be quickly decontaminated, removed, and reinstalled in the next tank with minimal radiation exposure to personnel. Disposable transfer pumps transfer the waste to a receipt or hub tank using existing underground transfer lines and diversion boxes. If the transfer system is degraded or non-existent, above-grade hose-in-hose technology is deployed, rather than investing in costly repairs. Temporary shielding is supplied as necessary to reduce exposure to personnel.

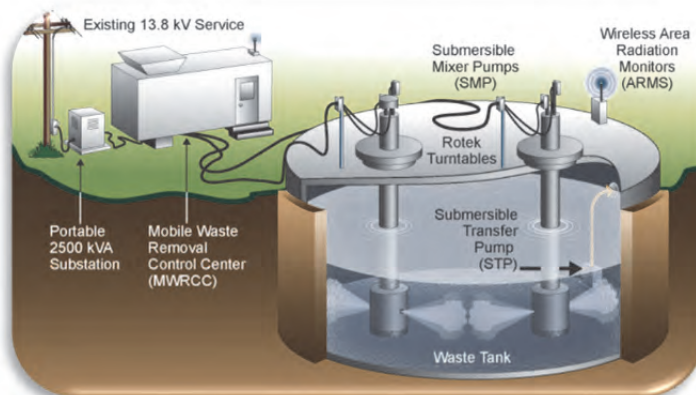


Figure 4-3 — WOW Deployment for BWRE

Sludge Removal

Sludge removal operations are typically conducted with three mixing pumps with provision for a fourth pump if needed. Sufficient liquid is added to the tank to suspend sludge solids; existing supernatant or DWPF recycle material is used instead of Inhibited Water (IW), when feasible, to minimize introduction of new liquids into the system. Operation of the mixing pumps suspends the solids, which are then transferred as a slurry from the tank. This operation is repeated, periodically lowering the mixer pumps, until the remaining contents of the tank can no longer be effectively removed by this method.

Sludge batches are configured to preferentially remove sludge from Type I, II, and IV tanks and to balance the sludge batch composition of Plutonium Uranium Reduction Extraction (PUREX) process and the modified PUREX process in H-Canyon (HM) sludges (see §7.1 for a description of these sludge types). Tank 13, a Type II tank in H-Tank Farm (HTF), will be used to store and transfer sludge from other tanks, as necessary, until Tank 13 heel removal is performed in 2020.

Salt Removal

Salt waste removal may be accomplished using a modified density gradient process (see Figure 4-4) followed by mechanical agitation. A well is mined through the saltcake down to the tank bottom. An off-the-shelf, disposable transfer pump is installed at the bottom of the well, along with instruments to monitor waste density. Water is added to dissolve the salt, and as the density increases, the saturated solution migrates to the bottom of the well where it is pumped out. The initial process involves no moving parts in the tank except the transfer pump. When available, DWPF recycle is used to dissolve salt, conserving Type III tank space by minimizing additions of new material and reducing the load on the evaporator system. The dissolved salt solution is prepared as close to saturation as possible prior to pumping out the tank. As salt dissolution progresses and the soluble fraction is pumped from the tank, the insoluble materials dispersed throughout the salt matrix blankets the underlying salt and the dissolution rate decreases significantly. SMPs, powered and controlled with WOW equipment, suspend and remove insoluble solids at the end of the dissolution step, similar to sludge removal.

Other methods of salt dissolution may be pursued on a case-by-case basis. For example, beginning in late FY 2010 and continuing to the present, Tank 41 salt dissolution has been achieved gradually by receiving recycle directly from DWPF until the level is approximately twelve inches above the saltcake, then recirculating with a transfer pump for

several days just prior to transferring out to Tank 23 for use in a salt batch. The resultant dissolved salt has been used in the make-up of ARP/MCU salt batches beginning with Salt Batch #5.

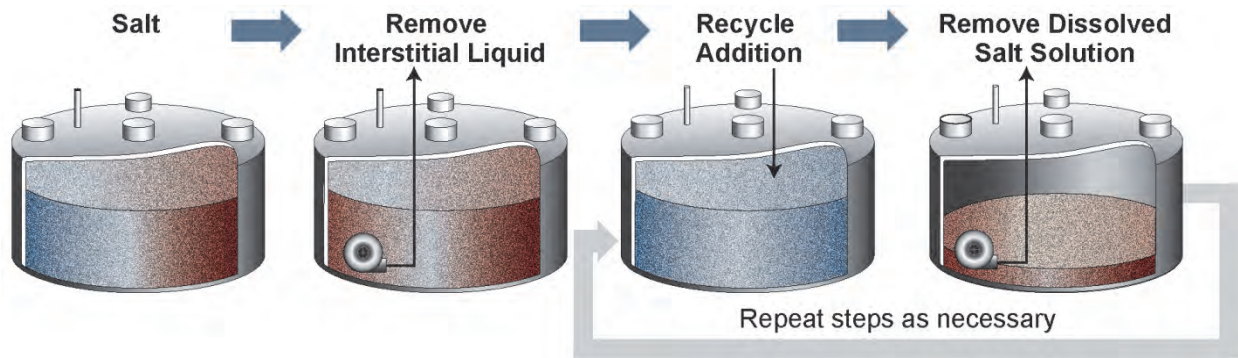


Figure 4-4 — Modified Density Gradient Salt Removal

Heel Removal

Heel removal is performed after BWRE has removed the material that can be removed with the technologies discussed above. Heel Removal can consist of a combination of Mechanical Heel Removal and Chemical Cleaning. In general mechanical heel removal is done prior to chemical cleaning, and is discussed below in some detail. Depending on tank conditions, however, chemical cleaning may be performed prior to mechanical heel removal or to perform some mechanical heel removal, some chemical heel removal, back and forth, to provide removal to the extent technically practicable from an engineering perspective and the highly radioactive radionuclides removed to the maximum extent practical.

Mechanical Heel Removal

For mechanical heel removal, this *Plan* assumes vigorous mixing continues, using mixing pumps, until less than approximately 5,000 gallons of material remain. Additional mechanical removal can be achieved through directing pumps discharges in specific patterns to impact remaining material.

Chemical Cleaning

Chemical cleaning may be performed on sludge tanks when mechanical heel removal has not removed the material to the extent technically practicable from an engineering perspective and the highly radioactive radionuclides removed to the maximum extent practical. In bulk oxalic acid (OA) cleaning, the tank is modified to address chemical compatibility concerns and OA is added to the tank and mixing pumps operated. The contents of the tank are agitated for a short period and then transferred to a receipt tank for neutralization. This process is repeated one to three times based on chemical flowsheet projections.

Tanks with Documented Leak Sites

Several Type I, II, and IV tanks have documented leak sites. All Type IV tanks having documented leak sites have been removed from service; however, waste removal operations on some of the Type I and II tanks could potentially reactivate old leak sites or create new leak sites in those tanks. Contingency equipment and procedures will be utilized to contain leakage and minimize the potential for release to the environment. Specific plans will avoid liquid levels above known leak sites, when feasible, and focused monitoring will be employed where these levels cannot be avoided. As a result of program progress to date, of the 14 SRS tanks (all old-style tanks) with leakage history:

- 2 are operationally closed and grouted
- 2 are empty and cleaned
- 1 has been cleaned, pending further evaluation
- 1 has had bulk waste removed and is undergoing chemical cleaning later this year
- 1 has had BWRE completed
- 5 contain essentially dry waste, with little or no free liquid supernate
- 2 contain liquid supernate (at a level well below all known leak sites)

Of the remaining 10 old-style tanks (none of which have any known leakage history):

- 2 are operationally closed and grouted
- 2 contain essentially dry waste, with little or no free liquid supernate
- 6 contain liquid supernate.

Annulus Cleaning

Some Type I and II tanks have waste in the annulus space, some of which is a soluble form of salt appearing as dried nodules on tank walls at leak sites and at the bottom of the annulus pan. These tanks will be inspected to determine if Annulus Cleaning is required. Before declaring the tank ready for grouting (for those tanks requiring annulus cleaning), this waste will be removed from the annulus to the extent technically practicable from an engineering perspective and the highly radioactive radionuclides removed to the maximum extent practical.

4.5.2 Tank Closure and Stabilization

Type I, II, and IV tanks are planned operational closure in accordance with a formal agreement between the DOE, Region IV of the EPA, and SCDHEC as expressed in the SRS currently approved FFA. Four of these tanks in F-Tank Farm (FTF); Tanks 17, 18, 19, and 20; were operationally closed and stabilized (grouted) — Tanks 17 and 20 in 1997 and Tanks 18 and 19 in 2012.

Operational closure and stabilization consists of those actions following waste removal that bring liquid radioactive waste tanks and associated facilities to a state of readiness for final closure of the Tank Farms complex. The process may involve:

- Sampling and Characterization
- Developing tank-specific regulatory documents
- Isolating the tank from all operating systems in the surrounding Tank Farm (e.g., electrical, instruments, steam, air, water, waste transfer lines, and tank ventilation systems)
- Stabilizing by grouting of the primary tank, remaining equipment, annulus, and cooling coils
- Capping of select tank risers.

The closure process has increased to thirty months based on recent experience. This process includes sampling and characterization, initial drafting of closure documents, first-time review process, annulus and coil closure, and stabilization by grouting for Tanks 5, 6, 12, 14, and 16. This *Plan* assumes twenty-nine months from the last removal of any material until completion of grouting. This is a reasonable assumption as long as funding allows.

Sampling and Characterization

Before declaring a tank ready for grouting, the tank and annulus are inspected, the residual volume is determined, and the residual is sampled in accordance with a sample plan. Laboratory analysis of the samples yields concentrations of radiological and non-radiological constituents in the remaining material. Concentration and volume data are used to characterize the residual material to produce radiological and non-radiological inventories for the Closure Module (CM). Tank-specific closure documents are prepared to demonstrate compliance with State and DOE regulatory requirements as well as NDAA §3116.

Tank Isolation

Tank isolation is the physical process of isolating transfer lines and services from the tank and removing the tank from normal operations. Tank isolation may include cutting and capping or blanking mechanical system components (transfer lines, water piping, air piping/tubing, steam piping, etc.) and disconnecting electrical power to all components on the tank. Prior to tank isolation, flammability and inhalation dose calculations are completed to allow the tank to be placed in removed from service (RFS) Mode¹⁹. Temporary power skids provide services for grout placement (including ventilation, lighting, and cameras). The skids also provide a portable ventilation system to replace the permanent system so that each tank is completely isolated from the Tank Farm during grouting operations.

Closure Documentation Development

An area-specific WD approach ensures the NDAA §3116 tank closure process is implemented as efficiently as possible. Performance Assessments (PA) and NDAA §3116 Basis Documents have been generated for each Tank Farm —one for FTF and one for HTF. The NDAA §3116 Basis Documents include the waste tanks as well as

ancillary structures located within the boundary of the respective Tank Farm. An area-specific General Closure Plan has been developed for each of the Tank Farms and approved by SCDHEC.

DOE Radioactive Waste Management Manual 435.1-1 mandates a Tier 1 Closure Plan and associated Tier 2 Closure Plans. The Tier 1 plans are area-specific and provide the bases and process for moving forward with tank grouting. This document is approved at the DOE-Headquarters level. The Tier 2 documents are tank-specific, follow the approved criteria established in the Tier 1 documents, and are locally approved by DOE-SR.

Development of a tank specific CM, per the State-approved area-specific General Closure Plans, follows completion of tank cleaning activities. The CM describes the waste removal and cleaning activities performed and documents the end state. Final characterization data supports the performance of a Special Analysis, the process used to determine if final residual inventories continue to support the conclusions of the PA.



Figure 4-5 — Grout Placement

Grout Selection and Manufacture

A reducing grout provides long-term chemical durability and minimizes leaching of residual waste over time. The reducing grout used to fill the tank, is self-leveling, and encapsulates the equipment remaining inside the tank. If needed, a strong grout cap is applied on top for intruder prevention in tanks that do not have a thick concrete roof. The properties of the reducing grout may be such that it can serve as this strong grout cap. Grouting activities include Authorization Basis (AB) changes, field modifications, and grout procurement.

Grout Placement

Grout fill operations, including site preparation, pumper truck set up, grout plant set up (if required), grout delivery lines, and grout equipment setup are established around the tanks (see Figure 4-5). A sequence for tanks with an annulus will be developed so that voids are filled and the structural integrity of the tank is maintained. Generally, grouting the annulus and primary tank in alternating steps provides structural support for the tank wall.

Equipment Grouting

For tanks with installed equipment or cooling coils, internal voids are filled with a flowable grout mixture. In those tanks where the cooling coils have broken, alternative techniques are used to minimize voids in the grout matrix.

Riser Grouting and Capping

The final step in the tank grouting operation, after filling the tank, may include encapsulating select risers. Using forms, grout encapsulates the risers thus minimizing the risk of in-leakage and intrusion. The final grouted tank configuration is an integral monolith free of voids and ensuring long-lasting protection of human health and the environment (see Figure 4-6).

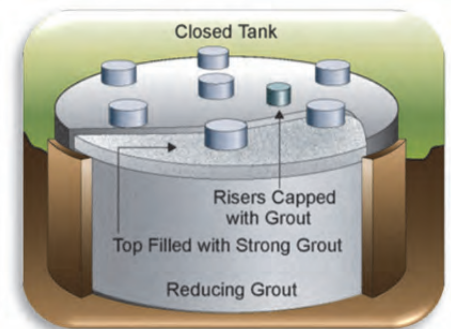


Figure 4-6 — Grouted Tank

4.6 Base Operations

4.6.1 Supporting Nuclear Material Stabilization

A continuing portion of the mission of the Tank Farms, especially HTF, is safe receipt, storage, and disposition of waste yet to be received from H-Canyon and HB-Line. This *Plan* supports nuclear material stabilization in H-Canyon through 2025 (with shutdown flows through 2026). Tank 39 will continue to be used for H-Canyon receipt through shutdown of H-Canyon. The 3H and 2F Evaporator systems will continue to operate. Salt must be removed from the Evaporator concentrate receipt tanks to allow continued evaporator operation. Thus, this *Plan* relies on Tank Farm evaporators to operate at reasonable attainment. An unanticipated extended outage of either the 2F or 3H Evaporator Systems could delay the preparation of a DWPF sludge batch, delay tank removals from service, and impact H-Canyon operation.

This *Plan* assumes waste volumes from H-Canyon are transferred to Tank 39 at no more than 300 kgal/yr per the *Functional Service Agreement between SRNS and SRR*²⁰. Some plutonium bearing waste by-passes Tank 39 and is inserted into a DWPF sludge batch “just-in-time” via receipt into the sludge processing tank (Tank 51) or the DWPF feed tank (Tank 40) as the alternative disposition path. Plutonium discards from H-Canyon will be supported to the

extent allowable without negatively impacting planned canister waste loadings or failing to comply with canister fissile material concentration limits. Additionally, LLW is transferred from H-Canyon into Tank 50 for direct disposal in SPF.

It is recognized that the H-Canyon mission may be changed in the coming years such that new waste streams may be received into the LW system. As new streams are identified, they will be evaluated and impacts to LW processing will be reviewed.

4.6.2 DWPF Recycle Handling

DWPF recycle is the largest influent stream received by the Tank Farm. In this *Plan*, disposition of the recycle stream is handled through evaporation in the 2H Evaporator System and through the beneficial reuse of the low sodium molarity (less than 1.0 molar sodium) recycle stream. The DWPF recycle rate will remain between 1.5 and 1.9 Mgal/yr prior to SWPF operations. The rate depends on canister production rate and Steam Atomized Scrubbers (SAS) operation as well as DWPF recycle reduction initiatives. The rate could increase to as high as 3.2 Mgal/yr after the startup of SWPF because of extra water in the SE stream and MST slurry and because the higher Cs-137 concentrations could require the operation of two SAS stages in the DWPF melter offgas system; currently, only one SAS stage is operated. This higher rate, however, could be mitigated by the DWPF recycle reduction initiatives discussed in §4.2, above. DWPF recycle is exclusively evaporated in the 2H Evaporator System due to chemical incompatibility with other waste streams. It may, however, be beneficially reused for salt solution molarity adjustment, salt dissolution, heel removal, etc. Beneficial reuse minimizes the utilization of the 2H Evaporator. LW system modeling forecasts that the life cycle processing outlined herein can adequately handle the DWPF recycle stream through the end of the *Plan*. DWPF recycle will be supplemented by IW, as required, for salt dissolution and adjustment.

4.6.3 Transfer Line Infrastructure

Although efforts will continue to be made to keep transfers between tanks to a minimum, executing this *Plan* requires more frequent transfers than have historically occurred in the Tank Farm, especially after the startup of SWPF, when large volumes of salt solution will be delivered to SWPF. Because of the greatly increased pace of transfers after the startup of SWPF, short downtimes due to unexpected conditions requiring repair will be more difficult to accommodate without impact because the idle time of transfer lines will be reduced.

New infrastructure is required to accomplish transfers to support SWPF, while also continuing activities that have been historically performed, such as waste removal and evaporation. Discoveries of unexpected conditions in existing transfer systems could impact the installation of new transfer lines and equipment.

The transfers in this *Plan* are generally based on the known current infrastructure and modifications planned in the SWPF transfer line tie-ins and in projects for new facilities. The actions described can be executed as long as the planned modifications are made and significant failures of key transfer equipment do not occur or can be mitigated quickly enough to allow activities to proceed as planned. This *Plan*, however, does not attempt to explain all the modifications needed or the failure of specific pieces of transfer equipment.

4.6.4 Tank 50 Equipping for HLW Service

Tank 50 was modified to enable it to enter HLW service, if needed. This *Plan* projects the continued use of Tank 50 as the SPF feed tank throughout the life cycle. Final conversion, however, is an option if future modeling indicates it is required.

4.6.5 Effluent Treatment Facility

The Effluent Treatment Facility (ETF), located in H-Area, collects and treats process wastewater that may be contaminated with small quantities of radionuclides and process chemicals. The primary sources of wastewater include the 2F, 2H, and 3H Evaporator overheads and H-Canyon. The wastewater is processed through the treatment plant and pumped to Upper Three Runs Creek for discharge at an NPDES permitted outfall. Tank 50 receives ETF residual waste for storage prior to treatment at SPF and final disposal at SDF. A 35-kgal Waste Concentrate Hold Tank (WCHT) provides storage capacity at ETF to minimize transfer impacts directly to Tank 50 or SPF during SWPF operations.

4.6.6 Managing Type III Tank Space

Type III tank space is essential to all the processes described in this *Plan*: evaporation, DWPF sludge batch preparation, salt processing, tank removal from service, etc. Limited waste storage space exists in Type III/IIIA tanks in both FTF and HTF. There is a risk that a leak in a primary tank or other adverse event could occur that might impair execution of this *Plan*.

In the 2F and 3H Evaporator Systems, space is needed for evaporator concentrate receipt to support periodic salt dissolutions and storage of high-hydroxide waste that does not precipitate into salt. This “boiled-down” liquid is commonly referred to as liquor and removing the liquor from an evaporator system is referred to as deliquoring. Evaporator effectiveness is diminished when the concentrate receipt tank salt level is 330” or greater — at this point, the evaporator system is said to be “salt bound.” Salt removal from the 3H Evaporator concentrate receipt tank, Tank 37, occurred in early FY11 to reduce the salt level. After salt removal from Tank 25, it replaced Tank 47 as the 2F Evaporator concentrate receipt tank in early 2010.

In addition, this *Plan* was structured in such a way as to provide contingency when allowable in order to provide the best opportunity for success. Lack of evaporator working space would hinder tank removals from service, canister production rate at the DWPF, or H-Canyon support.

This *Plan*, as did Revision 17 of the *Plan*, utilizes Type I, II, and IV tanks to store supernate generated by sludge preparation:

- Tank 8 stores aluminum-laden supernate from the LTAD of Sludge Batches 5 and 6
- Tank 4 and Tank 7 store concentrated supernate
- After Tank 8 aluminum-laden supernate is processed in ARP/MCU, Tank 8 will store concentrated supernate
- Tank 11 stores salt dissolution material
- Tank 21 through Tank 24 are planned for BWRE completion by 2018. After that:
 - Tank 21 will continue service as a salt blend tank for ARP/MCU and SWPF
 - Tank 22 will be used as a salt blend tank for SCIX
 - Tank 23 will store concentrated supernate
 - Tank 24 will store additional Tank 13 supernate to support sludge removal from Tank 13.

The EPA and SCDHEC concurred with the use of Tank 8 to store aluminum-laden supernate²¹, Tank 7 to support closure of Tanks 5 and 6 by storing liquids from cooling coil flushes, and Tank 11 to support BWRE in Tank 10 by receiving dissolved salt solution from Tank 10 until it is transferred to Tank 21 for inclusion in Salt Batch 7 and heel removal activities in Tank 12 by receiving and storing dewatering material from Tank 12^{22,23}. Pre-decisional presentations have been made to regulatory agencies regarding further use of tanks as described above.

4.7 Closure Sequence for the Liquid Waste System

After the H and F-Tank Farm tanks and ancillary equipment has been closed the Liquid Waste facilities outside the Tank Farm — DWPF, SWPF, ARP/MCU, SPF, SDF, and associated ancillary equipment — will be available for beneficial reuse, if required. Otherwise, these facilities will be available for removal from service.

While the general priority is to close geographically proximate equipment and facilities, thus minimizing cost, the actual sequence of the shutdowns is predicated on the capability of the facilities to process the particular blends required by the salt and sludge treatment processes. The priority (but not necessarily the sequence) for shutdowns as modeled is:

1. Type I, II, and IV tanks
2. F-Area waste tanks, the 2F Evaporator, and ancillary equipment (including 1F Evaporator and the concentrate transfer system)
3. H-Area West Hill waste tanks, the 3H Evaporator, and ancillary equipment (including 1H Evaporator)
4. H-Area East Hill waste tanks, the 2H Evaporator, and ancillary equipment (including any remaining ARP/MCU equipment)
5. Major remaining processing facilities (e.g., DWPF, SWPF, SDF/SPF).
6. ETF is not addressed in this plan as it processes streams from facilities outside the scope of this plan (e.g., Mixed Oxide Facility)

The key elements of the systematic closure sequence for shutting down and closing the LW System are summarized in Table 4-5.

Table 4-5 — Closure Activities

FY26	<ul style="list-style-type: none"> - Waste removal is complete from all Type I, II, and IV tanks - H-Canyon processing influents cease
FY27-28	<ul style="list-style-type: none"> - All Type I, II, and IV tanks are operationally closed - 2F Evaporator shut down - 3H Evaporator shut down - H-Canyon shutdown flow influents cease - 2H Evaporator shut down - SWPF shut down - FTF waste removal is completed - HTF waste removal is complete
FY29-34	<ul style="list-style-type: none"> - All Type III tanks are operationally closed - DWPF shut down - SPF shut down

Once closure activities are complete, the remaining facilities may be chemically cleaned and flushed as necessary.

5. Alternative Analyses

5.1 2023 SWPF Startup

Summary

In this Alternative Analysis, SWPF operations are delayed to October 2023 from October 2018.

Discussion

A five-year delay of the start-up of SWPF operations would allow deferral of Salt Disposition Initiative (SDI) scope to later years, freeing up funding in the near term enabling accelerated deployment of SCIX. This would allow the acceleration of SCIX start-up to October 2016 from April 2019. Additionally, since ARP/MCU is not shut down until six months before SWPF start-up, with additional investment, it could be available at a nominal rate of 4.7 Mgal per year for an additional five years. Delaying the SWPF operations would allow greater processing in the FY17 through FY23 timeframe due to continuous processing through that period. It would, however, delay processing in the later years (see Figure 5-1).

The increased production in SCIX and ARP/MCU results in a balanced treatment of the salt waste approximately evenly between the three major facilities (see Appendix H — *Salt Solution Processing, Alternate Case*). SWPF processing finishes in early FY29 as compared to FY26 in the base case and SCIX processing finishes early FY29 as compared to mid FY28 in the base case. While canister production would be similar to the base case, Type I, II, and IV tank closures would be further delayed (see Figure 5-2 and Appendix I — *BWRE & Removal from Service, Alternate Case*).

SDU-7 would be required a year earlier than in the base case, SDU-8 would be required eight months earlier, and SDU-9 would be required about a month earlier. Additionally, since SWPF would operate for a very few years only, there is essentially no positive return to the LW program from the investment in the SWPF Project.

SWPF startup in **October 2023** vs. **October 2018**

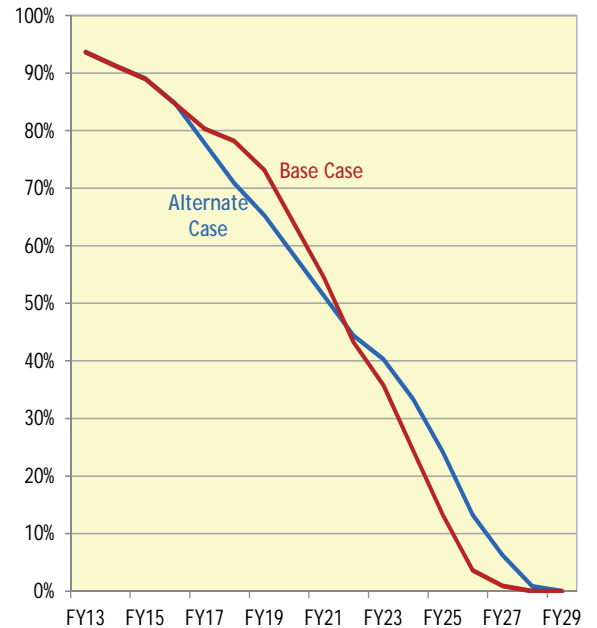


Figure 5-1 — Salt Solution Remaining

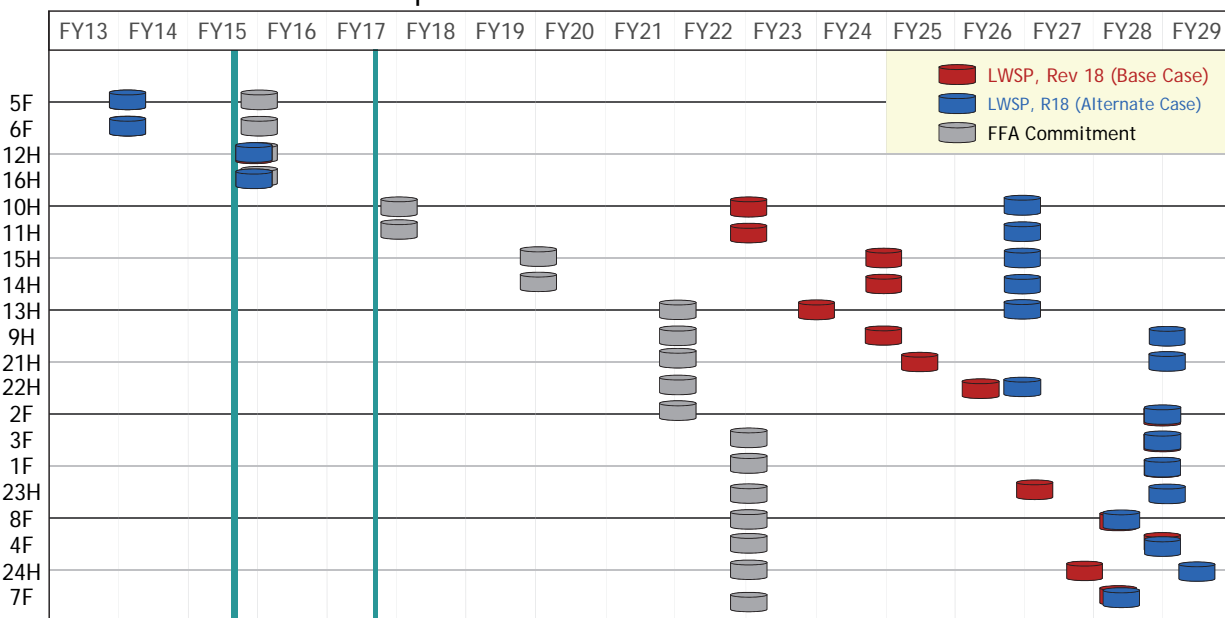


Figure 5-2 — Tank Closure Projections

6. Description of Assumptions and Bases

The major assumptions and planning bases are the results of an agreement between SRR and DOE²⁴. These assumptions address the planning period to the end of the program.

6.1 Priorities for Plan Development

- Continual Safe Storage
- Maximize Risk Reduction through Waste Disposition
- Tank Cleaning and Grouting

6.2 Funding

This *Plan* was developed assuming the funding required to achieve the planned project and operations activities will be available, within the following restrictions:

- Revision 18 of the *Plan* assumes receipt of \$450M (escalated) new Budget Authority (BA) per year to the LW contractor from FY14 through FY18 and then \$525 M (escalated) per year until the end of the program.
- The following items are supplemental to LW contractor funding: SWPF (project and operations), Additional Glass Waste Storage (project and operations), Landlord services, Essential Site Services (ESS - Section J), pension and legacy cost
- No “re-pricing” for site services is realized.

6.3 Regulatory Drivers

The following regulatory requirements drive the development of the System Plan through the end of the program.

- **Federal Facility Agreement (FFA)** – Commits the Department of Energy to operationally close the Type I, II, and IV tanks (Tanks 1–24) no later than 2022. The specific schedule for the Type I, II, and IV tanks is per the *Statement of Resolution of Dispute Concerning Extension of Closure Dates for Savannah River Site High-Level Radioactive Waste Tanks 19 and 18*¹⁴, which is the schedule for the currently approved FFA.
- **Site Treatment Plan (STP)** – “Upon the beginning of full operations, DWPF will maintain canister production sufficient to meet the commitment for the removal of the backlogged and currently generated waste inventory by 2028.” This is satisfied by removing waste (including heels) from all Type III tanks by 2028; Types I, II, and IV having had the waste removed in compliance with the FFA above.

Timely regulatory approvals are necessary to support this Plan.

6.4 Waste Removal and Tank Removal from Service Program

The following technical assumptions were used as input to the modeling of this *Plan*:

Waste Removal

- Types I, II, and IV tanks (Tanks 1–24):
 - Waste Removal and Tank Removal from Service commitments are per the FFA
 - After completion of bulk waste removal efforts in a specific tank, sufficient liquid may be added to facilitate heel cleaning and removal. Upon approval by SCDHEC and EPA, other liquids may be stored in the tank after completion of bulk waste removal efforts
- Type III and IIIA (Tanks 25–51)
 - While the Type III and IIIA tanks are not included in the FFA, commitment for completion of waste removal (bulk waste and heel) from all (Type I, II, III/IIIA, and IV) tanks is per the STP; tanks are not required to be isolated and grouted to meet the STP
- Waste removal and cleaning activities could include mechanical, chemical, and water washing operations
- After the initial BWRE campaign in a sludge tank, a ~3 to 6 inch heel (10–20 kgal) of waste remains
- After the initial BWRE campaign in a salt tank, ~ 2 to 3 feet (90–130 kgal depending on the type of tank) of insoluble/low solubility material waste (heel) remains
- Two Phases of Waste Heel Removal are available for use:
 - Mechanical Cleaning uses mechanical agitation
 - Assumed to take three months of operation unless otherwise stated
 - Heel solids volume reduced to less than 5 kgal
 - Chemical Cleaning uses OA or advanced/specialized mechanical or chemical technology

- Assumed to take 6 months of operation unless otherwise stated
- For some tanks with high waste turnover, e.g. Tank 8, mechanical cleaning may not be required; however, flushing could be required prior to chemical cleaning
- Tanks 4, 7, 8, 11, 12, 13, 14, 15, 26, 32, 33, 34, 35, 39, 42, 43, 47 are the source tanks for sludge solids in the model that would have chemical cleaning. No other tanks are planned to have chemical cleaning.
- Monitoring during the heel removal phase will inform the decision to do mechanical or chemical cleaning.
- Tank cleaning is complete for Tanks 5 and 6.

Annulus Cleaning

- All tanks that have experienced leaks will undergo inspection and, potentially, sampling and analysis to determine the necessity for annulus cleaning. The amount of material used for annulus cleaning depends on the extent of waste present.

Tank Removal from Service

- A 29-month operational closure and stabilization process is assumed
 - Drying & Sampling (6 months on critical path): including Tank Drying, Sample Prep Documents, Volume Determination Cessation Presentation and Sampling
 - Sample Analysis (7 months on critical path): including Lab Analysis and Sample Analysis Report (SAR)
 - Closure Documentation (11 months on critical path): including DQA, Inventory Determination, Special Analysis, MEP, Class C Calculation, Closure Module, and Tier 2
 - Grouting (5 months on critical path)
- Overall tank closure priority will support area closure in the following order, as feasible:
 1. F-Tank Farm
 2. H-Tank Farm West Hill
 3. H-Tank Farm East Hill
- Stabilization of a waste tank (i.e. grouting of primary tank, annulus space, and cooling coils as specified in the applicable Closure Module) is to be completed within 30 months of receipt of concurrence to enter the residual waste sampling and analysis phase
- Within six months of stabilization, tank waste systems will be removed from the *F and H Area High Level Radioactive Waste Tank Farms Construction Permit No. 17424-IW* in accordance with the applicable and approved Interim Record of Decision.

Regulatory Approvals

- SCDHEC will approve activities associated with waste removal, stabilization, operational closure, and maintenance and monitoring of waste tank systems will be performed and completed as described in the *Industrial Wastewater General Closure Plan for F-Area Waste Tank Systems*²⁵ or the *Industrial Wastewater General Closure Plan for H-Area Waste Tank Systems*²⁶. Operational closure activities will be performed and completed as described in tank-specific closure modules which are generated per the approved General Closure Plan
- The H-Tank Farm Waste Determination and associated HTF §3116 Basis Document, and the HTF Tier 1 Closure Plan will be approved by DOE in time to support the FY15 FFA tank closure milestones (i.e., Removal from Service of Tanks 12 and 16)
- DOE will approve any necessary waste determination documents to support this *Plan*
- DOE will maintain NEPA documentation necessary to support this *Plan*.

6.5 DWPF Production

Canister production and sludge batch need dates are projected by the *Sludge Batch Plan*¹⁵

- DWPF will produce canisters at maximum throughput for the duration of the program (based on Chemical Process Cell processing [mercury stripping], achievable melt rate, planned outages, and waste loading for sludge being processed). DWPF near-term canister production is based on revised sludge mass values.
- A four-month melter replacement outage is planned approximately every 96 months of melter operation (i.e., DWPF operates 92 months out of every 96 months).
- The next DWPF melter outage to replace Melter 2 is planned concurrent with replacement of MCU contactors and improvements to achieve the nominal 4.7 Mgal/year ARP/MCU processing rate (March 2015–June 2015). It is planned to include:
 - Melter #3 will replace Melter #2

- DWPF feed preparation modifications
- Recycle reduction modifications
 - reduce the recycle amount by ~1.25 Mgal/yr from the forecast of ~3.2 Mgal/yr after SWPF startup (as predicted by the algorithm used in versions of the LW System Plan prior to Rev. 15)
- A four-month DWPF outage, beginning June 2018, is required for SWPF tie-ins immediately prior to SWPF becoming operational. During this outage DWPF plans to implement productivity enhancements to support increased influents from SWPF
- Discrete Canister Production Rateⁱ:
 - Sludge batch planning is performed to recommend the sequencing and timing of future sludge batches. Based on modeling of sludge batches, *Appendix B — Sludge Processing* sums the canister production expectations, assuming 275 Discrete canisters/yr
- DWPF recycle is beneficially reused
- Supplemental glass waste storage will be required by December 2017
- Shipment of canisters off-site for final disposition is not in the scope of this Plan.
- DWPF canisters will maintain a concentration limit of 897 g/m³ of fissile material in the glass²⁷. Sludge batch preparation will supply feed for the DWPF to ensure the canisters remain within this requirement
- The canister heat load will be less than 834 watts per canister
- Pu discards from H-Canyon will be supported to the extent allowable without negatively impacting planned canister waste loadings while continuing to comply with the canister fissile material concentration limits.

6.6 Salt Program

ARP/MCU

- ARP/MCU processing rates:
 - ARP/MCU processes salt feed at a nominal rate of 3 Mgal/yr
 - A three-month outage in the fourth quarter of FY13 will allow the transition to a “next generation solvent” (NGS), enhancing the decontamination factor
 - Although implementation sets the stage for improved throughput, the improvement is not forecast at this time so the *Plan* will initially assume no throughput change with NGS
 - ISOPAR® levels allow Mode 1
 - A 4.7 Mgal/yr nominal throughput is planned after a minimum four-month outage in FY15, coincident with a DWPF melter change-out, to allow for ARP/MCU facility upgrades including: contactor bearings, weir adjustment, ARP filtration improvements (which could include an RMF installation in Tank 41), and throughput improvements
 - MCU decontamination factor for Cs-137 is 100–200 prior to NGS
 - Post-NGS decontamination factor will be greater than 200
- ARP/MCU Operations:
 - ARP/MCU will not operate during any DWPF melter replacement outages
 - a four-month ARP/MCU outage to rebuild contactors in every fourth year of operations after 2012
 - ARP/MCU will cease operations six months prior to SWPF start-up to allow for SWPF tie-ins
 - ARP/MCU will not return to operation after SWPF startup
- For each gallon processed, ~1.2 gallons of DSS is sent to SPF
- For each gallon processed, ~0.068 gallons of SE is sent to DWPF
- For each gallon processed, ~1.7 grams of MST is sent to DWPF
- DOE and SCDHEC will approve operation of ARP/MCU facilities to align with the SCDHEC previously approved date for SWPF startup
 - the total volume of waste may be increased from the present NDAA §3116 Basis
 - ARP/MCU facilities operate so as to ensure the total curies emplaced in SDF are within the amount identified in the *SRS LW Strategy*¹⁰ as amended by letter from the SCDHEC to DOE-SR¹¹ and the *Basis for Section 3116 Determination for Salt Waste Disposal at the Savannah River Site*⁷
- Any ARP/MCU facility upgrades required to maintain the ARP/MCU operating rate for its extended life will be provided.

ⁱ “Discrete canisters” refers to actual physical canisters (sometimes referred to as cans)

SCIX

- DOE approval will be required prior to the use of SCIX
- SCIX Processing of salt waste begins April 2019 at ~3 Mgal/yr (nominal rate) — this deployment date is extended due to funding limitations
- The average DSS stream resulting from the SCIX process will be consistent with the NDAA §3116 Basis Determination for Salt Waste Disposal at SRS.
- Annual processing throughput:
 - ~3 Mgal/yr processing rate
 - The 3 Mgal/yr is based on 100% availability for the Tank Farm feed as well as DWPF and SPF/DSS Tank receipt of SWPF discharge streams:
 - For each gallon processed, ~ 1 gallon of DSS is sent to SPF via Tank 50
 - For each gallon processed, ~ 8.1 grams of cesium-loaded ion exchange media is sent to DWPF via Tank 40
 - For each gallon processed, ~ 1.7 grams of MST is sent to DWPF via a sludge hub or sludge batch prep tank
- Tank Farm feed preparation infrastructure modifications are completed to support SCIX processing rates. Major modifications include:
 - H-Tank Farm blend tanks readiness for salt solution preparation
 - Tank 41 readiness as SCIX processing tank
 - Mixing capabilities
 - Enhanced transfer capabilities
 - Transfer routes provided to feed tank.

SWPF

- SWPF becomes operational September 30, 2018
 - SWPF tie-ins will require a four-month outage of DWPF operations and a two-month outage of SPF operations
- Annual processing throughput (*Long Term Processing Capacity at SWPF – Inputs to System Plan*²⁸)
 - Initial twelve months: 4.625 Mgal/yr processing rate
 - Second twelve months: 7.2 Mgal/yr nominal processing rate
 - The 7 Mgal/yr is based on 100% availability for the Tank Farm feed as well as DWPF and SPF/DSS Tank receipt of SWPF discharge streams
 - ~8.8 Mgal (nominal rate) of DSS will be sent to SPF per year
 - ~0.58 Mgal (nominal rate) of SE will be sent to DWPF per year
 - ~0.16 Mgal (nominal rate) of MST solids/sludge will be sent to DWPF per year
 - Subsequent years: 9.0 Mgal/yr nominal processing rate
(Note: these rates are based on the use of next generation solvent)
 - ~11.4 Mgal (nominal rate) of DSS will be sent to SPF per year
 - ~0.58 Mgal (nominal rate) of SE will be sent to DWPF per year
 - ~0.20 Mgal (nominal rate) of MST solids/sludge will be sent to DWPF per year
 - The SWPF feed chemistry is per SWPF Feed Specification Radionuclide Limits of the SWPF *Waste Acceptance Criteria*²⁹ including:
 - the initial one million gallons of feed to SWPF will be (at 6.44 M Na):
 - ≤ 1.0 Curies per gallon (Ci/gal)
 - all batches are planned to be at 6.44 M Na
 - additional blending may be required to meet other feed criteria, such as:
 - $\text{OH} > 2 \text{ M}$
 - Caustic (50% NaOH) additions are planned during salt dissolution and batch preparation, as needed to meet the minimum 2 M OH requirements
 - $\text{Al} < 0.25 \text{ M}$
 - $\text{Si} < 842 \text{ mg/L}$
- Tank Farm feed preparation infrastructure modifications required to support SWPF processing rates. Major modifications include:
 - H-Tank Farm Blend tanks readiness for salt solution preparation
 - F-Tank Farm Blend tanks readiness for salt solution preparation
 - Tank 49 readiness as SWPF feed tank
 - Mixing capabilities

- Enhanced transfer capabilities
- Transfer routes provided to feed tank.

6.7 Saltstone Production

SPF is capable of processing at a rate that supports other waste treatment operations as follows:

- During ARP/MCU operations:
 - May require operation of more than one cell and the use of “cold caps” to meet radiological control requirements
- During SWPF and SCIX operation:
 - SPF and SDF will support SWPF and SCIX processing rates
 - Additional operational time (i.e., multiple shifts, additional operating days each week, etc.) and adequate SDU receipt space to match production streams from SWPF and SCIX are planned
 - Modifications will provide sufficient contingency storage capacity to minimize impacts to SWPF, SCIX, or ETF due to SPF or SDF outages
- SPF will be in a 2-month outage just prior to SWPF operations for SWPF tie-ins
- Since neither ARP/MCU nor SWPF process during melter replacement outages, SPF is not planned to operate other than to run off any backlog material that may be in the feed tanks
- Three SDUs, Vault 1 and Vault 4 and SDU-2, are in service. Neither Vault 1 or Vault 4 are planned to receive additional saltstone grout:
 - Each gallon of DSS feed, when added to the cement, flyash, and slag, makes 1.76 gallons of grout
 - The next three SDUs (SDU-2, SDU-3, and SDU-5) will have two 150-foot diameter by 20-foot tall disposal cells. Each cell will contain ~2,300 kgal of grout. Therefore, each cell holds ~1,290 kgal of Tank 50-material feed solution; each SDU holds ~ 2,580 kgal of Tank 50-material feed solution
 - SDU-6–SDU-12 will be a single 375-foot diameter by 43-foot tall disposal cell which can contain 32 Mgal of grout. With the cold cap it will have a capacity of 30 Mgal of contaminated grout or 17.1 Mgal of Tank 50-material feed solution.

6.8 Base Operations

Evaporation

The primary influents into the Tank Farms are DWPF recycle and H-Canyon waste receipts. In addition, sludge batch preparation produces a large internal stream of spent washwater. In order to continue to maintain space in the Tank Farms to support these missions, these streams must be evaporated. There are two evaporators in H-Area and one in F-Area.

DWPF recycle has a high concentration of silica due to the vitrification process. When this stream is mixed with aluminum streams from PUREX and HM canyon processing, there is a potential for forming sodium aluminosilicate. Experience has shown that sodium aluminosilicate can co-precipitate sodium diuranate in the evaporator, causing a potential criticality concern. In order to prevent the potential for criticality, a feed qualification program is in place to minimize the formation of a sodium aluminosilicate scale in the 2F and 3H Evaporators and to prevent accumulation of enriched uranium in the 2H Evaporator. It is assumed that scale may accumulate in the 2H Evaporator, but uranium enrichments and masses will be well below criticality concerns.

- The 2H Evaporator System is used to evaporate DWPF recycle. The 2F and 3H Evaporators are used to process streams that will not produce scale, i.e., canyon wastes and sludge batch decants. The evaporator system feed and concentrate receipt tanks configuration is:
 - 3H: Feed – Tank 32; Receipt – Tanks 30 and Tank 37
 - 2H: Feed – Tank 43; Receipt – Tank 38
 - 2F: Feed – Tank 26; Receipt – Tank 25
- Evaporator Capacity – The following evaporator utilities and capacity were assumed based on historical experience.

Table 6-1 — Evaporator Utilities

Evaporator	Utility	Space Gain Capacity
2F	50%	150 kgal/mo
2H	50%	150 kgal/mo
3H	50% ^a	200 kgal/mo

- ^a 50% utility is assumed when operating. Due to periodic salt dissolutions and feed availability, average percentage of operating time is lower (<30%).

General Assumptions

- A minor influent is the 299-H Maintenance Facility. The influents mainly consist of a dilute nitric acid stream, decontamination solutions, and steam condensate. These waste streams are collected from decontaminating equipment and collected in the 299-H pump tank, neutralized and sent to Tank 39.
- Tank Farm infrastructure maintained to support SWPF, DWPF, and SPF processing rates and tank operational closure schedules.

Separations Canyon Operations

- Sufficient tank space volume is available to support the projected receipt of HLW into Tank 39 from H-Canyon operations through 2025. H-Canyon will transfer shutdown flows in 2026. LLW waste, mainly from the General Purpose Evaporator, dispositioned in SPF are received into Tank 50 and direct discards of Pu and neptunium materials to the DWPF feed system are received into Tank 40, or Tank 51, for which sufficient tank space volume is available.
- Shutdown flows for H-Canyon are assumed from 2026 and are as outlined in *H-Canyon Liquid Waste Generation Forecast for H-Tank Farm Transfer*³⁰.
- Additional material sent directly to sludge batches increases total DWPF canister count by as much as 100 canisters (these additional canisters are included in the 7,824 forecast canisters of this *Plan*):
 - Fissile isotope concentration of SRS HLW canisters will be maintained at or below 897 g/m³
 - Pu discards from H-Canyon will be supported to the extent allowable without negatively impacting planned canister waste loadings while continuing to comply with canister fissile material concentration limits.

Effluent Treatment Facility

- ETF is assumed to receive an average of 11 Mgal/yr:
 - LW Evaporators: 5 Mgal/yr
 - Savannah River Nuclear Solutions (SRNS) Facilities: 6 Mgal/yrNote: the Agreement between SRNS and SRR for LW Receipt Services provides that the total maximum allocation for waste generated from SRNS facilities including H-Canyon, F-Canyon, the Waste Solidification Building, Mixed Oxide Facility, and miscellaneous smaller contributors is 15 Mgal/yr.

Dismantlement and Decommissioning (D&D)

- LW Areas transferred to D&D on an Area-by-Area basis upon closure of their included facilities.

7. System Description

7.1 History

The LW System is the integrated series of facilities at SRS that safely manage the existing waste inventory and disposition waste stored in the tanks into a final glass or grout form. This system includes facilities for storage, evaporation, waste removal, pre-treatment, vitrification, and disposal.

Since it became operational in 1951, SRS, a 300-square-mile DOE Complex located in the State of South Carolina, has produced nuclear material for national defense, research, medical, and space programs. The separation of fissionable nuclear material from irradiated targets and fuels resulted in the generation of over 150 Mgal of radioactive waste. As of December 2012, approximately 37 Mgal³¹ of radioactive waste are currently stored onsite in large underground waste storage tanks at SRS. Most of the tank waste inventory is a complex mixture of chemical and radioactive waste generated during the acid-side separation of special nuclear materials and enriched uranium from irradiated targets and spent fuel using the Plutonium Uranium Reduction Extraction (PUREX) process in F-Canyon and the modified PUREX process in H-Canyon (HM process). Waste generated from the recovery of Pu-238 in H-Canyon for the production of heat sources for space missions is also included. The waste was converted to an alkaline solution; metal oxides settled as sludge, and supernate was evaporated to form saltcake.

The variability in both nuclide and chemical content is because waste streams from the 1st cycle (high heat) and 2nd cycle (low heat) extractions from each Canyon were stored in separate tanks to better manage waste heat generation. When these streams were neutralized with caustic, the resulting precipitate settled into four characteristic sludges presently found in the tanks where they were originally deposited. The soluble portions of the 1st and 2nd cycle waste were similarly partitioned but have and continue to undergo blending in the course of waste transfer and staging of salt waste for evaporative concentration to supernate and saltcake. Historically, fresh waste receipts were segregated into four general categories in the SRS Tank Farms: PUREX high activity waste, PUREX low activity waste, HM high activity wastes and HM low activity wastes. Because of this segregation, settled sludge solids contained in tanks that received fresh waste are readily identified as one of these four categories. Fission product concentrations are about three orders of magnitude higher in both PUREX and HM high-activity waste sludges than the corresponding low-activity waste sludges.

Because of differences in the material processed by PUREX and HM processes, the chemical compositions of principal sludge components (iron, aluminum, uranium, manganese, nickel, and mercury) also vary over a broad range between these sludges. Combining and blending salt solutions has tended to reduce soluble waste into blended salt and concentrate, rather than maintaining four distinct salt compositions. Continued blending and evaporation of the salt solution deposits crystallized salts with overlying and interstitial concentrated salt solution in salt tanks located in both Tank Farms. More recently, with transfers of sludge slurries to sludge washing tanks, removal of saltcake for tank removal from service, receipts of DWPF recycle, and space limitations restricting full evaporator operations, salt solutions have been transferred between the two Tank Farms. Intermingling of PUREX and HM salt waste will continue until high capacity salt waste processing can begin.

Continued long-term storage of these radioactive wastes poses a potential environmental risk. Therefore, since 1996, DOE and its contractor have been removing waste from tanks, pre-treating it, vitrifying it, and pouring the vitrified waste into canisters for long-term disposal in a permanent canister storage location (see *Figure 7-2 — Process Flowsheet*). As of December 31, 2012, DWPF had produced 3,560 vitrified waste canisters (see *Figure 7-3 — Liquid Waste Program — Current Status*).

7.2 Tank Storage

SRS has 51 underground waste storage tanks, all of which were placed into operation between 1954 and 1986. There are four types of waste tanks — Types I through IV. Type III tanks are the newest tanks, placed into operation between 1969 and 1986. There are 27 Type III tanks. Type I tanks are the oldest tanks, constructed in 1952 through 1953. Type II waste tanks were constructed in 1955 through 1956. There are eight Type IV tanks, constructed in 1958 through 1962. Four of these Type IV tanks, Tanks 17 through 20 in F-Tank Farm, have been isolated, removed from service, and grouted. Fourteen tanks without full secondary containment have a history of leakage³². As a result of program progress to date, of these 14 SRS tanks (all old-style tanks) with leakage history:

- 2 are operationally closed and grouted
- 2 are empty and cleaned

- 1 has been cleaned, pending further evaluation
- 1 has had bulk waste removed and is undergoing chemical cleaning later this year
- 1 has had BWRE completed
- 5 contain essentially dry waste, with little or no free liquid supernate
- 2 contain liquid supernate (at a level well below all known leak sites)

Of the remaining 10 old-style tanks (none of which have any known leakage history):

- 2 are operationally closed and grouted
- 2 contain essentially dry waste, with little or no free liquid supernate
- 6 contain liquid supernate.

When waste disposition began in 1996, the inventory of waste in the SRS tank system contained approximately 550 Million curies. Currently, 36.6 Mgal of radioactive waste, containing 294 million curies (MCi)³¹ of radioactivity, are stored in 45 active waste storage tanks located in two separate locations,



Salt waste is dissolved in the liquid portion of the waste. It can be in normal solution as Supernate (top picture) or, after evaporation, as salt cake (bottom picture) or concentrated supernate. The pipes in all the pictures are cooling coils.

frequently updated with new data from ongoing operations such as decanting and concentrating of free supernate via evaporators, preparation of sludge batches for DWPF feed, waste transfers between tanks, waste sample analyses, and influent receipts such as H-Canyon waste and DWPF recycle.




Tanks under construction. Note tank size relative to construction workers. Later, dirt is backfilled around the tanks to provide shielding.

H-Tank Farm (29 tanks) and F-Tank Farm (18 tanks). This waste is a complex mixture of insoluble metal hydroxide solids, commonly referred to as sludge, and soluble salt supernate. The supernate volume is reduced by evaporation, which also concentrates the soluble salts to their solubility limit. The resultant solution crystallizes as salts. The resulting crystalline solids are commonly referred to as saltcake. The saltcake and supernate combined are referred to as salt waste.

The sludge component of the radioactive waste represents approximately 3.0 Mgal (8% of total) of waste but contains approximately 138 MCi (47% of total). The salt waste makes up the remaining 33.6 Mgal (92% of total) of waste and contains approximately 156 MCi (53% of total). Of that salt waste, the supernate accounts for 17.9 Mgal and 144 MCi and saltcake accounts for the remaining 15.7 Mgal and 12 MCi³¹. The sludge contains the majority of the long-lived (half-life > 30 years) radionuclides (e.g., actinides) and strontium. The sludge is currently being stabilized in DWPF through a vitrification process that immobilizes the waste in a borosilicate glass matrix.


Radioactive waste volumes and radioactivity inventories reported herein are based on the Waste Characterization System (WCS) database, which includes the chemical and radionuclide inventories on a tank-by-tank basis. WCS is a dynamic database

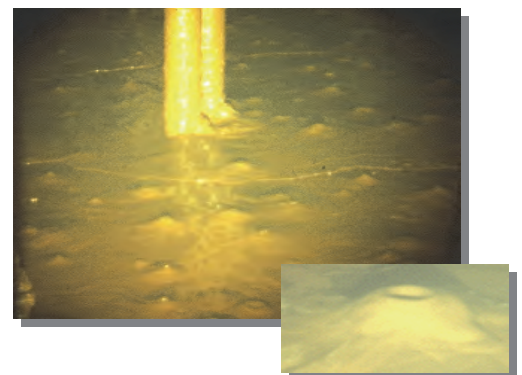

Sludge consists of insoluble solids that settle to the bottom of a tank. Note the offgas bubbles, including hydrogen generated from radiolysis.

Well over 95%³¹ of the salt waste radioactivity is short-lived (half-life ≤ 30 years) Cs-137 and its daughter product, Ba-137m, along with lower levels of actinide contamination. Depending on the particular waste stream (e.g., canyon waste, DWPF recycle waste), the cesium concentration may vary. The precipitation of salts following evaporation can also change the cesium concentration. The concentration of cesium is significantly lower than non-radioactive salts in the waste, such as sodium nitrate and nitrite, therefore, the cesium does not reach its solubility limit and only a small fraction precipitates³³. As a result, the cesium concentration in the saltcake is much lower than that in the liquid supernate and interstitial liquid fraction of the salt waste.

Figure 7-1 — Waste Tank Composite Inventory (as of December 31, 2012)³¹

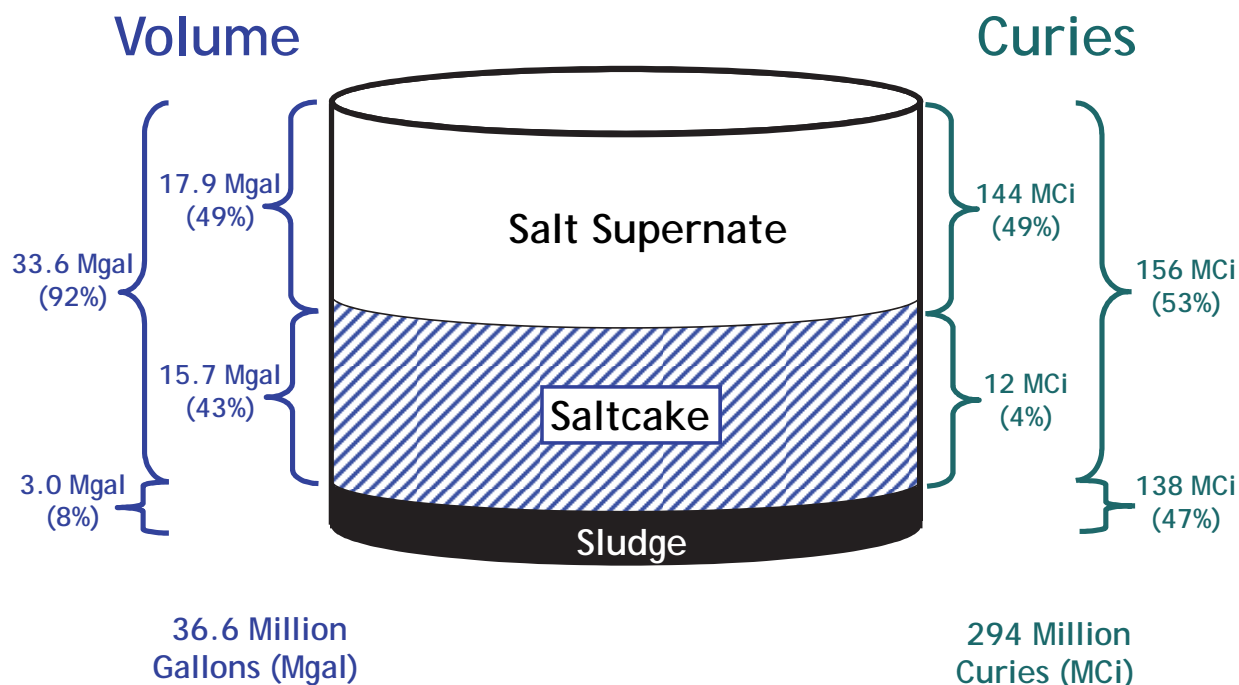

7.3 Waste Tank Space Management

To make better use of available tank storage capacity, incoming liquid waste is evaporated to reduce its volume. This is important because most of the SRS Type III waste storage tanks are already near full capacity. Since 1951, the Tank Farms have received over 150 Mgal of liquid waste, of which over 110 Mgal have been evaporated, leaving approximately 36.6 Mgal in the storage tanks. Projected available tank space is carefully tracked to ensure that the Tank Farms do not become “water logged,” meaning that so much of the usable Type III tank space has been filled that normal operations and waste removal and processing operations cannot continue. A contingency allotment of 1.3 Mgal is not included as working space. This amount is equivalent to the size of the largest tank and is reserved for the unlikely event that a full tank failed such that all its material had to be removed. Waste receipts and transfers are normal Tank Farm activities as the Tank Farms receive new or “fresh” waste from the H-Canyon stabilization program, liquid waste from DWPF processing (typically referred to as “DWPF recycle”), and wash water from sludge washing. The Tank Farms also make routine transfers to and from waste tanks and evaporators. Since initiation of interim salt waste treatment (DAA and ARP/MCU), the working capacity of the Tank Farms has been maintained. Three evaporator systems are currently operating at SRS — the 2H, 3H, and 2F systems.

Space in new-style tanks is used for various operations for waste processing and disposal. Tank space is recovered through evaporator operations, DWPF vitrification, ISDP Treatment, and saltstone disposal. This valuable space has been used to: (1) retrieve waste from and clean old-style tanks; (2) prepare, qualify, and treat sludge waste for disposal; (3) prepare, qualify, treat, and dispose salt waste; and (4) support nuclear materials stabilization and disposal through H-Canyon. The Tank Farm space management strategy is based on a set of key assumptions involving projections of DWPF canister production rates, influent stream volumes, Tank Farm evaporator

performance, and space gain initiative implementation. The processing of salt and sludge utilizes new-style tank space to retrieve and prepare waste from old-style tanks, and therefore nominal empty space in new-style tanks will increase only after all waste in old-style tanks is processed. Sludge processing through the DWPF removes the highest risk material from the old-style tanks. However, for every 1.0 gallon of sludge processed, 1.3 gallons of salt waste is formed due to sludge washing and DWPF processing operations to return the resulting low hazard salt waste to the tank farm. Similarly, salt waste retrieval, preparation, and batching typically require the use of 4 gallons of tank space per gallon of salt waste treated. Given these parameters, the “key to reducing the overall risk is processing high-level waste as expeditiously as possible and managing the total tank space efficiently,” as recognized by the DNFSB letter dated January 7, 2010.

New-style tank space is a currency used to prepare for permanent immobilization and disposition of high level waste in a vitrified waste form and low-level waste in a grouted waste form. Additionally, some “old-style” tanks (e.g., Tank 21–Tank 24) support immobilization and disposition of high-level waste. The tank space management program maintains sufficient space to allow continued DWPF operations. The tank space management program also provides the necessary tank space to support staging of salt solutions to sustain salt waste disposition currently through ARP/MCU and subsequently through SWPF and SCIX. Of the 27 new-style tanks (with a total nominal volume of 35.1 million gallons) in the SRS Liquid Waste System:

- 5 are dedicated to salt batching, qualification, and disposition (including DWPF recycle beneficial reuse and 2H evaporator)
- 6 are dedicated to sludge batching, qualification, and disposition (including 3H evaporator)
- 3 are dedicated to waste retrieval from and residual cleaning of old-style tanks in preparation for operational closure
- 1 is dedicated to uninterrupted H-Canyon waste receipts
- 12 are dedicated to safe storage of legacy liquid waste pending retrieval and disposition.

There are currently ~6.8 million gallons (Mgals) of empty space (~19%) in these new-style tanks.

- 3.0 Mgals is margin as defense-in-depth operational control coupled with SC/SS SSCs to facilitate reasonably conservative assurance of more than adequate dilution and ventilation of potentially flammable vapors
- 1.3 Mgals is procedurally-required minimum contingency space for recovery from the unlikely event of a bulk waste leak elsewhere in the system
- 2.5 Mgals is operational “working” space variously used to provide:
 - Additional contingency transfer space as operational excess margin above the procedurally-required minimum
 - Excess margin to preserve salt batch quality and maintain uninterrupted treatment and disposition through ARP/MCU and Saltstone
 - Excess margin to preserve sludge batch quality and maintain uninterrupted immobilization through DWPF
 - Excess margin to preserve uninterrupted support for H-Canyon.


7.4 Waste Removal from Tanks

The first step in the disposition of sludge and salt waste is bulk waste removal efforts (BWRE). Sludge is sent to a feed preparation tank ensuring sludge waste is continuously available for treatment at DWPF. Salt is dissolved, removed, and staged for treatment at ARP/MCU, SCIX, or SWPF.

To reduce the two-to-four year period required for installation of substantial structural steel and large mixing and transfer pumps — with their attendant infrastructure — required for BWRE, a Waste on Wheels (WOW) innovation was developed. The WOW concept minimizes new infrastructure. Portable and temporary equipment meet tank infrastructure needs. Additional purchased pumps and WOW equipment perform accelerated BWRE operations concurrently in both Tank Farms. The primary components of the WOW system are:

- Long-lasting reusable SMPs
- A portable field operating station containing pump drives and controls
- A portable substation to provide 480-, 240- and 120-volt power to the WOW equipment
- Disposable commercial transfer pumps.

WOW equipment is deployed at the tank as a field operating station, providing temporary power and control for BWRE equipment. When BWRE is completed on one tank, the WOW equipment is reconfigured to support waste removal on the next tank. Pumps are sized to fit through 24-inch openings allowing a high degree of flexibility to locate the pumps in optimal configurations within the waste tanks. Most are supported from the bottom of the tank, minimizing steel superstructures and tank-top loading. Product lubricated bearings and motor cooling eliminate the need for bearing and seal water supply. These pumps have exterior fittings and fixtures so that the pumps can be quickly decontaminated, removed, and reinstalled in the next tank with minimal radiation exposure to personnel. Disposable transfer pumps are used to transfer the waste to a receipt or hub tank using existing underground transfer lines and diversion boxes. If the transfer system is degraded or non-existent, above-grade hose-in-hose technology is deployed, rather than investing in costly repairs. Temporary shielding is supplied as necessary to reduce exposure to personnel.

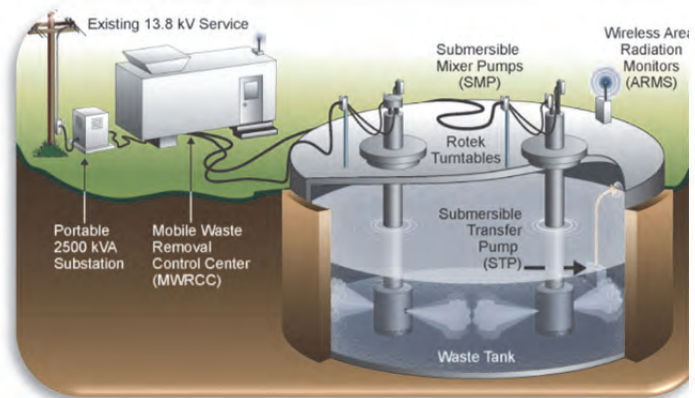

WOW Deployment for BWRE

Disposable transfer pumps are used to transfer the waste to a receipt or hub tank using existing underground transfer lines and diversion boxes. If the transfer system is degraded or non-existent, above-grade hose-in-hose technology is deployed, rather than investing in costly repairs. Temporary shielding is supplied as necessary to reduce exposure to personnel.

7.5 Safe Disposal of the Waste

The goal is to convert all of the waste into one of two final waste forms: Glass, which will contain 99% of the radioactivity, and Saltstone Grout, which will contain most of the volume. Each of the waste types at SRS needs to be treated to accomplish disposal in these two waste forms. The sludge must be washed to remove non-radioactive salts that would interfere with glass production. The washed sludge can then be sent to DWPF for vitrification. The salt must be treated to separate the bulk of the radionuclides from the non-radioactive salts in the waste. Starting in 2018, this separation will be accomplished in SWPF with SCIX supplementing this separation in 2019. However, until the startup of SWPF and SCIX, ARP/MCU accomplishes this separation.

7.6 Salt Processing

Five different processes treat salt:

- **Deliquification, Dissolution, and Adjustment (DDA)** – Deliquification (i.e., extracting the interstitial liquid) is an effective decontamination process because the primary radionuclide in salt is Cs-137, which is highly soluble. To accomplish the process, the salt was first deliquified by draining and pumping. The deliquified salt was then Dissolved by adding water and pumping out the salt solution. The resulting salt solution was aggregated with other Tank Farm waste to Adjust batch chemistry for processing at SPF. For salt in Tank 41 as of June 9, 2003, which was relatively low in radioactive content, treatment using DDA-solely was sufficient to meet the SPF WAC. Tank 41 has since received additional salt dissolution from Tank 25 and there is no longer any qualified feed for the DDA-solely process. No further use of DDA-solely is planned.
- **Actinide Removal Process (ARP)** – For salt in selected tanks (e.g., Tank 25), even though extraction of the interstitial liquid reduces Cs-137 and soluble actinide concentrations, the Cs-137 or actinide concentrations of the resulting salt are too high to meet the SPF WAC. Salt from these tanks first will be sent to ARP. In ARP, MST is added to the waste as a finely divided solid. Actinides are sorbed on the MST and then filtered out of the liquid to produce a low-level waste stream that is sent to MCU. The MST, containing the actinides, is sent to DWPF.
- **Modular CSSX Unit (MCU)** – The ARP low-level waste stream requires reduction in the concentration of Cs-137 using the CSSX process. MCU is a solvent extraction process for removal of Cs-137 from caustic salt solutions. The solvent used is a four-part solvent with the key ingredient being the cesium extractant (presently BoB Calix). This solvent is fed to a bank of centrifugal contactors while the waste is fed to the other end in a counter-current flow. The solvent extracts the cesium with each successive contactor stage extracting more, resulting in a DSS stream and a cesium-laden solvent stream. The solvent stream is stripped of its cesium, washed, and the solvent is reused. The cesium-laden strip effluent is transferred to DWPF. MCU has a dual purpose:


- demonstrating the CSSX flowsheet
 - treating salt waste to enable accelerated closure of Type I, II, and IV tanks and uninterrupted vitrification of HLW at DWPF.
- **Small Column Ion Exchange (SCIX)** – This planned process will use a non-elutable ion exchange media, crystalline silicotitanate (CST), for use in an ion exchange column (IXC) to remove Cs-137 from the salt solution. Ground CST, laden with Cs-137, is then transferred to a sludge batch for ultimate disposal at DWPF. The DSS stream will be dispositioned at SPF. The MST solids will be transferred to a sludge batch preparation tank for ultimate disposal at DWPF.
 - **Salt Waste Processing Facility (SWPF)** – This is the full-scale CSSX process. This planned facility will incorporate both the ARP and CSSX processes in a full-scale shielded facility capable of handling salt with high levels of radioactivity.

7.7 Sludge Processing

Sludge is washed to reduce the amount of non-radioactive soluble salts remaining in the sludge slurry. During sludge processing, large volumes of wash water are generated and must be volume-reduced by evaporation or beneficially reused. Over the life of the waste removal program, the sludge currently stored in tanks at SRS will be blended into separate sludge batches to be processed and fed to DWPF for vitrification.


7.8 DWPF Vitrification

Final processing for the washed sludge and salt waste occurs at DWPF. This waste

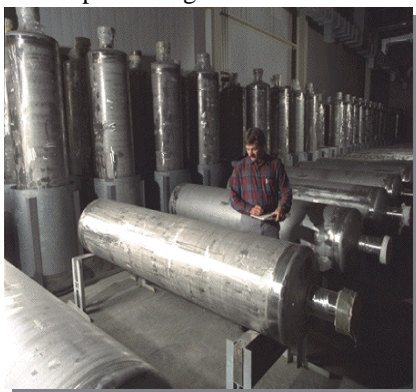

Canisters being received (prior to being filled with radioactive glass)

includes MST/sludge from ARP or SWPF, the cesium strip effluent from MCU or SWPF, and the washed sludge slurry. In a complex sequence of carefully controlled chemical reactions, this waste is blended with glass frit and melted to vitrify it into a borosilicate glass form. The resulting molten glass is poured into stainless steel canisters. As the filled canisters cool, the molten glass solidifies, immobilizing the radioactive waste within the glass structure. After the canisters have cooled, they are first sealed with a temporary plug, the external surfaces are decontaminated to meet United States Department of Transportation requirements, and the canister is then permanently sealed. The canisters are then ready to be stored on an interim basis on-site. Additional glass waste storage space will be needed by December 2016. A low-level recycle waste stream from DWPF is returned to the Tank Farms. DWPF has been operational since 1996.



Sample of Vitrified Radioactive Glass

7.9 Saltstone Disposition

The Saltstone Facility, located in Z-Area, consists of two facility segments: the Saltstone Production Facility (SPF) and the Saltstone Disposal Facility (SDF). SPF is permitted as a wastewater treatment facility per SCDHEC regulations. SPF receives and treats the salt solution to produce grout by mixing the LLW liquid stream with cementitious materials (cement, flyash, and slag). A slurry of the components is pumped into the SDUs, located in SDF, where the Saltstone grout solidifies into a monolithic, non-hazardous, solid LLW form. SDF is permitted as an Industrial Solid Waste Landfill site.



Future salt waste processing will impose significantly greater production demands. After SWPF startup, feed of decontaminated salt solution to the SPF could reach as high as 12.8 Mgal/year. In anticipation of this future demand,

SRS recently completed a planned production outage to support installation of Enhanced Low Activity Waste Disposal (ELAWD) improvements. The recent ELAWD Phase 1 improvements included:

- Redesign of the grout hopper (greater capacity) to increase operating margin. Redesign included a hopper agitator, upgrades to the hopper flush system, and provided capability of flushing the system upstream of the grout pump to minimize effects from a process control anomaly.
- Replacement of the existing mixer with an “off-the-shelf-mixer” and procurement of a spare mixer to improve both reliability (new mixer) and availability (direct replacement).
- Replacement of the existing obsolete four-way pig valves and mounting pedestal for the grout feed line.
- Redesign of associated piping, with proper slopes, including installation of an additional pulsation dampener and Y-pipe on the existing grout pump to accommodate the new equipment.
- Power/air supply and instrumentation to operate, control, and monitor Mixing and Transfer System equipment.
- Software modifications to support new equipment operations.

Also, during the ELAWD Phase 1 outage, the Mixing and Transfer System was modified to connect SPF to SDU-2.

- Currently, the Savannah River Site (SRS) Saltstone Processing Facility (SPF) production capability greatly exceeds the influent streams from the Modular Caustic-Side Solvent Extraction Unit (MCU), Effluent Treatment Project (ETP), and H Canyon. During the interim period until SWPF startup, SPF will operate in an alternating operating – maintenance/outage campaign mode. The typical flow of this operating plan will be a repeating cycle of approximately 2 months of virtually continuous daily operation followed by approximately 3 months of maintenance/outage downtime to allow Tank 50 to re-fill.
- This operating strategy allows facility equipment to be “stressed” and facility reliability to be evaluated at conditions that more closely approximate the higher capacities that will be experienced by SPF when SWPF comes on line.

ELAWD Phase 2 will modify the dry feeds system and connect SPF to new larger capacity salt solution feed receipt tanks. Lastly, modifications that support converting from the present day shift staffing to 24/7 operations are planned to be completed prior to SWPF startup.

The current operating plan allows the ELAWD Phase 2 reliability modifications to be implemented without impacting interim salt waste treatment or Saltstone production. The SPF facility will be evaluated throughout all of the operating campaigns. This operating plan will culminate in one final high capacity sprint demonstration run after all reliability mods are completed.

The facility will contain many large concrete SDUs. Each of the SDUs will be filled with solid Saltstone grout. The grout itself provides primary containment of the waste, and the walls, floor, and roof of the SDUs provide secondary containment.

Approximately 15 feet of overburden were removed to prepare and level the site for SDU construction. All SDUs will be built at or slightly below the grade level that exists after the overburden and leveling operations are complete. The bottom of the Saltstone grout monoliths will be at least five feet above the historic high water table beneath the Z-Area site, thus avoiding disposal of waste in a zone of water table fluctuation. Run-on and runoff controls are installed to minimize site erosion during the operational period.

An existing SDU (Vault 4) is approximately 200 feet wide by 600 feet in length by 26 feet in height, divided into twelve cells. One other existing SDU (Vault 1) is approximately 100 feet wide by 600 feet in length by 25 feet in height, divided into six cells. Neither is planned for use in emplacing contaminated grout.

SDU-2, SDU-3, and SDU-5, of which SDU-2 is currently in use, are two cells, nominally 150 feet diameter by 22 feet high each. This design is used commercially for storage of water. After accounting for interior obstructions (support columns, drainwater collection systems, etc.) and the requirement for a 2-foot cold cap, the nominal useable volume of a cell is 2,300 kgal. Recent operating experience has resulted in approximately 1.76 gallons of grout being produced for each gallon of DSS feed, yielding a nominal cell capacity of approximately 1,290 kgal of DSS.

For this *Plan*, it is assumed in future years that SDU-6 through SDU-12 will be a 375-foot diameter 43-foot tall single-cell design. The vaults will hold 30 Mgal of contaminated grout or 17.1 Mgal of DSS feed. SDU-6 is needed by July 2015.

Closure operations will begin near the end of the active disposal period in the SDF, i.e., after most or all of the SDUs have been constructed and filled. Backfill of native soil will be placed around the SDUs. The present closure concept

includes two moisture barriers consisting of clay/gravel drainage systems along with backfill layers and a shallow-rooted bamboo vegetative cover.

Construction of the SDF and the first two SDUs was completed between February 1986 and July 1988. The SDF started radioactive operations June 12, 1990. SDU-2 began filling in September 2012. SDU-3 and SDU-5 are planned to begin filling in October 2013. Future SDUs will be constructed on a “just-in-time” basis in coordination with salt processing production rates.



Figure 7-2 — Process Flowsheet


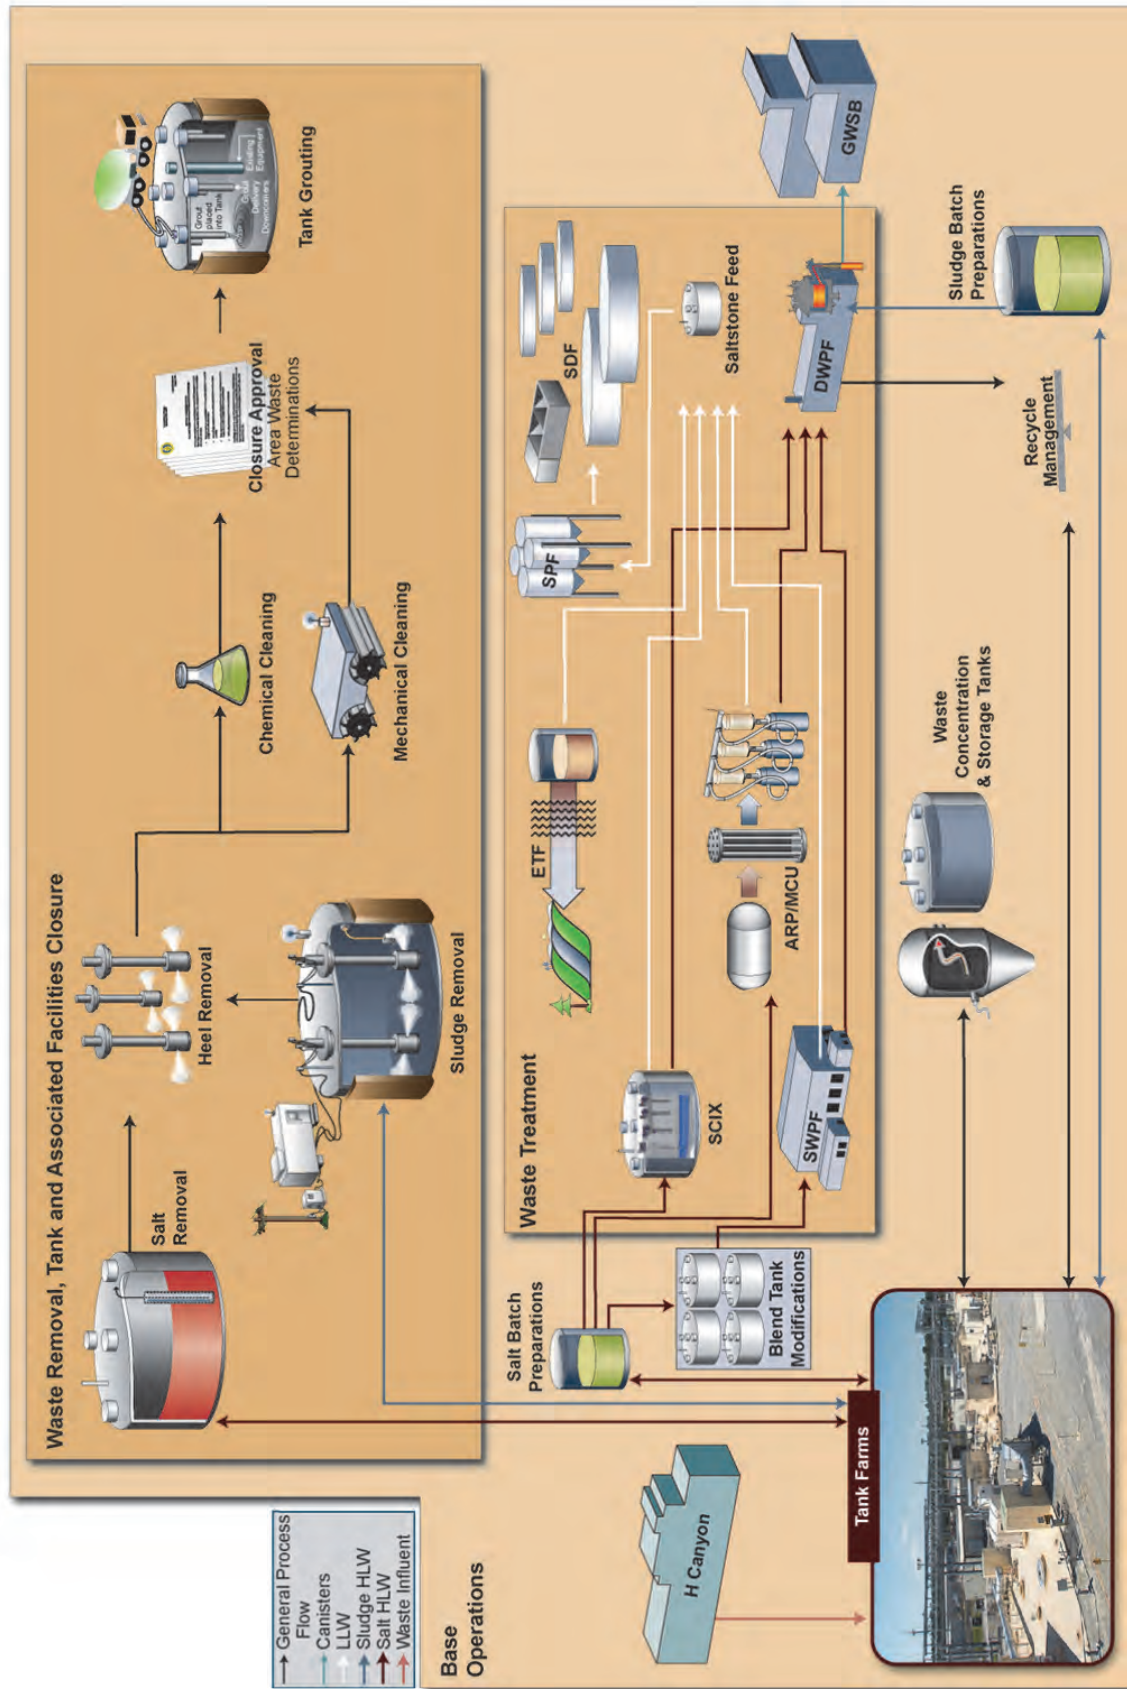


Figure 7-3 — Liquid Waste Program — Current Status

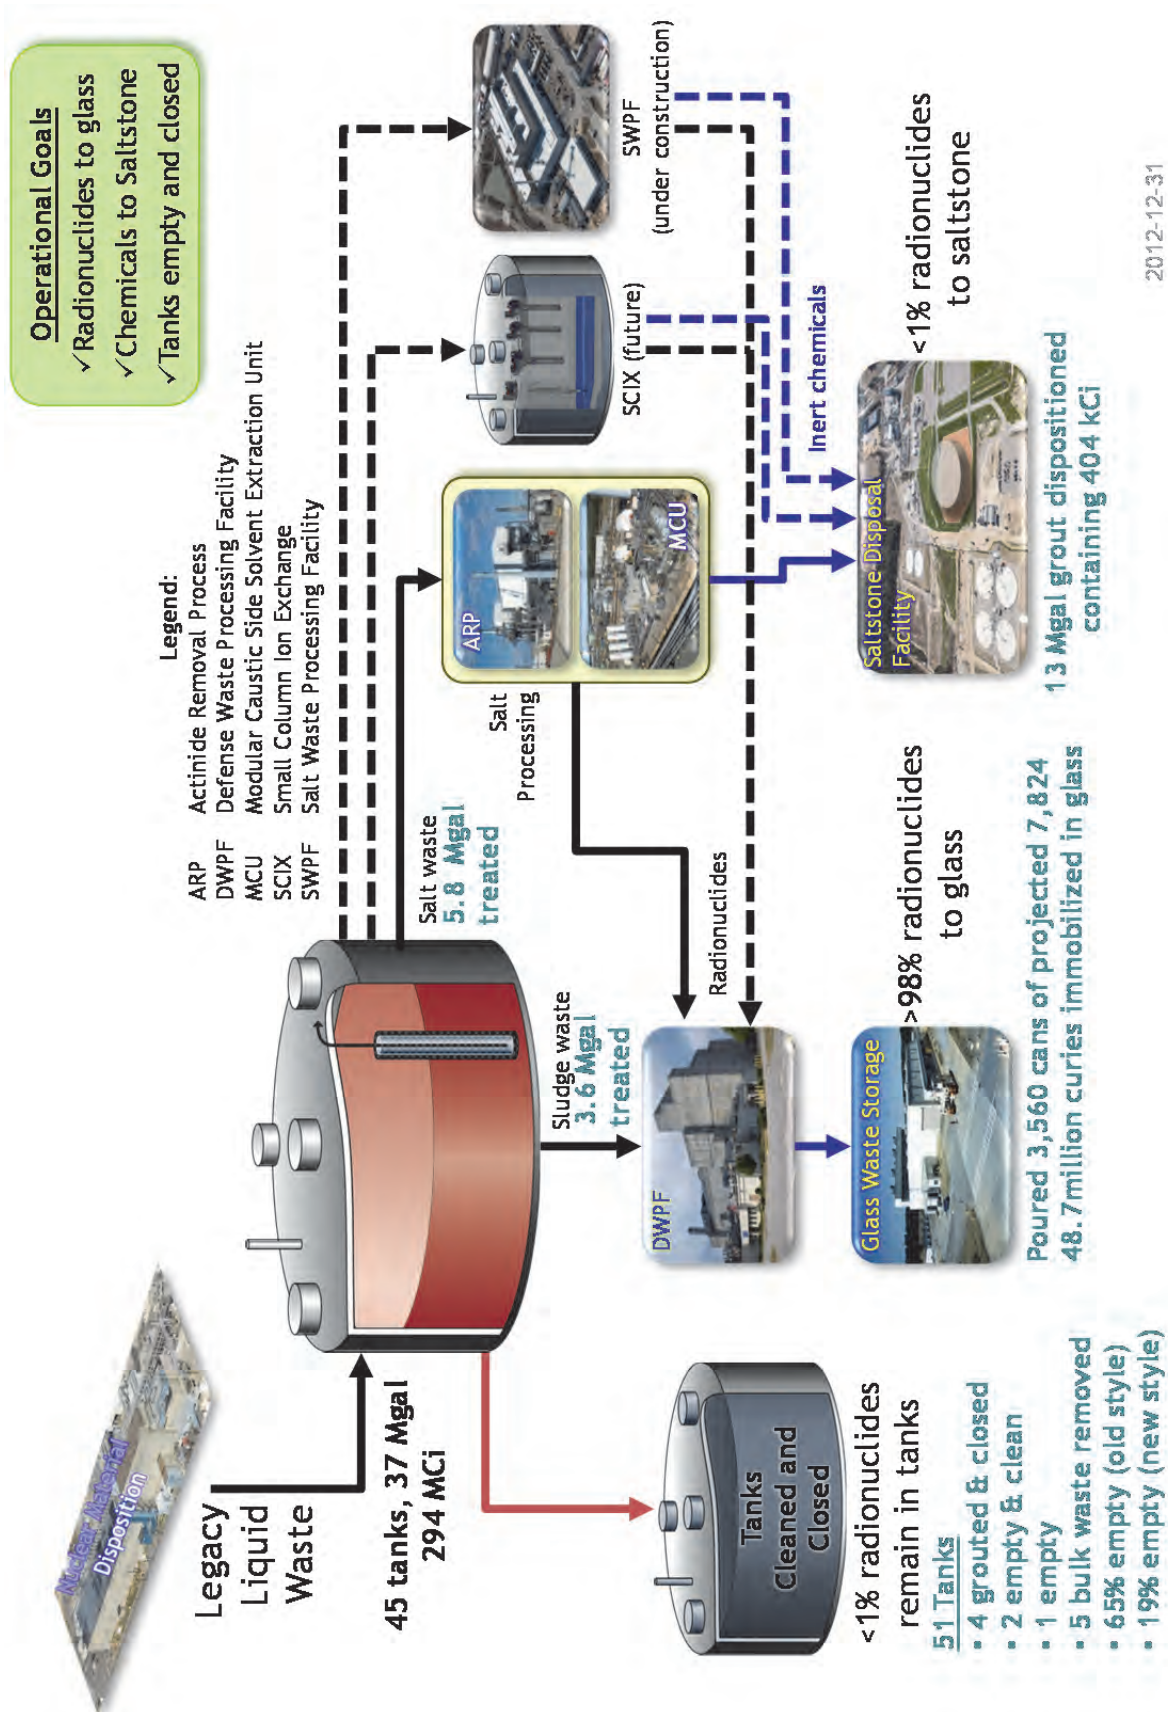

Appendix A — Salt Solution Processing, Base Case

End of Fiscal Year	Salt Solution (kgal)					to Tank 50 (kgal)			SDU Numbers ^c	
	DDA-solely	ARP/MCU	SCIX	SWPF	Total ^a	DSS	LLW ^b	ETF		Total
Total as of end of FY10	2,800	990			3,790	3,151	682	3,019	6,492	4
FY11		1,063			1,063	1,487	200	64	1,751	4
FY12		702			702	901	19	24	1,251	4 & 2
FY13		1,401			1,401	1,778	18	120	1,916	2
FY14		2,581			2,581	3,275	18	120	3,413	3 & 5
FY15		2,451			2,451	3,111	18	120	3,249	3-6
FY16		4,743			4,743	6,019	18	120	6,157	6
FY17		4,730			4,730	6,003	18	120	6,141	6
FY18		2,411			2,411	3,059	18	120	3,197	6
FY19			840	4,625	5,465	6,709	18	120	6,847	6-7
FY20			2,940	7,200	10,140	12,077	18	120	12,215	7-8
FY21			2,940	9,000	11,940	14,361	18	120	14,499	8
FY22			2,940	9,000	11,940	14,361	18	120	14,499	8-9
FY23			2,100	6,000	8,100	9,714	18	120	9,852	9-10
FY24			2,940	9,000	11,940	14,361	18	120	14,499	10-11
FY25			2,940	9,000	11,940	14,361	18	120	14,499	11-12
FY26			2,940	7,200	10,140	12,077	18	105	12,200	12
FY27			2,940		2,940	2,940		105	3,045	12
FY28			600		600	600		45	645	12
FY29					0	0		30	30	12
Total	2,800	21,073	24,120	61,025	109,018	130,345	1,153	4,951	136,396	12

^a Total Salt Solution from Tank Farms is a total of all LLW sent directly from the Tank Farm and all salt solution treated via the DDA-solely, ARP/MCU, SCIX, and SWPF processes. Each gallon of salt solution treated via ARP/MCU and SWPF yields ~1.3 gallons of DSS; SCIX yields ~1 gallon.

^b Low Level Waste receipts to Tank 50 are described in Appendix E — Tank Farm Influent and Effluents

^c SDU-1 and SDU-4 are no longer planned to receive contaminated grout.

- SDU-2, SDU-3, and SDU-5 have two ~2.3-Mgal cylindrical cells, each capable of receiving ~1.3 Mgal of Tank 50 DSS. SDU 3 and 5 were installed and will be filled together to allow filling multiple cells
- Beginning with SDU-6, the SDU will consist of a single 30 Mgal cylindrical cell, capable of receiving ~17 Mgal of DSS
- Each gallon of Tank 50 feed, when added to the cement, flyash, and slag, generates approximately 1.76 gallons of grout
- Bleed water recycling consumes 5% of the vault space, reducing the available space for feed solution.

Note Dates, volumes, and chemical or radiological composition information are planning approximations only.

Appendix B — Sludge Processing

Sludge Batch	Source Tanks ^a	Projected SOL (weight %)	Canister Production Rates (Cans/Year)	Actual Cans @ Projected SOL	Date Batch Finished @ Projected SOL ^b
Actual canisters poured through September 30, 2012:				3,528	
SB7B (to completion)	4, 7, 12	36%	275	95	Mar 2013
SB8	12 Heel Removal & 13	36%	275	387	Jun 2014
SB9	12 Chemical Cleaning & 13	36%	275	184	Feb 2015
DWPF Melter Replacement March 2015 thru June 2015					
SB9 (to completion)	(cont'd)	40%	275	161	Jan 2016
SB10	15 (via 13), 33 & 41 (MST Solids)	40%	275	345	Apr 2017
SB11	11, 15, 33 (via 13), & 35	40%	275	299	May 2018
SWPF Tie-In Outage June 2018 thru September 2018					
SB11 (to completion)	(cont'd)	40%	275	46	Nov 2018
SB12 (LTAD)	35 (LTAD), 14, 26, 33 BWR, HR, & CC (via 13), 41 (MST Solids)	40%		161	Jun 2019
SCIX Startup (Start of CST Resin to Tank 40) April 2019					
SB12 (LTAD) (to completion)	(cont'd) + CST Resin	40%	275	184	Feb 2020
SB13 (LTAD)	11, 15, 26, 33, 34 (via 13), 35, 39 (LTAD), 41 (MST Solids), CST Resin	40%	275	345	May 2021
SB14 (LTAD)	32, 35, 39 (LTAD), 47, 13 HR, CC, 41 (MST Solids), CST Resin	40%	275	345	Aug 2022
SB15 (LTAD)	32, 39 (LTAD — via 35), 43, 47, 9 Heel via 35, 41 (MST Solids), CST Resin	40%	275	138	Feb 2023
DWPF Melter Replacement March 2023 thru June 2023					
SB15 (LTAD) (to completion)	(cont'd)	40%	275	207	Mar 2024
SB16 (LTAD)	32, 35, 39 (LTAD), 43, 47, 9 Heel (via 35), 41 (MST Solids), CST Resin	40%	275	345	Jun 2025
SB17	32, 35, 39; 14, 15, 26, 33 (via 13), 41 (MST Solids), CST Resin	40%	275	345	Sep 2026
HB18 ^c	1, 2, 3, 4, 8 HR (via 7); 4 & 8 CC (via 7); 7 HR & CC (via 47); 22, 23 & 24 BWR (via 35); 41 (MST Solids); CST Resin	32%	168	211	Dec 2027
HB19	27 & 28 HR (via 47); 30 HR (via 35); 32, 35, 39; 14, 15, 26, 33 (via 13); 41 (MST Solids), CST Resin	32%	147	184	Mar 2029
HB20	25 & 34 HR & 34 HR (via 47); 29, 31, 38, 41 HR (via 35); Tk 32, 39, 47 CC (via 35); 41 (MST Solids), CST Resin	32%	118	147	Jun 2030
HB21	29, 32, 35, 38, 39, 41, 42, 43, 47 HR (via 35); 32, 39, 43, 42, 47 CC (via 35); 26, 33 HR & CC (via 47 & 35); Tk 41 (MST Solids), CST Resin	32%	133	167	Sep 2031
Total Canisters Produced:				7,824	

^a The indicated tanks are the sources of the major components of each sludge batch, not necessarily the sludge location just prior to receipt for sludge washing. Tanks 7 and 13, for example, are also used to stage sludge that is removed from other tanks.

^b Dates are approximate and represent when Tank 40 gets to a 40" heel. Actual dates depend on canister production rates.

^c Lower production rate assumed for dilute heel processing; Heel Batches 18 through 21 will process tank heels, salt insolubles, and oxalates

Note: Dates, volumes, and chemical or radiological composition information are planning approximations only.

Appendix C — Canister Storage

End of Fiscal Year	SRS Cans Produced		SRS Cans in GWSB #1 (2,251 capacity) ^a		SRS Cans in GWSB #2 (2,339 capacity) ^b		SRS Cans in Supplemental Storage ^c	
	Yearly	Cum.	Added	Cum.	Added	Cum.	Added ^d	Cum.
FY96	64	64	64	64				
FY97	169	233	169	233				
FY98	250	483	250	483				
FY99	236	719	236	719				
FY00	231	950	231	950				
FY01	227	1,177	227	1,177				
FY02	160	1,337	160	1,337				
FY03	115	1,452	115	1,452				
FY04	260	1,712	260	1,712				
FY05	257	1,969	257	1,969				
FY06	245	2,214	244	2,213	1	1		
FY07	160	2,374	28	2,241	132	133		
FY08	225	2,599		2,241	225	358		
FY09	196	2,795		2,241	196	554		
FY10	192	2,987	3	2,244	183	737		
FY11	264	3,251		2,244	260	997		
FY12	277	3,528		2,244	277	1,269		
FY13	275	3,803		2,244	275	1,544		
FY14	276	4,079		2,244	276	1,820		
FY15	184	4,263		2,244	184	2,004		
FY16	276	4,539		2,244	276	2,280		
FY17	276	4,815		2,244	59	2,339	217	217
FY18	184	4,999		2,244		2,339	184	401
FY19	276	5,275		2,244		2,339	276	677
FY20	276	5,551		2,244		2,339	276	953
FY21	276	5,827		2,244		2,339	276	1,229
FY22	276	6,103		2,244		2,339	276	1,505
FY23	184	6,287		2,244		2,339	184	1,689
FY24	276	6,563		2,244		2,339	276	1,965
FY25	276	6,839		2,244		2,339	276	2,241
FY26	276	7,115		2,244		2,339	276	2,517
FY27	169	7,284		2,244		2,339	169	2,686
FY28	153	7,437		2,244		2,339	153	2,839
FY29	132	7,569		2,244		2,339	132	2,971
FY30	122	7,691		2,244		2,339	122	3,093
FY31	133	7,824		2,244		2,339	133	3,226
FY32		7,824		2,244		2,339	15	3,241

Numbers in italics are actuals – through FY11. FY12 and on are forecast based on modeling assumptions

^a GWSB #1 filling began in May 1996. Of 2,262 standard canister storage locations, 8 are unusable and 3 store non-radioactive archive canisters yielding a usable storage capacity of 2,251 standard canisters; 7 are contingency positions for placement of canisters if GWSB #2 is temporarily unavailable. It reached its maximum capacity in FY07.

^b GWSB #2 was built with 2,340 standard storage locations. One archived non-radioactive canister is stored in GWSB #2 yielding a usable storage capacity of 2,339 standard canisters. GWSB #2 received its first radioactive canister in June 2006. It is expected to reach maximum capacity in FY17.


^c This *Plan* assumes supplemental canister storage is available in early FY17.

^d Typically, five to ten canisters are in the vitrification building pending transfer to canister storage. All cans will be transferred to canister storage before the DWPF is cleaned and flushed.

Note: Dates, volumes, and chemical or radiological composition information are planning approximations only.


Appendix D — BWRE & Removal from Service, Base Case

Bulk Waste Removal Efforts

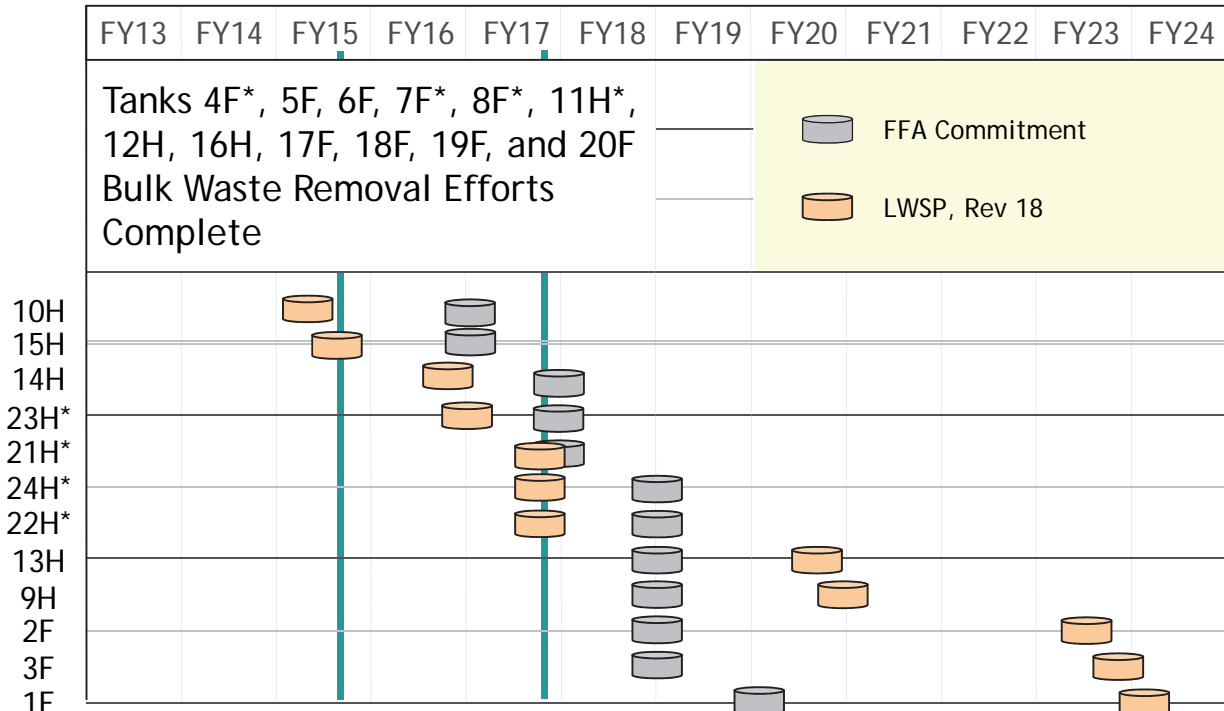

* These tanks are planned for continued usage after the BWRE milestones are complete. EPA and SCDHEC concurred with the continued use of Tank 8, 7 and 11. Tanks 4, 7, and 8 are under discussion for expanded continued use. Tanks 21–24 will be reviewed with SCDHEC and EPA at the appropriate time.

Tank Removal from Service

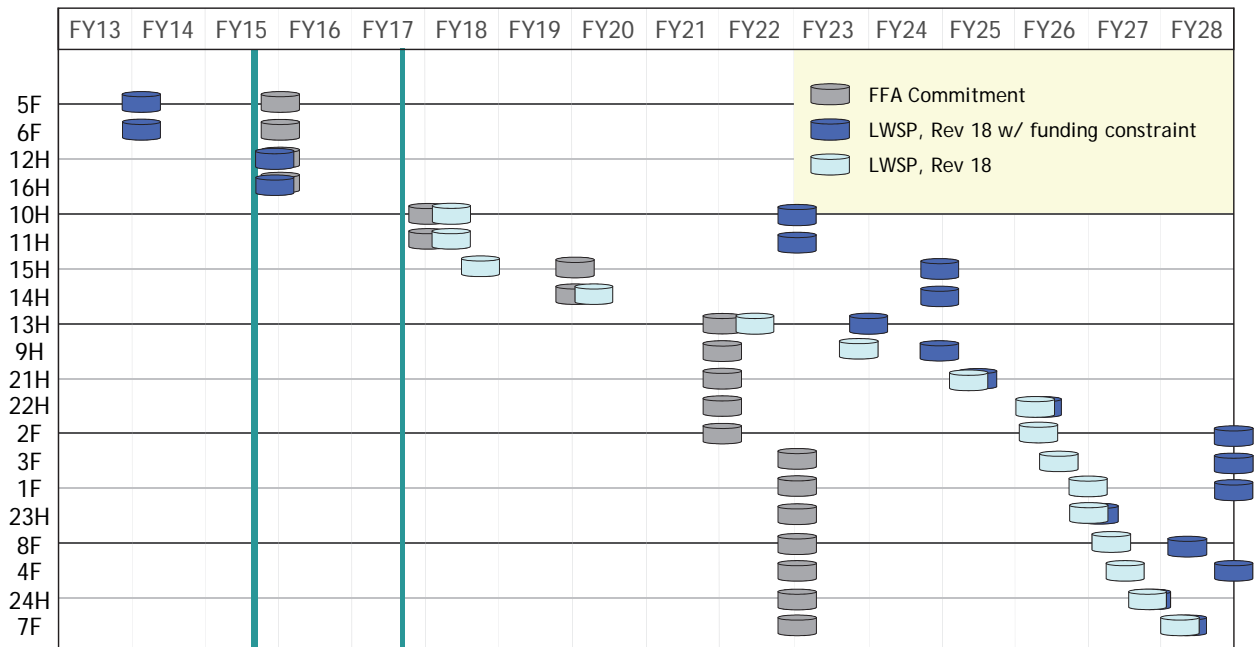


Appendix E — Tank Farm Influent and Effluents

End of Fiscal Year	Influent (kgal)										Effluent (kgal)			Total Inventory ^e
	LW	Hi-Canyon ^a		Other Mat'l ^p	DWWP Recycle ^c	299-H	ETF	DSS to SPF	Sludge to DWWP		Total Inventory ^e			
		LLW	18						DSS to SPF	DSS to SPF				
FY13	300	18	10	1,912	12	120	1,916	363			35,687			
FY14	300	18	-	2,049	12	120	3,413	354			34,113			
FY15	300	18	-	1,520	12	120	3,249	254			33,382			
FY16	300	18	-	2,213	12	120	6,157	420			30,061			
FY17	300	18	-	2,213	12	120	6,141	420			26,860			
FY18	300	18	-	1,448	12	120	3,131	284			26,124			
FY19	300	18	-	2,401	12	120	6,847	397			22,941			
FY20	300	18	-	2,650	12	120	12,215	384			21,542			
FY21	300	18	-	2,823	12	120	12,215	375			18,373			
FY22	300	18	-	2,823	12	120	15,007	375			14,264			
FY23	300	18	-	2,060	12	120	9,852	254			10,866			
FY24	300	18	-	2,823	12	120	15,007	380			8,740			
FY25	300	18	-	2,823	12	120	15,007	381			6,050			
FY26	195	18	-	2,622	12	105	12,581	389			3,357			
FY27	-	-	-	1,203	d	105	3,045	195			2,150			
FY28	-	-	-	-	-	45	1,045	168			330			
FY29	-	-	-	-	-	30	30	136			273			
FY30	-	-	-	-	-	30	-	123			100			
FY31	-	-	-	-	-	30	-	151			25			
FY32	-	-	-	-	-	-	-	-			-			

- ^a H-Canyon receipts are based on Ling-to-Blackmon³⁴ for the duration and the *Liquid Waste Functional Service Agreement*³⁵ between SRNS and SRR for the volume. The shutdown flow volume for H-Canyon, as outlined in *H-Canyon Liquid Waste Generation Forecast For H-Tank Farm Transfer*³⁰, is assumed in FY26.
- LW is the main component of H-Canyon waste and is received into Tank 39
 - LLW consists primarily of General Purpose (GP) H-Canyon Evaporator concentrate received in Tank 50
 - Other materials, which may include uranium, plutonium, neptunium, etc., are received directly into sludge batches, via either the sludge preparation tank (Tank 51) or the DWPF feed tank (Tank 40).
- ^b Various nuclear materials, including plutonium, uranium, neptunium, etc., from H-Canyon may be introduced into sludge batches to the extent allowable without negatively impacting planned canister waste loadings while continuing to comply with the canister fissile material concentration limits. At the time of publication of this *Plan*, H-Canyon did not have a forecast for processing this material past FY13. The H-Canyon forecast for these materials will be included in future versions of this *Plan*, as it is made available.
- ^c DWPF Recycle receipts reflect modifications made in the DWPF to reduce recycle. Additionally, DWPF recycle is used to minimize inhibited water addition required for salt dissolution and molarity adjustments within the Tank Farms.
- ^d Maintenance Facility (299-H) receipts mainly consists of a dilute nitric acid stream, decon solutions, and steam condensate. These waste streams from decontaminating equipment are collected in the 299-H pump tank, neutralized, and sent to Tank 39. They are assumed to be redirected when necessary to complete Tank 39 heel removal.
- ^e Volumes are not additive after accounting for jet dilution, expansion of sludge during slurry operations (sludge becomes less dense), and other volume changes during the processing of waste. During a transfer, steam eductor jets are used to transfer liquid waste from tank to tank. Volume from the transfer steam accounts for 4% of the volume being transferred for intra-area transfers and 6% for inter-area lines. Mixing waste forms of different compositions are not mathematically additive. For example, noticeable space recovery can be achieved when a light solution (such as DWPF recycle water) is mixed with concentrated supernate. Also, the dissolution of "dry salt" (i.e. salt with interstitial liquid removed) tends to recover space. Years with large amounts of salt dissolution reflect this anomaly.

^{Note} Dates, volumes, and chemical or radiological composition information are planning approximations only.

Appendix F — Remaining Tank Inventory

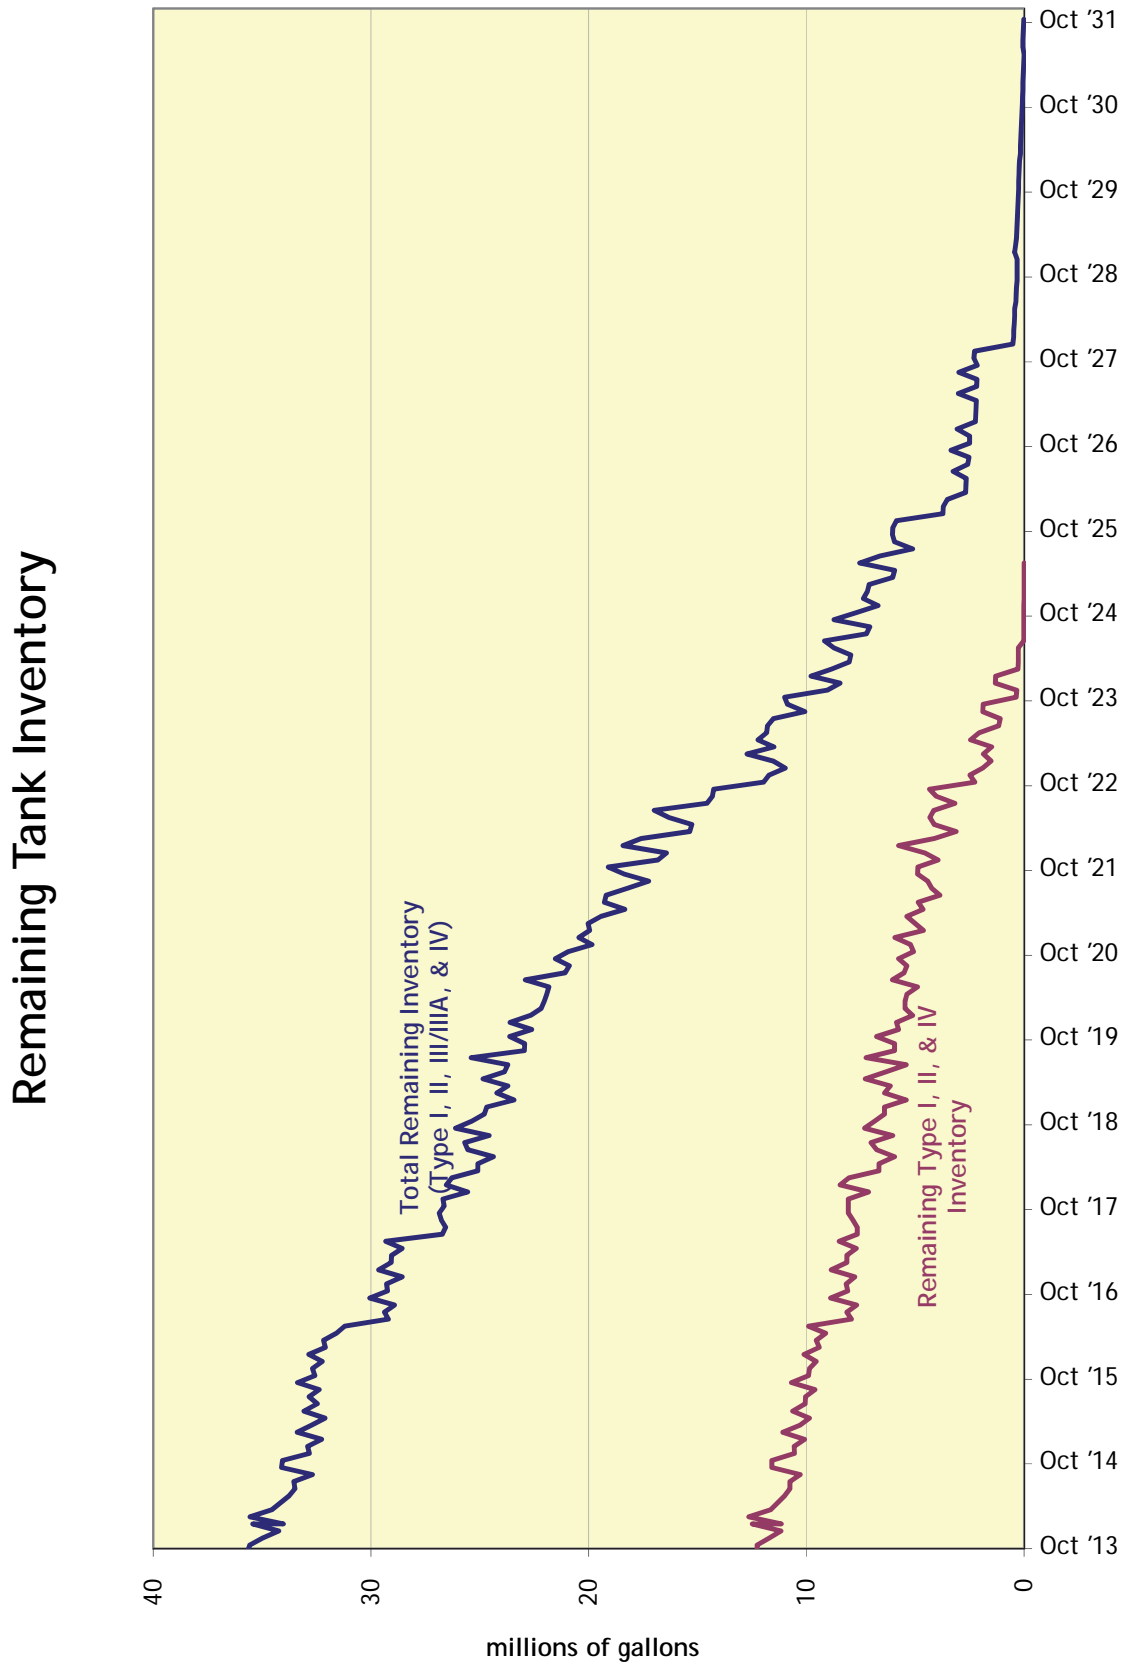

Appendix G — *LW System Plan — Rev 18 Summary*


(see attached foldout chart)

Appendix H — Salt Solution Processing, Alternate Case


End of Fiscal Year	Salt Solution (kgal)					to Tank 50 (kgal)				SDU Numbers
	DDA-solely	ARP/MCU	SCIX	SWPF	Total	DSS	LLW	ETF	Total	
Total as of end of FY10	2,800	990			3,790	3,151	682	3,019	6,492	4
FY11		1,063			1,063	1,487	200	64	1,751	4
FY12		702			702	901	19	24	1,251	4 & 2
FY13		1,401			1,401	1,778	18	120	1,916	2
FY14		2,581			2,581	3,275	18	120	3,413	3 & 5
FY15		2,451			2,451	3,111	18	120	3,249	3-6
FY16		4,700			4,700	5,964	18	120	6,102	6
FY17		4,700	2,940		7,640	8,904	18	120	9,042	6
FY18		4,700	2,940		7,640	8,904	18	120	9,042	6-7
FY19		3,133	2,940		6,073	6,916	18	120	7,054	7
FY20		4,700	2,940		7,640	8,904	18	120	9,042	7-8
FY21		4,700	2,940		7,640	8,904	18	120	9,042	8
FY22		4,700	2,940		7,640	8,904	18	120	9,042	8-9
FY23		2,350	2,520		4,870	5,502	18	120	5,640	9
FY24			2,940	4,625	7,565	8,809	18	120	8,947	9-10
FY25			2,940	7,200	10,140	12,077	18	120	12,215	10-11
FY26			2,940	9,000	11,940	14,361	18	120	14,499	11
FY27			2,940	4,700	7,640	8,904		120	9,024	11-12
FY28			2,940	3,000	5,940	6,747		60	6,807	12
FY29			420	500	920	1,055		30	1,085	12
Total	2,800	42,872	35,280	29,025	109,977	128,560	1,153	4,996	134,656	12

Appendix I — BWRE & Removal from Service, Alternate Case

Bulk Waste Removal Efforts

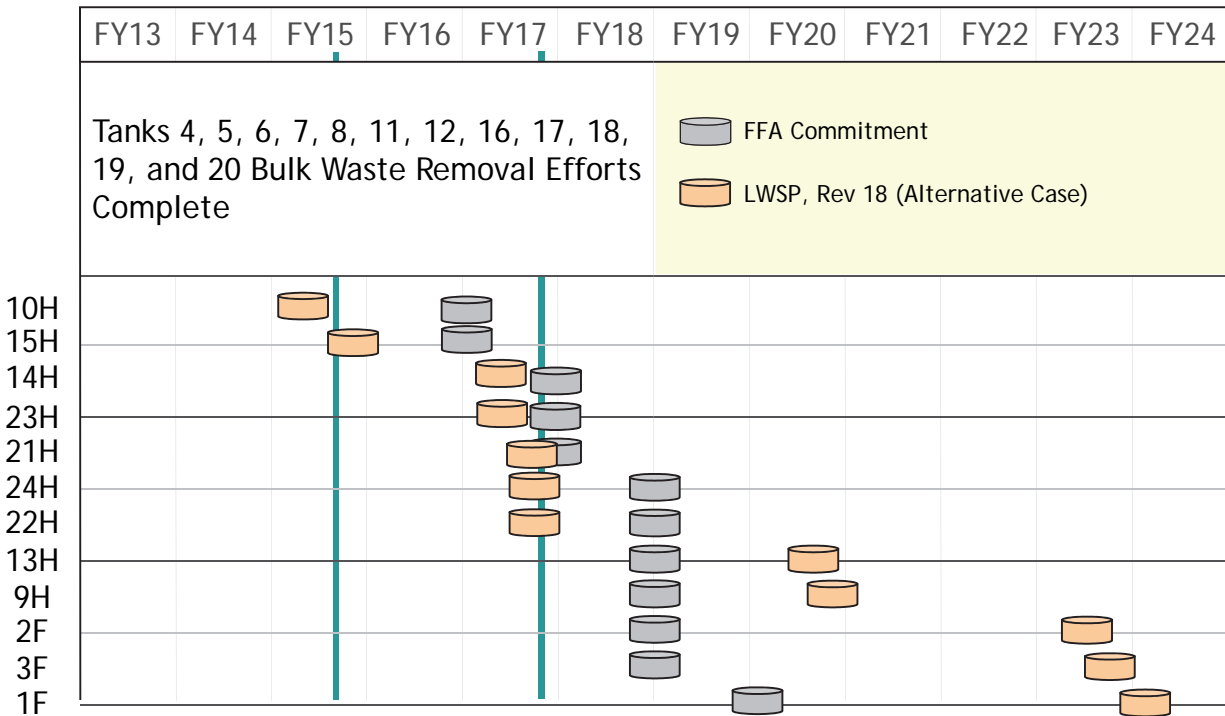

Tank Removal from Service

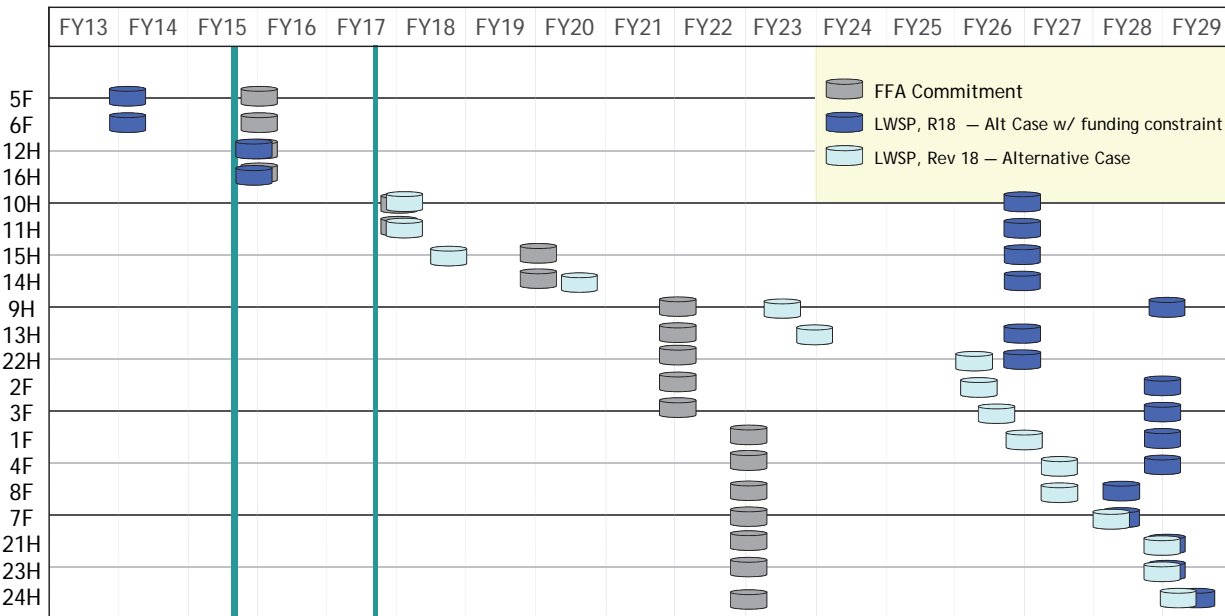

Appendix J — Acronyms

AB	Tank Farm Authorization Basis		vault for storing glass-filled HLW canisters
ARP	Actinide Removal Process – planned process that will remove actinides and Strontium-90 (Sr-90), both soluble and insoluble, from Tank Farm salt solution using MST and filtration	HLW	High Level Waste
		HM	H Modified – the modified PUREX process in H-Canyon for separation of special nuclear materials and enriched uranium
BWRE	Bulk Waste Removal Efforts	HTF	H-Tank Farm
Ci/gal	Curies per gallon	IL	Interstitial Liquid
CM	Closure Module	IPABS	Integrated Planning, Accountability, & Budgeting System
CSSX	Caustic Side Solvent Extraction – process for removing cesium from a caustic (alkaline) solution. The process is a liquid-liquid extraction process using a crown ether. SRS plans to use this process to remove Cesium-137 (Cs-137) from salt wastes.	ITR	Independent Technical Review
		IW	Inhibited Water – well water to which small quantities of sodium hydroxide and sodium nitrite have been added to prevent corrosion of carbon steel waste tanks
CST	crystalline silicotitanate	IXC	Ion Exchange Column
D&D	Dismantlement and Decommissioning	kgal	thousand gallons
DCS	Digital Control System	LTAD	Low Temperature Aluminum Dissolution
DDA	Deliquification, Dissolution, and Adjustment	LLW	Low Level Waste
DNFSB	Defense Nuclear Facilities Safety Board	LW	Liquid (Radioactive) Waste – broad term that includes the liquid wastes from the canyons, HLW for vitrification in DWPF, LLW for disposition at SDF, and LLW wastes for treatment at ETF
DOE	Department of Energy		
DOE-SR	The DOE Savannah River Operations Office	MCi	Million Curies
DSS	Decontaminated Salt Solution – the decontaminated stream from any of the salt processes – DDA, ARP/MCU, or SWPF	MCU	Modular CSSX Unit – small-scale modular unit that removes cesium from supernate using a CSSX process similar to SWPF
DWPF	Defense Waste Processing Facility – SRS facility in which LW is vitrified (turned into glass)	Mgal	million gallons
EA	Environmental Assessment	MSB	Melter Storage Box
ECC	Enhanced Chemical Cleaning	MST	monosodium titanate
EIS	Environmental Impact Statement	NDAA	Ronald W. Reagan National Defense Authorization Act for Fiscal Year 2005, Public Law 108-375
ELAWD	Enhanced Low Activity Waste Disposal	NDAA §3116	Section 3116 – Defense Site Acceleration Completion — of the NDAA
EPA	Environmental Protection Agency	NEPA	National Environmental Policy Act
ETF	Effluent Treatment Facility – SRS facility for treating contaminated wastewaters from F & H Areas	NGS	Next Generation Solvent
FFA	Federal Facility Agreement – tri-party agreement between DOE, SCDHEC, and EPA concerning closure of waste sites. The currently-approved FFA contains commitment dates for closing specific LW tanks	NPDES	National Pollution Discharge Elimination Systems
FESV	Failed Equipment Storage Vault	NRC	Nuclear Regulatory Commission
FTF	F-Tank Farm	OA	Oxalic Acid
FY	Fiscal Year	PA	Performance Assessment
GP	General Purpose Evaporator – an H-Canyon process that transfers waste to HTF	PBR	President’s Budget Request
		PEP	Project Execution Plan
GWSB	Glass Waste Storage Building – SRS facilities with a below-ground concrete	PEIS	Programmatic Environmental Impact Statement
		PUREX	Plutonium Uranium Reduction Extraction
		RCRA	Resource Conservation and Recovery Act
		RFS	Removed from Service

RMF	Rotary Microfilter		
ROMP	Risk and Opportunity Management Plan		
SAC	Specific Administrative Controls		
SAS	Steam Atomized Scrubber		
SB	Sludge Batch		
SC	Safety Class		
SCDHEC	South Carolina Department of Health and Environmental Control – state agency that regulates hazardous wastes at SRS		
SCIX	Small Column Ion Exchange		
SD	Salt Dissolution		
SDI	Salt Disposition Initiative		
SDF	Saltstone Disposal Facility – SRS facility containing Saltstone Disposal Units		
SDU	Saltstone Disposal Units – Disposal Units that receive wet grout from SPF, where it cures into a solid, non-hazardous Saltstone		
SE	Strip Effluent		
SEIS	Supplemental Environmental Impact Statement		
SME	Slurry Mix Evaporator		
SMP	Submersible Mixer Pump		
SOL	Sludge Oxide Loading		
SPF	Saltstone Production Facility – SRS facility that mixes decontaminated salt solution and other low-level wastes with dry materials to form a grout that is pumped to SDF		
		SRD	Spent Resin Disposal
		SRNS	Savannah River Nuclear Solutions
		SRR	Savannah River Remediation LLC
		SRS	Savannah River Site
		SS	Safety Significant
		SSC	Systems, Structures and Components
		STP	Site Treatment Plan
		SWPF	Salt Waste Processing Facility – planned facility that will remove Cs-137 from Tank Farm salt solutions by the CSSX process and Sr-90 and actinides by treatment with MST and filtration
		TSR	Technical Safety Requirements
		UUM	Unirradiated Uranium Material
		WAC	Waste Acceptance Criteria
		WCHT	Waste Concentrate Hold Tank
		WCS	Waste Characterization System – system for estimating the inventories of radionuclides and chemicals in SRS Tank Farm tanks using a combination of process knowledge and samples
		WD	Waste Determination
		WOW	Waste on Wheels
		wt%	weight percent

References

- ¹ Chew, D.P., *et al.*, SRR-LWP-2009-00001, *Liquid Waste System Plan*, Revision 16, December 2010
- ² Chew, D.P., *et al.*, SRR-LWP-2009-00001, *Liquid Waste System Plan*, Revision 17, February 2012
- ³ Contract No. DE-AC09-09SR22505 for the Liquid Waste (LW) Program at the Savannah River Site (SRS), December 2008
- ⁴ WSRC-OS-94-42, *Federal Facility Agreement for the Savannah River Site*, August 1993, as amended through March 2010
- ⁵ SRNS-TR-2008-00101, *Savannah River Site Approved Site Treatment Plan, 2010 Annual Update*, Revision 2, November 2010
- ⁶ Bodman, S.W., DOE-WD-2005-001, *Section 3116 Determination for Salt Waste Disposal at the Savannah River Site*, Revision 0, January 2006
- ⁷ DOE-WD-2005-001, *Basis for Section 3116 Determination for Salt Waste Disposal at the Savannah River Site*, Revision 0, January 2006
- ⁸ Chu, S, DOE-WD-2012-001, *Section 3116 Determination for Closure of F-Tank Farm at the Savannah River Site*, Revision 0, March 2012
- ⁹ DOE/SRS-WD-2012-001, *Basis for Section 3116 Determination for Closure of F-Tank Farm at the Savannah River Site*, Revision 0, March 2012
- ¹⁰ Thomas, S.A., LWO-PIT-2006-00017, *Savannah River Site – Liquid Waste Disposition Processing Strategy*, Revision 0, September 2006
- ¹¹ Kent M. Coleman, P.G., to Dr. David C. Moody, *Savannah River Site Z-Area Saltstone Disposal Facility Permit Facility ID No. 02550-1603 Aiken County*, August 2011
- ¹² Winship, G.C., Y-RAR-G-00022, *PBS-SR-0014, Radioactive Liquid Tank Waste Stabilization and Disposition, Risk and Opportunity Management Plan*, Revision 7, December 2010
- ¹³ BD-12-0031, C.N. Smith to D.J. Schlismann, *DE-AC09-09SR22505: Revision 3- Savannah River Remediation. (SRR) Office of Environmental Management (EM) Preliminary) FY 2013 Expected Funds*, September 2012
- ¹⁴ FFA Appendix L, *Statements of Dispute Resolution, Statement of Resolution of Dispute Concerning Extension of Closure Dates for Savannah River Site High-Level Radioactive Waste Tanks 19 and 18*, November 2007, and amendments
- ¹⁵ Gillam, J.M., and McIlmoyle, D.W., SRR-LWP-2013-00019, *Sludge Batch Plan in Support of System Plan Rev. 18*, Revision 0, April 2013
- ¹⁶ Shah, H.B., SRR-LWP-2011-00067, *Sludge Batch Plan in Support of System Plan Rev. 17*, Revision 0, January 2012
- ¹⁷ Le, T.A., SRR-LWP-2013-00023, *Salt Batch Plan in Support of System Plan R 18*, Revision 0, April 2013
- ¹⁸ Carroll, P.E., U-ESR-H-00084, *ARP / MCU Life Extension Evaluation*, Revision 0, June 2009
- ¹⁹ WSRC-SA-2002-00007, *Concentration, Storage, and Transfer Facilities Documented Safety Analysis*, Revision 14, July 2012
- ²⁰ G-FSP-G-00019, *Functional Service Agreement Between Savannah River Nuclear Solution LLC and Savannah River Remediation LLC Liquid Waste Receipt Services*, Revision 3, October 2012
- ²¹ Folk, J.L., WDPD-10-84, *Request to Store Supernate in Tank 8 After Completion of Bulk Waste Removal Efforts*, September 2010
- ²² R.H. Pope to B.T. Hennessey, March 7, 2013

- ²³ P.G. Van Keisler to B.T. Hennessey, *Letter, Hennessey to Keisler and Pope, Approval for Continued Usage of High Level Waste Tanks 7F and 11H, dated March 1, 2013*, March 7, 2013
- ²⁴ Schlismann, D.J., SRR-CAA-2013-00028, *Contract DE-AC09-09SR22505-Agreement on Key Input Bases and Assumptions for Revision 18 of the Liquid Waste System Plan*, January 2013
- ²⁵ Birk, M.B., LWO-RIP-2009-00009, *Industrial Wastewater General Closure Plan for F-Area Waste Tank Systems, Industrial Wastewater Construction Permit #17424-IW*, Revision 3, January 2011
- ²⁶ Birk, M.B., SRR-CWDA-2011-00022, *Industrial Wastewater General Closure Plan for H-Area Waste Tank Systems*, Revision 0, May 2012
- ²⁷ MGR-10-037, *Fissile Limits in Defense Waste Processing Facility Canisters*, April 2010
- ²⁸ Suggs, P.C. to Mahoney, M.J., PIT-MISC-0195, email *Long Term Processing Capacity of SWPF-Inputs to System Plan*, July 2006
- ²⁹ X-ESR-J-00001, *Waste Acceptance Criteria*, Revision 1, September 2009
- ³⁰ Jilani, I.A., CBU-HCP-2005-00105, *H-Canyon Liquid Waste Generation Forecast For H-Tank Farm Transfer*, Revision 0, May 2005
- ³¹ Le, T.A., SRR-LWP-2013-00006, *1/2/13 – January 2013 WCS Curie and Volume Inventory Report*, Revision 1, June 2013
- ³² Waltz, R. S., Jr., C-ESR-G-00003, *SRS High Level Waste Tank Leaksite Information*, Revision 5, January 2011
- ³³ Brooke, J. N., Peters, J. F., and K. Stahell, WSRC-TR-99-00358, *Hydrological Methods Can Separate Cesium from Nuclear Waste Saltcake*, 1999.
- ³⁴ L. Ling to R. Blackmon, July 2, 2012, *Summary of Discussion with DOE (Gunter)*
- ³⁵ G-FSP-G-00019, *Functional Service Agreement Between Savannah River Nuclear Solution LLC and Savannah River Remediation LLC – Liquid Waste Receipt Services*, Revision 3, October 2012

DOE-SR

T. J. Spears, 704-S (40)
J. L. Reynolds, 703-41A

SRR-Sr. Staff

S. A. MacVean, 766-H

SRR-Staff

P. M. Allen, 766-H (7)
R. W. Blackmon, 766-H (5)
P. D. Campbell, 766-H (5)
K. S. Cassara, 766-H (7)
N. R. Davis, 704-56H (10)
J. E. Dickenson, 766-H
V. G. Dickert, 766-H
S. P. Fairchild, 766-H (10)
V. A. Franklin, 705-1C (10)
M. A. Schmitz, 766-H
S. W. Wilkerson, 704-S (10)
C. J. Winkler, 766-H (10)
D. C. Wood, 704-26F (10)

SRNS

K. H. Fuller, Jr, 225-7H (5)
S. L. Marra, 766-A

DNFSB

D. L. Burnfield, 703-41A
M. T. Sautman, 703-41A
S. Sircar, DNFSB
D. M. Gutowski, DNFSB

File

ECATS (DOE), 730-1B
D. P. Chew (300), 766-H
Records Administration, 773-52A



Acronyms:
AC: Annulus Cleaning
ARP: Actinide Removal Process
BWR: Bulk Waste Removal
CST: Crystalline Silico-Titanate
DWPFF: Defense Waste Processing Facility
HR: Heel Removal
LTAD: Low Temperature Aluminum Dissolution
MCU: Modular CSS Unit
MST: Mono-sodium Titanate
SB: Sludge Batch
SCIX: Small Column Ion Exchange
SDF: Saltstone Disposition Facility
SDU: Saltstone Disposal Unit
SPF: Saltstone Production Facility
SWPF: Salt Waste Processing Facility

Legend:
★ FFA BWRE Date
◆ Forecast BWRE complete
★ FFA Closure Date
★ Forecast Closure Complete

Note:
- Dates, volumes, and chemical or radiological composition information contained in this plan are planning approximations only. Specific flowheets guide actual execution of individual processing steps.
- This chart is a plan, not a schedule. The bars indicate summary-level activities, some of which have not yet been fully defined. The sequence of activities reflect the best judgment of the planners; full scope, schedule, and funding definition may require modification of this plan.

SDF (Head) TK 50 (Head) TK 41 (Head) TK 22 (Head) TK 42 (Head) SDF (Head) TK 49 (Head) TK 21 (Head) TK 24 (Head) TK 33 (Head) TK 34 (Head) TK 36 (Head) TK 40 (Head) TK 51 (Head) F-Tank Farm TK 25 (Head) TK 26 (Head) TK 27 (Head) TK 28 (Head) TK 29 (Head) TK 30 (Head) TK 31 (Head) TK 32 (Head) TK 33 (Head) TK 34 (Head) TK 35 (Head) TK 36 (Head) TK 37 (Head) TK 38 (Head) TK 39 (Head) TK 40 (Head) TK 41 (Head) TK 42 (Head) TK 43 (Head) TK 44 (Head) TK 45 (Head) TK 46 (Head) TK 47 (Head) TK 48 (Head) H-Tank Farm TK 9 (Head) TK 10 (Head) TK 11 (Head) TK 12 (Head) TK 13 (Head) TK 14 (Head) TK 15 (Head) TK 16 (Head) TK 17 (Head) TK 18 (Head) TK 19 (Head) TK 20 (Head) TK 21 (Head) TK 22 (Head) TK 23 (Head) TK 24 (Head) TK 25 (Head) TK 26 (Head) TK 27 (Head) TK 28 (Head) TK 29 (Head) TK 30 (Head) TK 31 (Head) TK 32 (Head) TK 33 (Head) TK 34 (Head) TK 35 (Head) TK 36 (Head) TK 37 (Head) TK 38 (Head) TK 39 (Head) TK 40 (Head) TK 41 (Head) TK 42 (Head) TK 43 (Head) TK 44 (Head) TK 45 (Head) TK 46 (Head) TK 47 (Head) TK 48 (Head)