

U.S. DEPARTMENT OF  
**ENERGY**

Office of  
**ENERGY EFFICIENCY &  
RENEWABLE ENERGY**

# Integrating Health and Energy Efficiency in Healthcare Facilities

December 2020



**FEMP**  
Federal Energy Management Program

# INTEGRATING HEALTH AND ENERGY EFFICIENCY IN HEALTHCARE FACILITIES

*The U.S. Department of Energy's Federal Energy Management Program (FEMP), in partnership with the General Services Administration, is exploring how traditional building energy efficiency measures can impact the health of occupants in the federal sector through its Healthy Buildings Initiative (HBI).*

## Acknowledgements

This report was prepared by Alison Delgado, Nora Wang, and Kevin Keene of Pacific Northwest National Laboratory (PNNL) under contract to the U.S. Department of Energy. The work was supported by FEMP led by Jefferey Murrell. The authors would like to express gratitude to Whitney Gray of International WELL Building Institute and Julia Rotondo, James McNeill and Andrea Wilkerson of PNNL who have reviewed this case study and provided feedback.

## Background

HBI investigates the intersection of energy efficiency and occupant health and wellbeing. The developing field of healthy buildings looks at impacts of the built environment on the social health and wellbeing of building occupants. It encompasses a wide range of applications that promote human health, such as lighting, thermal comfort, and indoor air quality, as well as human outcomes such as improved individual and organizational performance, reduced absenteeism and presenteeism in the workplace, and lowered healthcare costs.

HBI currently only includes office buildings in its methodology and application. In this report, PNNL presents a review of literature and current best practices along the intersection of energy efficiency and occupant health at U.S. healthcare facilities, including federally owned buildings. This report includes a review of minimum code requirements for healthcare indoor environmental quality (IEQ) and research on building measures that optimize occupant health and energy efficiency. The healthcare industry includes a wide variety of services and thus facility types. This case study focuses primarily on inpatient facilities, such as hospitals.

### HEALTHY BUILDINGS INITIATIVE OFFICE BUILDING METHODOLOGY

The HBI utilizes a framework to evaluate a building's improvement potential regarding occupant health in commercial and government office buildings. The HBI framework may be expanded to include healthcare buildings in subsequent editions. As shown in Figure 1, the current framework is comprised of the following three key modules:

1. The **Performance Baseline Module** collects baseline IEQ data by measuring parameters such as carbon dioxide, temperature, humidity, and light levels, and administering an occupant survey.
2. The **Improvement Opportunities Module** uses the baseline IEQ data to guide the collection of additional building characteristics, operation, and asset information needed to understand the reasons for any IEQ issues and identify specific improvement actions to help achieve the IEQ targets.
3. The **Productivity Financial Gains Module** uses the data collected in Module 1 to estimate the potential productivity improvement for a building. PNNL developed a series of correlations between IEQ metrics and occupant productivity from a meta-analysis of 51 experimental conditions from peer reviewed academic studies. The potential productivity gains between the baseline IEQ values and the target IEQ values are converted to financial gains using the personnel cost of employees in the building.

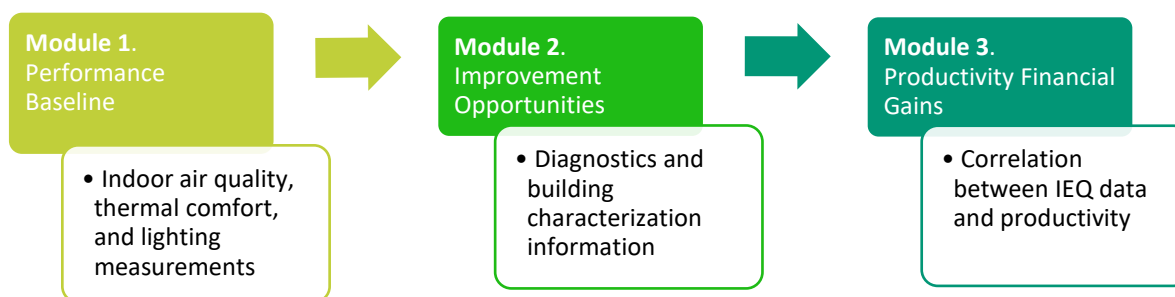


Figure 1. Healthy Building Framework diagram of major components for office buildings.

### Healthcare Facilities: Opportunity Space

U.S. healthcare facilities comprise approximately 4 billion square feet or 5% of total commercial floorspace, accounting for about 10% of total commercial building energy consumption (EIA 2012). Hospitals and other inpatient facilities comprise about half of the healthcare facilities floorspace and nearly three-fourths of all energy consumed by healthcare facilities (EIA 2012). Hospitals tend to have a high energy use intensity (EUI) compared to other building types, nearly three times the average commercial building (Della Barba 2014). They are currently the second most energy-intensive building type in the U.S., with heating, cooling, and ventilation (HVAC) comprising 52% of their energy use (Taylor and Arch 2016). The healthcare sector also has high operating expenditures, with a combined budget of about \$1 trillion (AHA 2020).

Most hospitals in the U.S. are community hospitals (nonfederal, short-term general, and other special hospitals), with almost half of these being not-for-profit (AHA 2020). Federal government hospitals make up only 4% of U.S. hospitals (AHA 2020). Federal healthcare facilities include the U.S. Department of Defense's (DoD) Military Health System (which provides healthcare to active duty, Reserve component, and retired U.S. military personnel and their dependents), the Veterans Affairs (VA) hospitals (which serve military veterans), and the Indian Health Service (IHS, an agency within the Department of Health and Human Services responsible for providing federal health services to Native Americans).

Despite robust infection control and health safety practices, many inpatients are contracting hospital-acquired infections (HAI) which threaten their health and survival (Taylor and Arch 2016). A number of studies (Deloach 2004; Craig et al. 2003; Hoskins 2003) show a direct relationship between certain concentrations of air pollutants with internal health problems, such as allergies, asthma, bronchitis, pneumonia, and lung cancer. Studies have also documented correlations between ventilation and the transmission of infectious diseases such as measles, tuberculosis, chickenpox, influenza, and severe acute respiratory syndrome (SARS) (Li et al. 2007, Mendell et al. 2002; Yu et al. 2004). HVAC systems that are poorly designed or poorly maintained (i.e., conducive to contamination) are common in hospitals which often lead to poor indoor air quality (Hellgren and Reijula 2006).<sup>1</sup> This may lead to Sick Building Syndrome, various occupational hazards, and HAIs (Reijula et al. 2013). HAIs, in turn, are associated with increased mortality, length of hospital stay and costs.

<sup>1</sup> In a year, about 2 million patients suffer with HAIs in the United States. Of these cases, nearly 90,000 patients are expected to die. HAI is ranked the fifth leading cause of death in U.S. acute-care hospitals. The total direct cost of HAIs to hospitals is from \$28 billion to \$45 billion.

# Health and Energy Efficiency Intersection

Core aspects of healthy buildings revolve around areas such as lighting, indoor air quality, thermal comfort, acoustics, access to nature, access to healthy foods, and opportunities for movement. With healthcare facilities, some of these aspects are also linked to improved hygiene and infection control. Healthcare building design is guided by rigorous research that links hospitals' physical environments to health outcomes, building on strategies that help to inform standard setting groups such as the Facilities Guidelines Institute (Hamilton 2003; Ulrich et al. 2008). This report provides an overview of the current literature on occupant health-related issues<sup>2</sup> concerning healthcare facilities in the context of energy efficiency. Specifically, it looks at linkages between healthy building concerns and practices related to HVAC (e.g., ventilation rate and humidity control to reduce pathogen loads and thermal comfort) and lighting (e.g., lighting spectrum for night-shift workers, lighting illuminance for precision tasks, and daylighting for patient recovery and to reduce stress and improve sleep of healthcare providers).

## Ventilation

Much of the effort to address occupant health in the healthcare industry has centered around ventilation. Ventilation rates at healthcare facilities have long represented a delicate balance between reducing pathogen loads and addressing the sector's high energy use (English 2016). The high EUI in hospitals is mostly attributed to the HVAC systems, primarily in supply air heating to meet ventilation requirements (English 2016). Ventilation rate, expressed sometimes as air changes per hour (ACH), is an important parameter for controlling indoor air quality (Ulrich et al. 2008).

ASHRAE Standard 170, *Ventilation of Health Care Facilities* serves as the main roadmap for designers and health facility operators across the nation (ASHRAE 2017; English 2016). Table 1 shows sample ventilation specifications, as well as relative humidity ranges, for inpatient spaces. Standard 170 brought together several ventilation standards used throughout North America into one document and is referenced almost exclusively in building codes for ventilation requirements in hospitals and other healthcare facilities (Emmerich et al. 2017). The standard is also included in its entirety in the Facility Guidelines Institute's (FGI) Guidelines for Design and Construction of Hospitals, Outpatient Facilities, and Residential Health, Care, and Support Facilities, respectively,<sup>3</sup> which has been adopted by 42 states (ASHRAE 2019). Many outpatient facilities (e.g., doctor's offices) are classified as B-occupancy (Business) and may be instead applicable to ASHRAE Standard 90.1, *Energy Standard for Buildings Except Low-Rise Residential Buildings* and ASHRAE 62.1, *Ventilation for Acceptable Indoor Air Quality* (ASHRAE 2019).

Both the VA and the IHS instruct designers and engineers to use ASHRAE 170 for medical spaces (IHS 2019; VA 2020). DoD's 2019 Unified Facilities Criteria for Military Medical Facilities (DoD 2019) cites ASHRAE 62.1 for ventilation. Leadership in Energy and Environmental Design (LEED) v4.1, a green building certification system, has a healthcare specific framework for new and existing buildings. LEED v4.1 has differing energy credits for healthcare buildings compared to other use types, and for IEQ specifically related to ventilation, the certification program adopts requirements from ASHRAE 170.

WELL, the first building certification system to focus exclusively on health and wellbeing, is open to all building typologies including inpatient and outpatient healthcare, although it does not have specific considerations for these building types. WELL requires conforming with ASHRAE 62.1 ventilation rates as a pre-requisite for basic certification and offers points for achieving 30% and 60% above ASHRAE 62.1 for advanced certification levels (WELL 2020 A06). Adventist and MetroHealth are examples of healthcare systems that have pursued WELL. WELL is in the process of standing up the WELL Advisory on Healthcare.

---

<sup>2</sup> Occupants in healthcare facilities include workers/staff, patients and visitors.

<sup>3</sup> See relevant FGI guidelines at: <https://fgiguideelines.org/guidelines/2018-fgi-guidelines>



Natural ventilation, an effective strategy to decrease energy consumption, has not been fully studied in healthcare facilities. One concern is that natural ventilation compromises building envelope integrity by allowing in non-filtered air with outdoor air contaminants such as fungal spores (Bartley, Olmsted, and Haas 2010). While the modern life safety and infection prevention principles emphasize tighter control, the emerging biophilic design trend seeks to maintain, enhance, and restore the beneficial experience (e.g., reduce stress, mitigate pain, and speed patient recovery) of nature in the built environment.

**Table 1. ASHRAE 170 ventilation design parameters for inpatient spaces. (Source: ASHRAE 170-2017)**

Function of Space	Pressure Relationship to Adjacent Areas <sup>4</sup>	Minimum Outdoor ACH	Minimum Total ACH	Design Relative Humidity (%)
Cesarean delivery room	Positive	4	20	20-60
Critical care patient care station	No requirement	2	6	30-60
Operating room	Positive	4	20	20-60
Procedure room	Positive	3	15	20-60
Treatment room	No requirement	2	6	20-60
Endoscope cleaning	Negative	2	10	No requirement
Physical therapy	Negative	2	6	Max 65
Laboratory work area, pathology	Negative	2	6	No requirement

Ultraviolet germicidal irradiation (UVGI), using UV-C lighting (a short-wave UV light) in HVAC systems and upward-facing UV light fixtures in patient rooms, has been used in some hospitals to disinfect the air of both bacteria and viruses (Memarzadeh et al. 2010). Other stand-alone units can be placed inside the bathrooms of patients above the door to clean on a cyclical basis. It is important to note that even the most robust HVAC system is unlikely to achieve enough air mixing to kill off microbes in which the mode of transmission is via droplets that do not remain suspended in the air for long periods of time. In the case of infectious agents such as SARS-CoV-2 (COVID-19) and influenza, droplets fall out within a 2-meter radius or more from a coughing/sneezing person (Dudalski et al. 2020; Memarzadeh et al. 2010) and the particles may never reach the upper-room UV zone. Escombe et al. (2009) tested the use of upward-facing UV light fixtures in the ceilings of a negative-pressure tuberculosis isolation ward. The researchers concluded that an upper-room UVGI fixture can be an effective, low-cost intervention for use in tuberculosis infection control in high-risk clinical settings, provided there is adequate mixing of room air. According to a 2010 review by Memarzadeh et al. (2010) of this technology, practitioners should view UVGI as a supplemental strategy rather than an alternative to adequate ventilation levels. Additionally, the safety of UV devices needs further study.<sup>5</sup>

## Humidity

Healthcare facilities should maintain the relative humidity of a space within an optimal range. Below a relative humidity of 40%, infectious aerosols originating from watery environments (e.g., from breathing, speaking, coughing, toilet flushing, vomiting, and diarrhea) shrink to become tiny droplet nuclei (Taylor and Arch 2016). The upward velocity of circulating indoor air more easily surpasses the terminal settling velocity of these smaller aerosol droplets and they remain suspended in the air for a prolonged period. Keeping the indoor relative humidity below 40% could potentially reduce the necessary design ventilation rate that inhibits virus transmission and therefore reduce energy use (Taylor and Arch 2016).

<sup>4</sup> A positive pressure room (protective environment) allows staff to reduce exposure of vulnerable patients to infections and disease. They can maintain a higher pressure inside the treated area than that of the surrounding area, preventing air in potentially contaminated rooms from entering treated rooms. Conversely, a negative-pressure room isolates patients with infectious conditions and protects people outside that room from exposure.

<sup>5</sup> The U.S. Environmental Protection Agency recently issued a compliance advisory for UV lights (<https://www.epa.gov/sites/production/files/2020-10/documents/uvlight-complianceadvisory.pdf>). UV lights are regulated under the Federal Insecticide, Fungicide, and Rodenticide Act (FIFRA) as pesticide devices when sold or distributed with claims to kill or be otherwise effective against viruses and/or bacteria. EPA has not conducted a human health risk assessment to determine the safety of UV light devices.

Humidity also directly affects human's psycho-physiological mechanisms. Higher humidity of the inhaled air has been shown to enhance the host's airway antiviral defense at multiple levels (e.g., mucus production) (Moriyama, Hugentobler, and Iwasaki 2020). Humidity also affects cognitive functions (Taylor and Arch 2017) which could be essential to some medical professionals.

Humidity control in buildings has been primarily focused on reducing humidity to eliminate condensation and mold growth, rather than on preventing low humidity levels. A double heat pipe heat exchanger system is recommended, over conventional heat exchangers, to improve humidity control and decrease fungus growth and energy consumption in hospitals located in hot and humid areas (Yau 2008; Yau and Ng 2011). This system also has a lower initial cost, lower maintenance cost, and lowering operating cost. It is deemed a practical solution in the HVAC industry; however, to date, only a few studies have investigated the use of double-pipe heat exchangers in air conditioning applications (Ghani et al. 2018).

## Thermal Comfort

Indoor comfort in the healthcare setting is a less explored topic (Derks et al. 2018; Verheyen et al. 2011), but of the studies to date, a few have found linkages with health outcomes. One study of hospital operating rooms found that thermal comfort affects the working conditions, wellbeing, safety, and health of the medical personnel (Balaras, Dascalaki, and Gaglia 2007). While ASHRAE 170 states that the desirable indoor air temperature is from 20 to 24°C (68 to 75°F) and desirable relative humidity is from 30 to 60%, Balaras et al. (2017) clarify that the use of lower or higher temperatures can be justified when patient comfort and/or medical conditions require those conditions. For example, for pediatric surgeries, practitioners commonly set a higher indoor air temperature (sometimes as high as 27°C [80.6°F]) because children tend to be more sensitive to lower temperatures (Balaras, Dascalaki, and Gaglia 2007; Nastase et al. 2016).

Thermal sensation greatly varies from person to person, especially between patients and medical personnel. In a study of nursing staff in hospital wards, one study found that the thermal condition was reported to be "slightly warm" and negatively impacted self-reported work performance (Derks et al. 2018). Optimal thermal sensation for nurses (i.e., to suit thermal comfort requirements and work performance), the study found, would be closer to "slightly cool" than neutral. Derks et al. (2018) recommend a design approach of dividing the hospital ward into separate thermal zones, with different setpoints for respective patients' and care-professionals' comfort, which they posit would not only contribute positively to the work environment but also provide opportunities to conserve energy.

ASHRAE Standard 55, *Thermal Environmental Conditions for Human Occupancy* specifies the combination of environmental factors (temperature, thermal radiation, humidity, and air speed) and personal factors (activity level and clothing) that will produce thermal conditions acceptable to most occupants. However, there exist scenarios and spaces within healthcare facilities where the standard is not applicable or where deviations from Standard 55 are required (Addendum H to ASHRAE 170-2017). Section 2.7 of Standard 170 states that this standard does not ensure compliance with ASHRAE Standard 55. ASHRAE 170 Addendum H also clarifies that the standard provides HVAC design temperature and humidity ranges that, while potentially affecting occupant comfort, are also provided to address therapeutic patient outcomes, aseptic practices, and worker protection.

## Existing and Emerging HVAC Solutions

In terms of solutions, most modern HVAC systems have the capacity to control the indoor environment by detecting certain parameters of indoor air such as air temperature, carbon dioxide (CO<sub>2</sub>) concentration, humidity or air flow rate and adjusting it to a determined optimal value for medical staff, patients, and visitors (Reijula et al. 2013). However, many modern HVAC systems only respond to a single environmental parameter (e.g., air temperature or CO<sub>2</sub>), due to lack of advanced sensors and HVAC optimization techniques. Without the ability to balance multiple parameters, the building is either consuming excessive energy or not achieving desired indoor air quality. Rapidly advancing HVAC technologies are capable of detecting several indoor environmental parameters simultaneously to address the needs of hospital users. Dedicated outdoor air

systems, for example, decouple fresh outdoor air and air that it used to change the temperature so that air quality and temperature do not need to compete against each other. Adaptive and user-centric technologies are particularly important in healthcare facilities where occupant needs can vary greatly from one space to another.

Another emerging HVAC technology is adaptive variable air volume (VAV) systems. Often, regular VAV systems installed in hospital isolation rooms run at constant air volume, which leads to higher fan energy use (Kim and Augenbroe 2009). Adaptive VAV control systems—a feedback control system that adjusts its characteristics in a changing environment—have the benefit of consuming significantly less energy while not showing a significant difference in the potential spread of contaminants and thermal comfort (Reijula et al. 2013). Another example is demand-controlled ventilation (DCV), a ventilation rate control practice that provides the amount of outdoor air to each space based on the real-time demand (Jeong, Choi, and No 2010). DCV systems can utilize occupant scheduling (for buildings with predictable occupancy patterns), infrared sensors to sense human activity, or CO<sub>2</sub> sensors to estimate the number of occupants.

A recent study by Morawska et al. (2020) recommends avoiding recirculated air to combat COVID-19. The investigators also suggest that if this is not possible, the building should try to maximize the outdoor-air level and “apply filtering or ultraviolet germicidal irradiation to remove or deactivate potential viral contamination from the recirculated air” (Morawska et al. 2020, p. 3).

## Circadian Rhythm

Over one-third of the components of our genome are clock-controlled (controlled by circadian rhythms), and over half of all drug-response pathways are also clock-controlled (Wolverton 2013). A growing body of research indicates that chronic circadian disruption may lead to a higher risk of diseases ranging from diabetes and obesity to cardiovascular disease and cancer (IES 2016). According to Marks (2013), electrical lighting codes and standards with an emphasis on energy efficiency usually supply insufficient illuminance during the day and too much light intensity at night to maintain a normal circadian function.

A survey conducted in 2004 (Rogers et al. 2004) revealed that hospital staff workers usually worked longer than scheduled with approximately 40 percent of study participants logging in more than 12 hours. Working shifts, particularly when it involves rotating and overnight shifts, is associated with increased risks for developing cancer and other diseases (Figueiro et al. 2007; Figueiro et al. 2009; Figueiro et al. 2016; IES 2016; Plitnick et al. 2010). Research in this area has primarily focused on circadian disruption and exposure to light at night. Nurses and doctors who work shifts and patients who are constantly exposed to light are unable to entrain with their 24-hour natural rhythms (Schernhammer et al. 2001).

Providing the appropriate lighting levels is beneficial for shift-working staff and sleeping patients. Lighting does not just affect visual acuity, but also the non-visual systems emanating from the retina which modulate alertness and regulate circadian rhythms (Rea and Figueiro 2016).<sup>6</sup> While developing lighting design for circadian impact, a few key measures to consider include ensuring that the light levels are at the eye level of the occupant to simulate the light entering the eye of the user, and considering the duration of exposure to light as well as the timing of exposure (WELL 2020 L03). For night lighting at healthcare facilities, studies (Figueiro et al. 2016; Rea and Figueiro 2013; Rea and Figueiro 2016; Plitnik et al. 2010) have found that exposure to low levels of 640-nm red light (below 300 lux or 30 footcandles) does not significantly suppress melatonin levels (a hormone produced in response to darkness to regulate circadian rhythms) but can still provide adequate light for achromatic visual tasks (e.g., reading black font on a white paper). Very modest light levels (no more than 60 lux/6 footcandles) on horizontal surfaces using warm white light (2700 K) is enough for minor visual tasks without circadian disruption but may not provide alertness (IES 2016). Sixty lux (6 footcandles) of red light at night has been shown to improve alertness without circadian disruption (IES 2016). The Illuminating Engineering Society (IES) RP-29-16 recommends the use of controls for task lighting

---

<sup>6</sup> Circadian rhythms are kept in sync with light (in addition to other cues) via the intrinsically photosensitive retinal ganglion cells (ipRGCs), the non-image-forming photoreceptors of the eyes (WELL 2020).

or increasing illumination in the red spectrum to maintain shift workers alert for their tasks. It also recommends that patient room night lighting consider using low levels (less than 5 lux or 0.5 footcandles) of warm (2700 K) light sources. This suggests that a dim-to-warm strategy which decreases the correlated color temperature of light as the perceived power of light (also known as luminous flux) decreases could benefit circadian entrainment (IES 2016).

Daylighting, where practical, can also be leveraged to regulate circadian rhythms. Studies (Beauchemin and Hayes 1998; Benedetti et al. 2001; Oren et al. 2002; Sumaya et al. 2001; Joarder et al. 2009; Walch et al. 2005) have demonstrated that patients located in rooms with greater exposure to daylight are likely to recover more quickly and require less medication. For example, in a study of patients undergoing elective cervical and lumbar spinal surgery, Walch et al. (2005) found that patients in brighter rooms exposed to natural sunlight used 22 percent less pain medication which reduced medication costs by 21 percent.

Moreover, daylighting has a positive psychological impact. Studies have demonstrated that a shortened length of stay of psychiatric patients, as well as improved moods overall where daylight is abundant, often accelerates recovery from depression. In a study by Ulrich (1984) that looked at records on recovery after cholecystectomy, 23 surgical patients assigned to rooms with windows looking out on a natural scene had shorter postoperative hospital stays, received fewer negative evaluative comments in nurses' notes, and took fewer potent analgesics compared to 23 matched patients in similar rooms with windows facing a brick building wall. Beauchemin and Hayes (1998) found that women in east-facing rooms recovered faster than women in west-facing rooms. In a study by Benedetti et al. (2001), direct sunlight in the morning reduced hospital stays by 3.67 days. In another study (Sumaya et al. 2000), 50% of participants exposed to 10,000 lux (or 1,000 footcandles) in the morning, no longer diagnosed as depressed, while the control group showed no change. Similarly, a study by Oren et al. (2002) found mean depression ratings improved by 49% with no adverse effects in a 3-week study of patients exposed to bright light in the morning. There are also limited studies suggesting that daylighting leads to job satisfaction among healthcare staff (IES 2016). For example, Alimoglu and Donmez (2005) found that exposure to three hours of daylight per day lowered stress among nurses in a University Hospital and increased job satisfaction responses.

Daylighting design should incorporate proper window treatment to control glare and excessive solar heat gain. Fiber optic daylighting systems can bring sunlight into a building via fiber optic cables while still allowing controllability. This technology could be useful in healthcare facilities where glass facades may not be desirable or practical (Werring 2009). It also has the benefits of being less expensive in the long-term and more energy efficient than conventional electric lighting systems. However, fiber optic daylighting systems should also be compared to other readily available technologies such as light-emitting diodes (LEDs) which can be used to achieve a desired Spectral Power Density (SPD).<sup>7</sup>

There is evidence to assist designers, architects, and engineers in selecting the proper type and adequate quantity of light for different healthcare settings (Marks 2013). For example, we know that cool (bluish white) color temperature light has the effect of suppressing melatonin and increasing alertness in humans. Thus, this type of lighting should not be prescribed for use above a hospital patient's bed at night yet could be beneficial during the daytime for patients in long-term care facilities (Holzman 2010). There are ways to balance the lighting needs among different staff, patients, and visitors and at different times of the day (see the sidebar on page 8 for an example of this in a Neonatal Intensive Care Units).

---

<sup>7</sup> SPD describes a light source's distribution of intensity as a function of wavelength.



## Electric Lighting

Recently introduced codes and standards for lighting are more prominently incorporating guidelines related to occupant health. IES RP-29-16 *Lighting for Hospitals and Healthcare Facilities*, published in 2016, is the leading reference for lighting design in healthcare facilities in the U.S. Regulations set out by the DoD and the VA for healthcare facilities follow this standard (DoD 2019; VA 2015). The 2016 version of the standard (the previous one was published in 2006) saw several changes, in large part as a result of massive changes in lighting technologies over the previous decade, such as the emergence of LEDs. It also emphasizes the patient experience and evidence-based design practices. Updated guidelines emphasize quality of care over quantity of procedures. Some of the recommendations include:

- Glare-free lighting to improve visual acuity, reduce eye strain, and enhance the ambience
- Proper illumination levels and uniformity to maximize speed and accuracy of task performance
- Proper illumination to enhance safety and limit slips and falls
- Wayfinding to assist patients and visitors
- Flexibility (for example, in patient areas where recommended illumination levels are below 400 lux or 40 footcandles, IES RP-29-16 recommends that the designer consider using supplemental illumination for cleaning to promote proper hygiene)

Table 2 provides example recommended maintained illuminance targets (lux) for various healthcare spaces.

**Table 2. Example illuminance values for healthcare facilities in IES RP-29-16. Targets shown apply to groups of visual observers where at least half are between the ages of 25 and 65 years.**

Applications and Tasks	Horizontal Targets (lux)	Vertical Targets (lux)
Patient room corridors: Inpatient (Day)	100	50
Patient room corridors: Inpatient (Night)	50	20
Special Patient Care (Critical Care), Patient room: General	100	20
Special Patient Care (Critical Care), Patient room: Night observation	100	6
Patient Room, Night Observation	30	6
Neonatal Intensive Care, General (Day)	500	100
Neonatal Intensive Care, General (Day)	100	20
Nursery, General	100	30
Nursery, Observation	300	50
Dental suite: Examination, hygiene, treatment	1000	300

Using the proper type and quantity of light can prevent errors such as misreading charts and medication labels or a patient's vital signs (Marks 2013). A large-scale study examining the effects of different illumination levels on pharmacists' prescription-dispensing errors suggested that the frequency of such errors was lowered when work-surface light levels were at an illuminance level (brightness) of 1,500 lux (2.6% error rate) compared to 450 lux (3.8% error rate) (Buchanan et al. 1991). Booker and Roseman (1995) who studied the seasonal pattern of hospital medication errors in Alaska found correlations between increases in medication errors and the season; they observed increases in errors two months after the onset of seasonal darkness.

LED technology has dramatically changed what is feasible with electrical lighting. It is not only responsible for increases in the electrical efficiency of lighting systems (and improvements in their color properties), but also in creating a lit environment that produces maximum comfort for occupants by optimizing the light-source spectrum and color rendition (Soltic and Chalmers 2019). Researchers are also exploring the use of diode lasers, although this technology is not ready for commercial application (Cao et al. 2006).

## Conclusions

While improving the patient experience has always been recognized as a fundamental building design principal in the healthcare sector, efficiency and delivery of healthcare services are traditionally the focus. Over the past decade, however, the healthcare sector has been undergoing several changes to this landscape. Surgical treatments that used to be performed in a hospital are shifting to an outpatient setting (King et al. 2017; Kos and Quadi 2010). With the interplay of technological innovation, economic market forces, rising healthcare costs, patient and staff safety, and evolving government regulations, there is a move toward patient-centered care which is resulting in the purposeful provision of healthy building measures that improve air quality and lighting. This is reflected in the latest version of lighting requirements in healthcare facilities by IES RP-28-16 which was completely revamped from the previous version and has a whole section dedicated to occupant health. Hospitals also now get reimbursed based on patient ratings, which is a large driver for patient-centered care.<sup>8</sup> Aligned with this new way of operating hospitals and other healthcare facilities are several healthy building initiative outcomes, such as faster recovery of patients, less risk of HAIs, the ability to attract and retain staff, a more productive and effective workforce, and an improved visitor experience (Cartledge 2019). This new push toward holistic sustainable design which encompasses both energy efficiency and user-centric practices, alongside the construction boom in the healthcare sector, provides an opportunity for incorporating improved occupant health measures.

## LIGHTING HEALTH BUILDING PRACTICES FOR NEONATAL INTENSIVE CARE UNITS

There is a trend in healthcare facility design to incorporate more holistic and user-centric healthy buildings practices. One example is the SSM Health St. Mary's Hospital Neonatal Intensive Care Unit (NICU) project (Dunwoody 2017). NICUs are the hospital units where newborn babies who need intensive medical care are treated and cared for. We do not fully understand the effects of lighting on infants (Morag and Ohlsson 2016). There are some indications that too much exposure and brightness can be extremely damaging to a newborn's development (IES 2016). Thus, it is important for medical administrators to closely monitor the amount and types of light in a NICU environment. However, there is a need to further study the potential benefits and harms of differing light in neonatal units (Morag and Ohlsson 2016).

The SSM Health St. Mary's Hospital NICU utilizes daylight in one section and circadian lighting in the other to bring a natural diurnal cycle of light to the infants which can be blocked out by curtains if too bright. In addition, coverings on the windows are helping to control the amount of daylight received by the babies. The NICU has also created separate zones within the room for the babies and their families which allow the babies to sleep in more controlled light while families are able to still enjoy natural light.

This example follows similar cases that suggest that these lighting practices may help increase sleep in the babies (patients) which is critical for their brain development, as well as result in less stress in staff and comfortable conditions for their parents (visitors). In a similar case at an NICU in Bath, England, healthy building measures such as controlled lighting and exposure to more natural lighting resulted in babies sleeping for 20% longer (Maddox 2014). In addition, compared to an older unit without these measures, parents visited an average of 30 minutes longer a day and staff reported feeling less cramped and less stressed. Moreover, 90% of babies were breastfed in the unit, compared with 64% of babies observed in the old unit.

<sup>8</sup> Ratings are based on the Hospital Consumer, Assessment of Healthcare Providers and Systems (HCAHPS) survey, which is the first national, standardized, publicly reported survey of patients' perspectives of hospital care. Source: [https://hcahpsonline.org/globalassets/hcahps/facts/hcahps\\_fact\\_sheet\\_october\\_2019.pdf](https://hcahpsonline.org/globalassets/hcahps/facts/hcahps_fact_sheet_october_2019.pdf).

## References

- AHA (American Hospital Association). (2020). "Fast Facts on U.S. Hospitals, 2020." <https://www.aha.org/statistics/fast-facts-us-hospitals>.
- Alimoglu, M.K., and L. Donmez. (2005). "Daylight exposure and the other predictors of burnout among nurses in a University Hospital." *International journal of nursing studies*, 42(5), 549-555.
- ASHRAE. (2014). "Interpretation IC 170-2013-2 of ANSI/ASHRAE/ASHE Standard 170-2013 Ventilation of Health Care Facilities." Available at <https://www.ashrae.org/File%20Library/Technical%20Resources/Standards%20and%20Guidelines/Standards%20Intepretations/IC170-2013-2.pdf>.
- ASHRAE. (2017). ANSI/ASHRAE/ASHE Standard 170-2017 Ventilation of Health Care Facilities; American Society of Heating, Refrigerating and Air-Conditioning Engineers Inc.: Atlanta, GA, 2006.
- ASHRAE. (2019). "Health Care Facilities In 2019 HVAC Applications Handbook." Atlanta, GA: American Society of Heating, Refrigerating and Air-Conditioning Engineers.
- Balaras, C.A., E. Dascalaki, and A. Gaglia. (2007). "HVAC and indoor thermal conditions in hospital operating rooms." *Energy and Buildings* 39(4); pp. 454-470.
- Bartley, J.M., R.N. Olmsted, and J. Haas. (2010). "Current views of health care design and construction: Practical implications for safer, cleaner environments." *American Journal of Infection Control* 38(5); S1-S12.
- Beauchemin, K.M. and P. Hays. (1998). "Dying in the dark: sunshine, gender and outcomes in myocardial infarction." *Journal of the Royal Society of Medicine* 91(7); pp. 352-354.
- Benedetti, F., C. Colombo, B. Barbini, E. Campori, and E. Smeraldi. (2001). "Morning sunlight reduces length of hospitalization in bipolar depression." *Journal of Affective Disorders* 62(3); pp. 221-223.
- Booker, J.M., and C. Roseman. (1995). "A seasonal pattern of hospital medication errors in Alaska." *Psychiatry Research* 57(3); pp. 251-257.
- Buchanan, T.L., K.N. Barker, J.T. Gibson, B.C. Jiang, and R.E. Pearson. (1991). "Illumination and errors in dispensing." *American Journal of Hospital Pharmacy* 48(10); pp. 2137-2145.
- Cao, H., A.L. Gray, L.F. Lester, and M. Osinski. (2006). Monolithically integrated twin ring diode lasers with quantum-dot active region. In *Physics and Simulation of Optoelectronic Devices XIV* (Vol. 6115, p. 611521). International Society for Optics and Photonics.
- Cartledge, S. (2019). "Healthy Buildings: how we can improve our hospitals and homes through healthy infrastructure." *World Healthcare Journal*. Available at <https://worldhealthcarejournal.com/newsdit-article/c9dfb0f5bf324d6e2b93136c66c99cec>.
- Craig, B., A. Bourassa, K. Ruest, D. Hill, and S. Marshall. (2003). *Air Quality in Interior Environments*. Ottawa: Canada Mortgage and Housing Corporation.
- Della Barba, M.P. (2014). *Optimizing Energy Use in a HealthCare Setting*. 22<sup>nd</sup> National Conference on Building Commissioning. <http://www.bcx.org/wp-content/uploads/2014/06/Cx-Hospitals-DellaBarba-DB.pdf>
- Deloach, C. (2004). "Healthcare is going green: saving dollars and making sense." Business Briefings: Hospital Engineering & Facilities Management. London: International Federation of Hospital Engineering.

Derks, M.T.H., A.K. Mishra, M.G.L.C. Loomans, and H.S.M. Kort. (2018). “Understanding thermal comfort perception of nurses in a hospital ward work environment.” *Building and Environment* 140; pp. 119-127.

DoD (The U.S. Department of Defense). (2019). Unified Facilities Criteria (UFC): Design: Military Medical Facilities. UFC 4-510-01. Change 2, 4 December 2019.

Dudalski, N., A. Mohamed, S. Mubareka, R. Bi, C. Zhang, and E. Savory. (2020). “Experimental investigation of far-field human cough airflows from healthy and influenza-infected subjects.” *Indoor Air*, 30(5):966-977. DOI: 10.1111/ina.12680.

Dunwoody, N. (2017). “Building Wellness into Healthcare Facilities.” Christner, Inc. <https://christnerinc.com/blog/building-wellness-into-healthcare-facilities>.

EIA (Energy Information Administration). (2012). Commercial Buildings Energy Consumption Survey 2012 Microdata. Accessed June 2, 2020 at <https://www.eia.gov/consumption/commercial/data/2012/index.php?view=microdata>.

Emmerich, S., H.E. Burroughs, W. Fisk, C. Sekhar, S. Taylor, and W. Thomann. (2017). “Indoor Air Quality.” ASHRAE Position Document, Approved by ASHRAE Board of Directors. [https://www.ashrae.org/file%20library/about/position%20documents/ashrae\\_pd\\_indoor\\_air\\_quality2017.pdf](https://www.ashrae.org/file%20library/about/position%20documents/ashrae_pd_indoor_air_quality2017.pdf).

English, T.R. (2016). “A Brief History of Health-Care Ventilation.” *ASHRAE Journal* 58(6); pp. 52-60.

Escombe, A.R., D.A. Moore, R.H. Gilman, M. Navincopa, E. Ticona, B. Mitchell, C. Noakes, C. Martinez, P. Sheen, R. Ramirez, W. Quino, A. Gonzalez, J.S. Friedland, and C. Evans. (2009). “Upper-room ultraviolet light and negative air ionization to prevent tuberculosis transmission.” *PLoS medicine* 6(3). DOI: 10.1371/journal.pmed.1000043.

Figueiro, M.G., A. Bierman, B. Plitnick, and M.S. Rea. (2009). “Preliminary evidence that both blue and red light can induce alertness at night.” *BMC Neuroscience* 10(105).

Figueiro, M.G., J.D. Bullough, A. Bierman, C.R. Fay, and M.S. Rea. (2007). “On light as an alerting stimulus at night.” *Acta Neurobiologiae Experimentalis* 67(2); pp. 171-178.

Figueiro, M.G., L. Sahin, B. Wood, and B. Plitnick. (2016). “Light at night and measures of alertness and performance: implications for shift workers.” *Biological Research for Nursing* 18(1); pp. 90-100.

Ghani, S., S.M.A. Gamaledin, M.M. Rashwan, and M.A. Atieh. (2018). “Experimental investigation of double-pipe heat exchangers in air conditioning applications.” *Energy and Buildings* (158), 801-811.

Hamilton, D.K. (2003). “The four levels of evidence-based practice.” *Healthcare Design*, 18-26.

Hellgren, U.M. and K. Reijula. (2006). “Indoor-air-related complaints and symptoms among hospital workers.” *SJWEH Supplements* (2); pp. 47-49.

Holzman, D.C. (2010). What’s in a color? The unique human health effects of blue light.” *Environ Health Perspect.* A22-A27. doi: 10.1289/ehp.118-a22.

Hoskins, J.A. (2003). “Health effects due to indoor air pollution.” *Indoor and Built Environment* 12(6); pp. 427-433.

IES (Illuminating Engineering Society). (2016). “Lighting for Hospitals and Healthcare Facilities.” ANSI/IES RP-28-16, Revised. New York, NY.



IHS (Indian Health Service). (2019). 2019 Architect / Engineer Design Guide. Available at [https://www.ihs.gov/sites/des/themes/responsive2017/display\\_objects/documents/IHS\\_Architect\\_and\\_Engineer\\_Design\\_Guide-508-V1.pdf](https://www.ihs.gov/sites/des/themes/responsive2017/display_objects/documents/IHS_Architect_and_Engineer_Design_Guide-508-V1.pdf).

Jeong, J.W., A. Choi, and S.T. No. (2010). "Improvement in demand-controlled ventilation simulation on multi-purposed facilities under an occupant based ventilation standard." *Simulation Modelling Practice and Theory* 18(1); 51-62.

Joarder, M.A.R., A.D. Price, and M. Mourshed. (2009). Systematic study of the therapeutic impact of daylight associated with clinical recovery.

Kim, S.H. and G. Augenbroe. (2009, July). "Ventilation operation in hospital isolation room: a multi-criterion assessment considering organizational behaviour." In Eleventh Int IBPSA Conference, Glasgow, Scotland.

King, D., C. Beebe, J. Suchomel, P. Bardwell, V. Della Donna, and L. Walt. (2017). "State of U.S. Health Care Facility Infrastructure." ASHE [American Society for Healthcare Engineering] Monograph.

Kos, C. and D. Quadi. (2010). Healing today's hospitals. <https://www.csemag.com/articles/healing-todays-hospitals>

Li, Y., G.M. Leung, J.W. Tang, X. Yang, C.Y. Chao, J.Z. Lin, J.W. Lu, P.V. Nielsen, J. Niu, H. Qian, A.C. Sleight, H.-J.J. Su, J. Sundell, T.W. Wong, and P.L. Yuen. (2007). "Role of ventilation in airborne transmission of infectious agents in the built environment-a multidisciplinary systematic review." *Indoor Air* 17(1); pp. 2-18. doi: 10.1111/j.1600-0668.2006.00445.x.

Maddox, L. (2014). "Building healthier hospitals." *MOSAIC*. <https://mosaicscience.com/story/building-healthier-hospitals/>.

Marks, F.M. (2013). "Letter to the Editors: Lighting for Different Healthcare Settings." *HERD: Health Environments Research & Design Journal* 6(3); 166-168.

Memarzadeh, F., R.N. Olmsted, and J.M. Bartley. (2010). "Applications of ultraviolet germicidal irradiation disinfection in health care facilities: effective adjunct, but not stand-alone technology." *American Journal of Infection Control* 38(5); S13-S24.

Mendell, M.J., W.J. Fisk, M.R. Petersen, C.J. Hines, M. Dong, D. Faulkner, J.A. Deddens, A.M. Ruder, D. Sullivan, and M.F. Boeniger. (2002). "Indoor particles and symptoms among office workers: results from a double-blind cross-over study." *Epidemiology* 13(3); 296-304. doi: 10.1097/00001648-200205000-00010.

Morag, I. and A. Ohlsson. (2016). Cycled light in the intensive care unit for preterm and low birth weight infants. *Cochrane Database of Systematic Reviews*, (8).

Morawska, L., J.W. Tang, W. Bahnfleth, P.M. Bluyssen, A. Boerstra, G. Buonanno, J. Cao, S. Dancer, A. Floto, ... M. Yao. (2020). "How can airborne transmission of COVID-19 indoors be minimised?" *Environment International*, 142, 105832. doi: 10.1016/j.envint.2020.105832.

Moriyama, M., W.J. Hugentobler, and A. Iwasaki. (2020). "Seasonality of respiratory viral infections." *Annual Review of Virology*, 7.

Nastase, I., C. Croitoru, A. Vartires, and L. Tataranu. (2016). "Indoor environmental quality in operating rooms: an European standards review with regard to Romanian guidelines." *Energy Procedia* 85; 375-382.

- Oren, D.A., K.L. Wisner, M. Spinelli, C.N. Epperson, K.S. Peindl, J.S., Terman, and M. Terman. (2002). "An open trial of morning light therapy for treatment of antepartum depression." *American journal of Psychiatry* 159(4); 666-669.
- Plitnick, B., M.G. Figueiro, B. Wood, and M.S. Rea. 2010. "The effects of red and blue light on alertness and mood at night." *Lighting Research and Technology* 42(4); pp. 449-458.
- Rea, M.S. and M.G. Figueiro. (2013). "A working threshold for acute nocturnal melatonin suppression from "white" light sources used in architectural applications." *J Carcinog Mutagen* 4(3); pp. 150-5.
- Rea, M.S. and M.G. Figueiro. (2016). "The NICU lighted environment." *Newborn and Infant Nursing Reviews* 16(4); pp. 195-202.
- Reijula, J., R. Holopainen, E. Kähkönen, K. Reijula, and I.D. Tommelein. (2013). "Intelligent HVAC systems in hospitals." *Intelligent Buildings International* 5(2); pp. 101-119.
- Rogers, A.E., W.T. Hwang, L.D. Scott, L.H. Aiken, and D.F. Dinges. (2004). "The working hours of hospital staff nurses and patient safety." *Health Affairs* 23(4); pp. 202-212.
- Schernhammer, E.S., F. Laden, F.E. Speizer, W.C. Willett, D.J. Hunter, I. Kawachi, and G.A. Colditz. (2001). "Rotating night shifts and risk of breast cancer in women participating in the nurses' health study." *Journal of the National Cancer Institute* 93(20); pp. 1563-1568.
- Soltic, S. and A. Chalmers. (2019). "Optimization of LED Lighting for Clinical Settings." *Journal of Healthcare Engineering*, p. 8. <https://doi.org/10.1155/2019/5016013>.
- Sumaya, I.C., Rienzi, B.M., Deegan, J.F., and D.E. Moss. (2001). "Bright light treatment decreases depression in institutionalized older adults: a placebo-controlled crossover study." *The Journals of Gerontology Series A: Biological Sciences and Medical Sciences* 56(6), M356-M360.
- Taylor, S. and M. Arch. (2016). *Breathe easy: Two basic steps to improve patient outcomes and healthcare reimbursement*. Available at <https://cndarcdn.scdn3.secure.raxcdn.com/m/0/breatheeasy-wp-drtaylor-final-web-v102016.pdf>.
- Taylor, S. and M. Arch. (2017). *The Essential role of Indoor Air Quality in Patient Outcomes: New Tools and New Understanding*. ASHRAE New Mexico Chapter meeting. 16 January 2018. <http://www.newmexicoashrae.org/resources/Documents/Presentations/Essential%20Role%20of%20IAQ%20in%20Patient%20Outcomes.pdf>.
- Ulrich, R. S., C. Zimring, X. Zhu, J. DuBose, H. B. Seo, H. B., Y. S. Choi, X. Quan, and A. Joseph. (2008). A review of the research literature on evidence-based healthcare design. *HERD: Health Environments Research & Design Journal*, 1(3), 61-125.
- Ulrich, R.S. (1984). "View through a window may influence recovery from surgery." *Science*, 224(4647), 420-421.
- VA (U.S. Department of Veterans Affairs). (2015). *Lighting Design Manual*. Available at <https://www.cfm.va.gov/til/dManual/dmLighting.pdf>.
- VA (U.S. Department of Veterans Affairs). (2020). *HVAC Design Manual 2017 (Rev. March 1, 2020)*. Available at <https://www.cfm.va.gov/til/dManual/dmHVAC.pdf>.

Verheyen, J., N. Theys, L. Allonsius, and F. Descamps. (2011). "Thermal comfort of patients: Objective and subjective measurements in patient rooms of a Belgian healthcare facility." *Building and Environment* 46(5), 1195-1204.

Walch, J.M., B.S. Rabin, R. Day, J.N. Williams, K. Choi, and J.D. Kang. (2005). "The effect of sunlight on postoperative analgesic medication use: a prospective study of patients undergoing spinal surgery." *Psychosomatic Medicine* 67(1); pp. 156-163.

WELL. (2020). A06: Enhanced Ventilation Design. WELL v2, Q4 2020, <https://v2.wellcertified.com/wellv2/en/air/feature/6>

WELL. (2020). L03: Circadian Lighting Design. WELL v2, Q4 2020, <https://v2.wellcertified.com/v/en/light/feature/3>

Werring, C.G. (2009). Design and application of fiber optic daylighting systems. <http://hdl.handle.net/2097/1473>.

Wolverton, M. (2013). "Living by the clock." *The Science of Chronobiology*. MedicalXpress, Medical Research, 7 p.

Yau, Y.H. (2008). "The use of a double heat pipe heat exchanger system for reducing energy consumption of treating ventilation air in an operating theatre—A full year energy consumption model simulation." *Energy and Buildings* 40(5); pp. 917-925.

Yau, Y.H. and W.K. Ng. (2011). "A comparison study on energy savings and fungus growth control using heat recovery devices in a modern tropical operating theatre." *Energy Conversion and Management* 52(4); pp. 1850-1860.

Yu, I.T., Y. Li, T.W. Wong, W., Tam, A.T. Chan, J.H.W. Lee, J. H., D.Y.C. Leung, and T. Ho. (2004). "Evidence of airborne transmission of the severe acute respiratory syndrome virus." *New England Journal of Medicine* 350(17); pp. 1731-1739. doi: 10.1056/NEJMoa032867.





U.S. DEPARTMENT OF  
**ENERGY**

Office of  
**ENERGY EFFICIENCY &  
RENEWABLE ENERGY**

For more information, visit: [energy.gov/eere/femp](https://energy.gov/eere/femp)

PNNL-SA-153493 · December 2020